STEALTH

PINNACLE

Service Manual

SC-36ZPL-HP230 / SC-36WPL-HP230

Table of Contents

Part I : Technical Information

1. Summary.....1

2. Specification .....2 - 9

2.2 Capacity Variation Ratio According to Temperature.....8

2.3 Noise Curve.....9

2.4 Cooling and Heating Data Sheet in Rated Frequency 9

3.Outline Dimension Diagram .....10 - 11

3.1 Indoor Unit 10

3.2 Outdoor Unit .....10 - 11

4. Refrigerant System Diagrams.....12 - 14

5. Electrical Part.....15 - 21

5.1 Wiring Diagram 18

5.2 PCB Printed Diagram .....19 - 20

6. Function and Control.....21 - 34

6.1 Remote Controller Introduction of YAN1F6F(WiFi).....22 - 25

6.2 Remote Controller Introduction of YV1FB9F(WiFi) .....26 - 29

6.3 GREE+ App Operation Manual.....30

6.4 Ewpe Smart App Operation Manual.....31

6.5 Brief Description of Modes and Functions .....32 - 34

Part Ⅱ : Installation and Maintenance

7. Notes for Installation and Maintenance .....35 - 37
7.1 Main tools for installation and maintenance.....37
8. Installation.....38 - 44
8.1 Installation Dimension Diagram.....38 - 39
8.2 Installation Parts-checking 40
8.3 Selection of Installation Location 40
8.4 Requirements for electrical connection.....40
8.5 Installation of Indoor unit.....40 - 42
8.6 Installation of Outdoor unit.....43 - 44
8.7 Vacuum Pumping and Leak Detection.....44
8.8 Check after Installation and Test Operation.....44
9. Trouble.....45 - 70
9.1 Flashing LED of Indoor/Outdoor unit and primary judgement.....45 - 51
9.1a. Analysis or processing of some of the malfunction display.....52
9.2 How to check the main part.....56 - 68
9.3 Troubleshooting for basic malfunctions.....69 - 70
10.Exploded View and parts list.....71 - 81
11.Removal Procedure.....82 - 101
11.1 Indoor Unit.....82 - 90
11.2 Removal Procedure of of outdoor unit.....91 - 101
APPENDIX.....102 - 106

Part Ⅰ : Technical Information

1. Summary


Indoor Unit: **Outdoor Unit:**


SC-36ZPL-HP230 / SC-36WPL-HP230


YAN1F6F(WiFi)

Remote Controller:



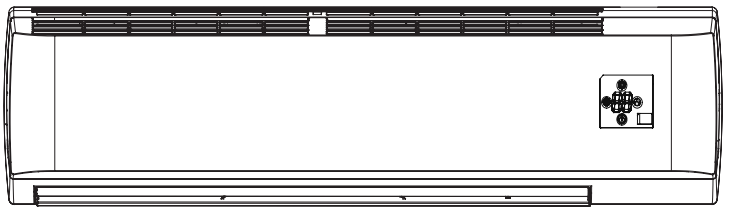

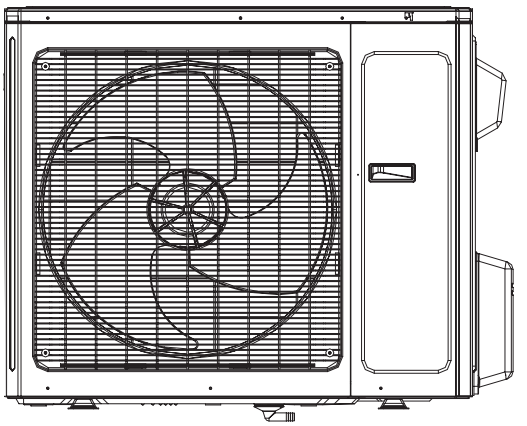

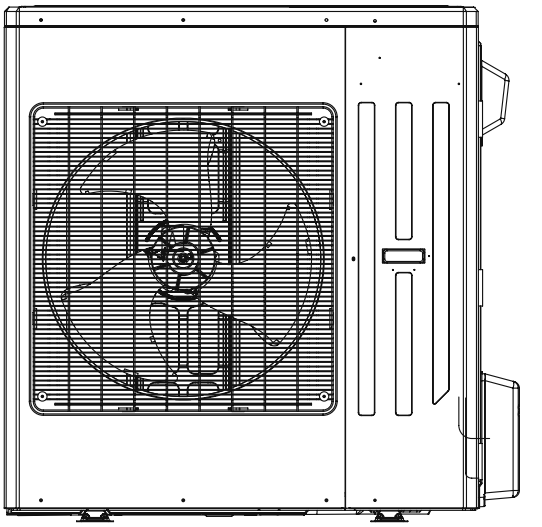

Model			SC-36ZPL-HP230
Product Code			CB432010100
Power Supply	Rated Voltage	V~	208/230
	Rated Frequency	Hz	60
	Phases		1
Power Supply Mode			Outdoor
Cooling Capacity(Min~Max)		Btu/h	33000(8800~40900)
Heating Capacity(Min~Max)		Btu/h	34600(16700~49400)
Cooling Power Input(Min~Max)		W	3220(500~4100)
Heating Power Input(Min~Max)		W	3100(1000~7000)
Cooling Power Current		A	14.7
Heating Power Current		A	14.2
Rated Input		W	7000
Rated Current		A	19
Rated Heating Current		A	30
Air Flow Volume(SH/H/M/L)		CFM	824/706/589/441
Dehumidifying Volume		Pint/h	7.4
EER		(Btu/h)/W	10.25
COP		(Btu/h)/W	11.16
SEER			23
HSPF			10.5
Application Area		yd^2	55.01-83.72
Indoor Unit	Model of indoor unit		SC-36WPL-HP230
	Indoor Unit Product Code		CB432N10100
	Fan Type		Cross-flo
	Diameter Length(DXL)	inch	Φ4 1/4X20 9/16
	Fan Motor Cooling Speed (SH/H/M/L)	r/min	1550/1300/1150/850
	Fan Motor Heating Speed (SH/H/M/L)	r/min	1500/1300/1150/1000
	Output of Fan Motor	W	70
	Fan Motor RLA	A	0.4
	Fan Motor Capacitor	μF	/
	Evaporator Form		Aluminum Fin-copper Tube
	Pipe Diameter	inch	Φ9/32
	Row-fin Ga	inch	2-1/16
	Coil Length (LXDXW)	inch	42 9/32X1X15
	Swing Motor Model		MP24BA
	Output of Swing Motor	W	2
	Fuse	A	5
	Sound Pressure Level (SH/H/M/L)	dB (A)	54/49/44/37
	Sound Power Level (SH/H/M/L)	dB (A)	64/59/54/47
	Dimension (WXHXD)	inch	53 9/64X12 53/64X9 61/64
	Dimension of Carton Box (LXWXH)	inch	56 39/64X16 29/64X13 55/64
	Dimension of Package (LXWXH)	inch	56 47/64X16 37/64X14 7/16
	Net Weight	lb	41.9
	Gross Weight	lb	51.8


Outdoor Unit	Model of Outdoor Unit		SC-36ZPL-HP230
	Outdoor Unit Product Code		CB432W10100
	Compressor Manufacturer/Trademark		ZHUHAI LANDA COMPRESSOR CO., LTD
	Compressor Model		QXAW-F518zX440C
	Compressor Oil		FV50S or equivalent
	Compressor Type		Rotary
	Compressor Locked Rotor Amp (L.R.A)		36
	Compressor RLA	A	24
	Compressor Power Input	W	5830±3%
	Overload Protector		/
	Throttling Method		Electron expansion valve
	Operation temp	ºF	61~86
	Ambient temp (cooling)	ºF	0~109
	Ambient temp (heating)	ºF	-31~75
	Condenser Form		Aluminum Fin-copper Tube
	Pipe Diameter	inch	Φ5/16
	Rows-fin Ga	inch	2-1/16
	Coil Length (LXDXW)	inch	41 37/64X1 1/2×38 13/64
	Fan Motor Speed	rpm	940
	Output of Fan Motor	W	170
	Fan Motor RLA	A	0.73
	Fan Motor Capacitor	μF	/
	Air Flow Volume of Outdoor Unit	CFM	3119
	Fan Type		Axial-flo
	Fan Diameter	inch	Φ21 21/32
	Defrosting Method		Automatic Defrosting
	Climate Type		T1
	Isolation		I
	Moisture Protection		IPX4
	Design Pressure(High)	PSIG	550
	Design Pressure(Low)	PSIG	240
	Sound Pressure Level (H/M/L)	dB (A)	63/-/-
	Sound Power Level (H/M/L)	dB (A)	73/-/-
	Dimension (WXHXD)	inch	43 37/64X43 1/2X16 9/64
	Dimension of Carton Box (LXWXH)	inch	45 1/2X18 57/64X45 39/64
	Dimension of Package (LXWXH)	inch	45 39/64X19 X44 9/32
	Net Weight	lb	253.53
	Gross Weight	lb	271.17
	Refrigerant		R410A
	Refrigerant Charge	oz	123.5
Connection Pipe	Length	ft	24.6
	Gas Additional Charge	oz/ft	0.3
	Outer Diameter Liquid Pipe	inch	1/4
	Outer Diameter Gas Pipe	inch	5/8
	Max Distance Height	ft	98.4
	Max Distance Length	ft	164
	Note:The connection pipe applies metric diameter.		

The above data is subject to change without notice; please refer to the nameplate of the unit.


2.2 Capacity Variation Ratio According to Temperature

Heating operation ambient temperature range is -4ºF~75ºF

Cooling

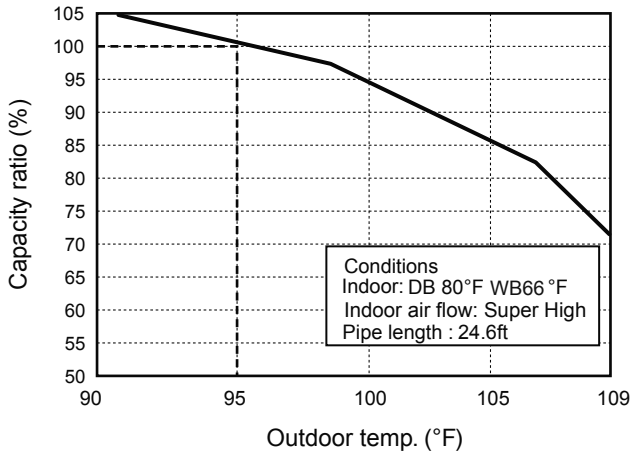


Heating

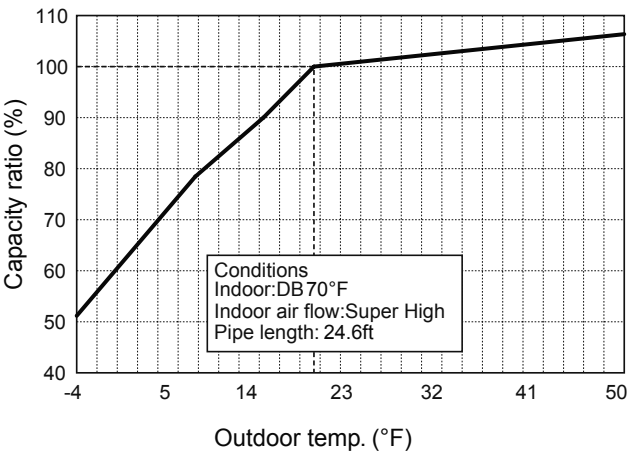


Heating operation ambient temperature range is -13ºF~75ºF

Cooling

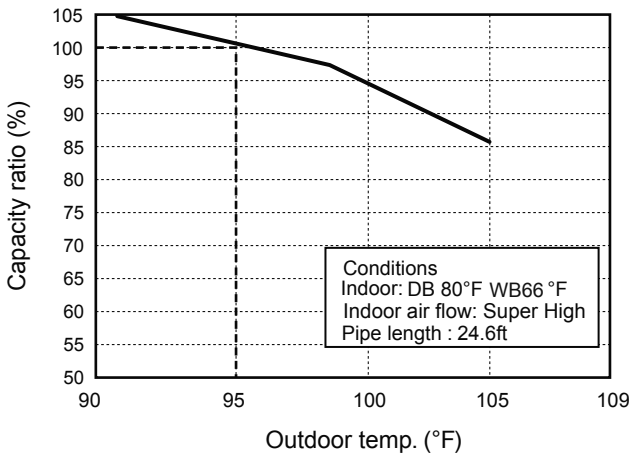


Heating

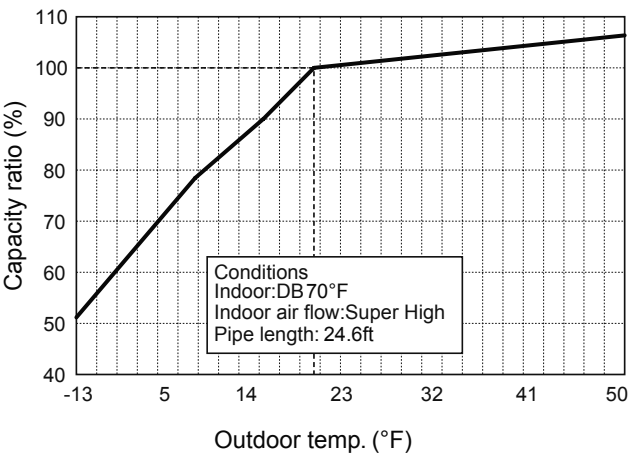


Heating operation ambient temperature range is -31ºF~75ºF

Cooling

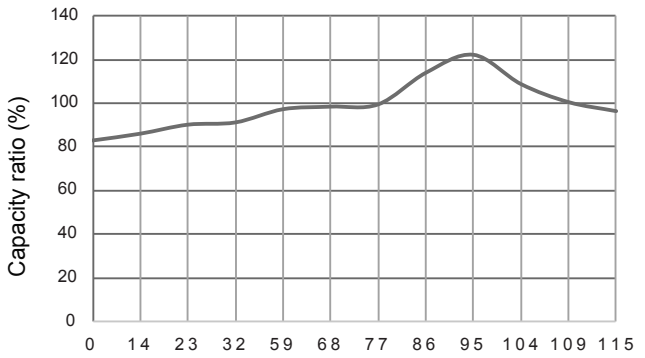


Heating

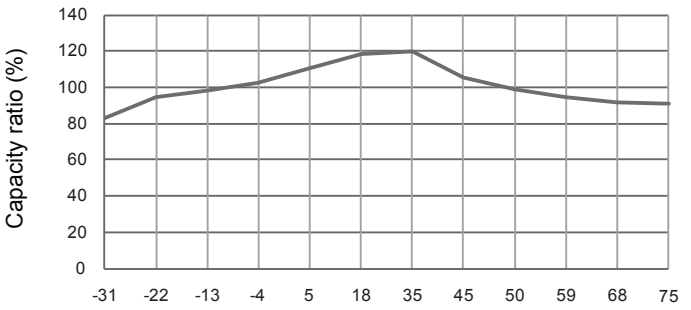


2.3 Noise Curve

Indoor side noise

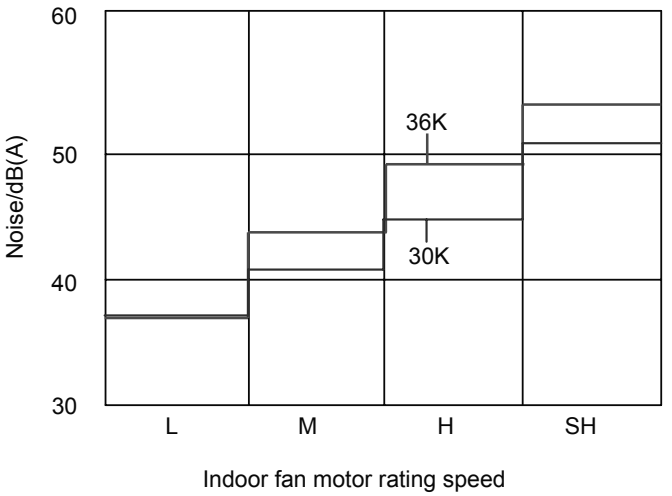

Outdoor side noise

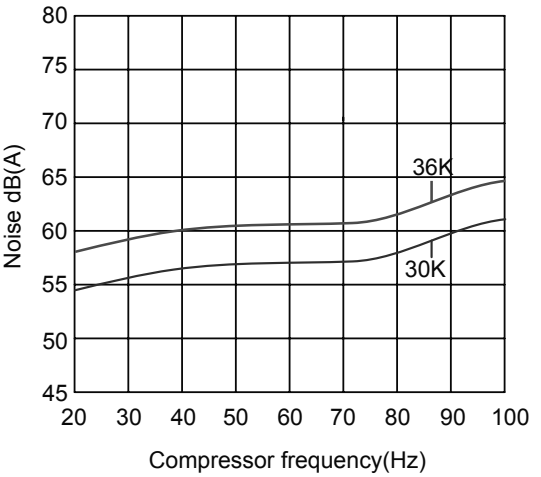

2.4 Cooling and Heating Data Sheet in Rated Frequency

Cooling:

Rated cooling condition(°F) (DB/WB)		Model	Pressure of gas pipe connecting indoor and outdoor unit	Inlet and outlet pipe temperature of heat exchanger		Fan speed of indoor unit	Fan speed of outdoor unit	Compressor revolution (rps)
Indoor	Outdoor		P (PSIG)	T1 (°F)	T2 (°F)			
80/66	95/-	30K	130~145	46.8 to 52.8	127 to 96.8	Super High	High	46
80/66	95/-	36K	130~145	46.8 to 52.8	127 to 96.8	Super High	High	37

Heating:


Rated heating condition(°F) (DB/WB)		Model	Pressure of gas pipe connecting indoor and outdoor unit	Inlet and outlet pipe temperature of heat exchanger		Fan speed of indoor unit	Fan speed of outdoor unit	Compressor revolution (rps)
Indoor	Outdoor		P (PSIG)	T1 (°F)	T2 (°F)			
70/-	20/19	30K	507~550	134.4 to 102	36 to 39	Super High	High	46
70/-	20/19	36K	507~550	134.4 to 102	36 to 39	Super High	High	34

Instruction:
T1: Inlet and outlet pipe temperature of evaporator
T2: Inlet and outlet pipe temperature of condenser
P: Pressure at the side of big valve
Connection pipe length: 24.6ft.

3. Outline Dimension Diagram

3.1 Indoor Unit


SC-36WPL-HP23

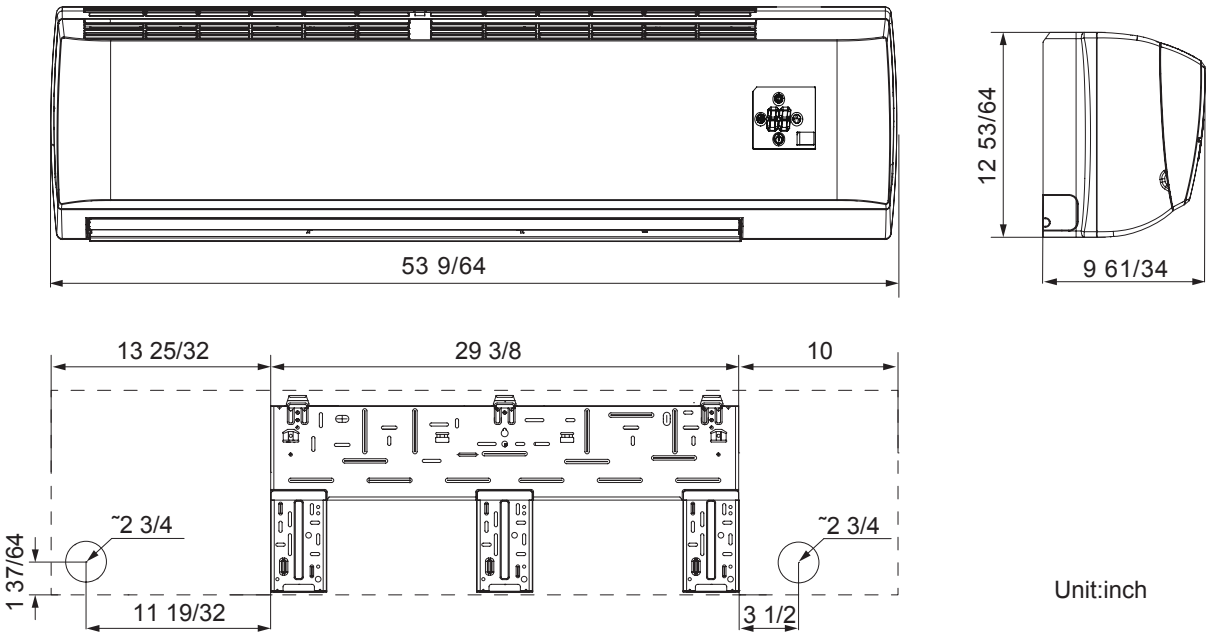

Unit:inch


3.2 Outdoor Unit

SC-36ZPL-HP230

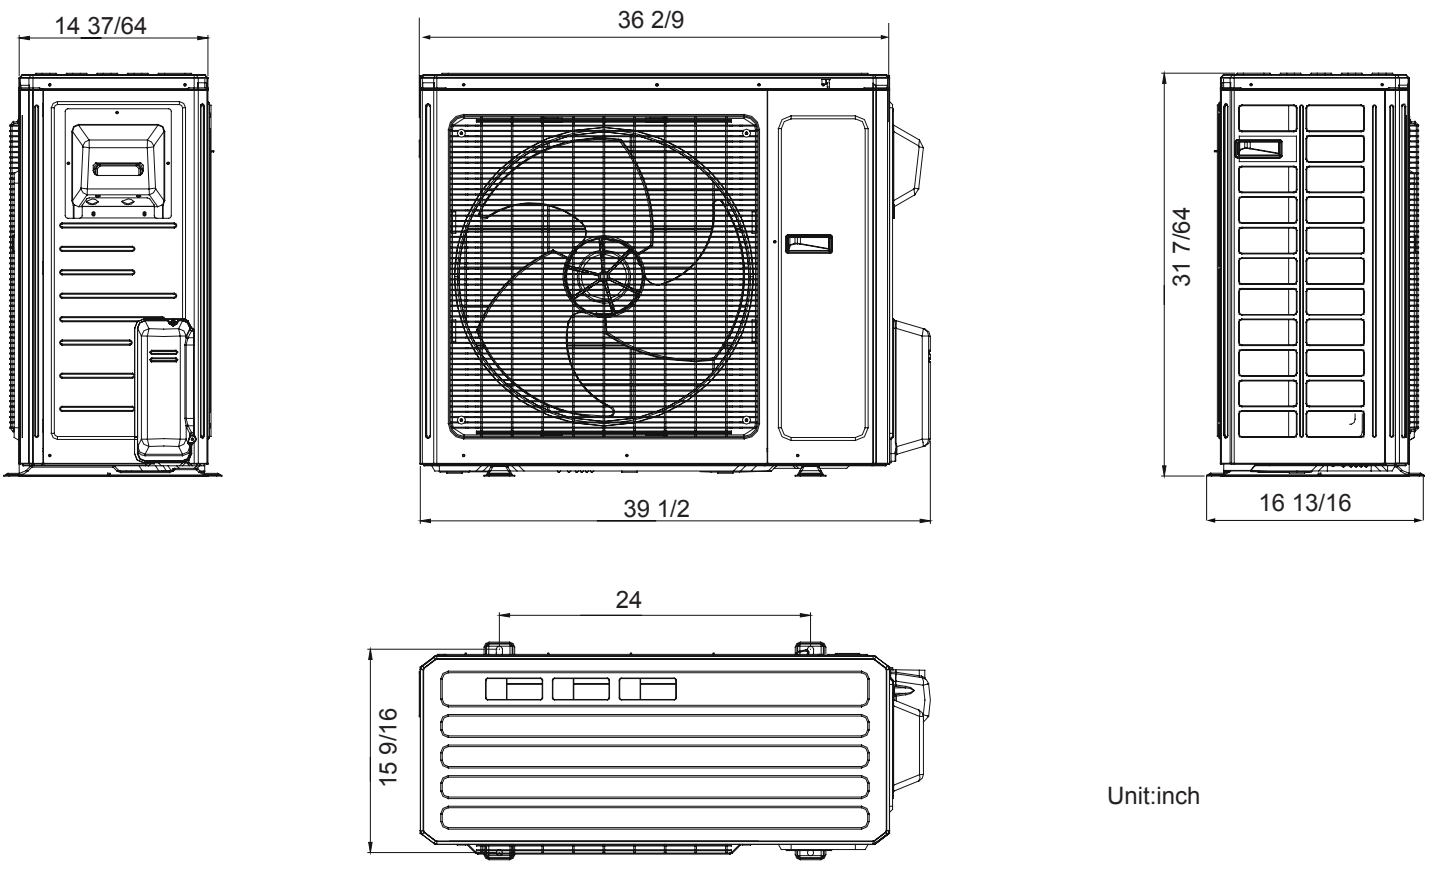

Unit:inch

SC-36ZPL-HP230/SC-36WPL-HP230

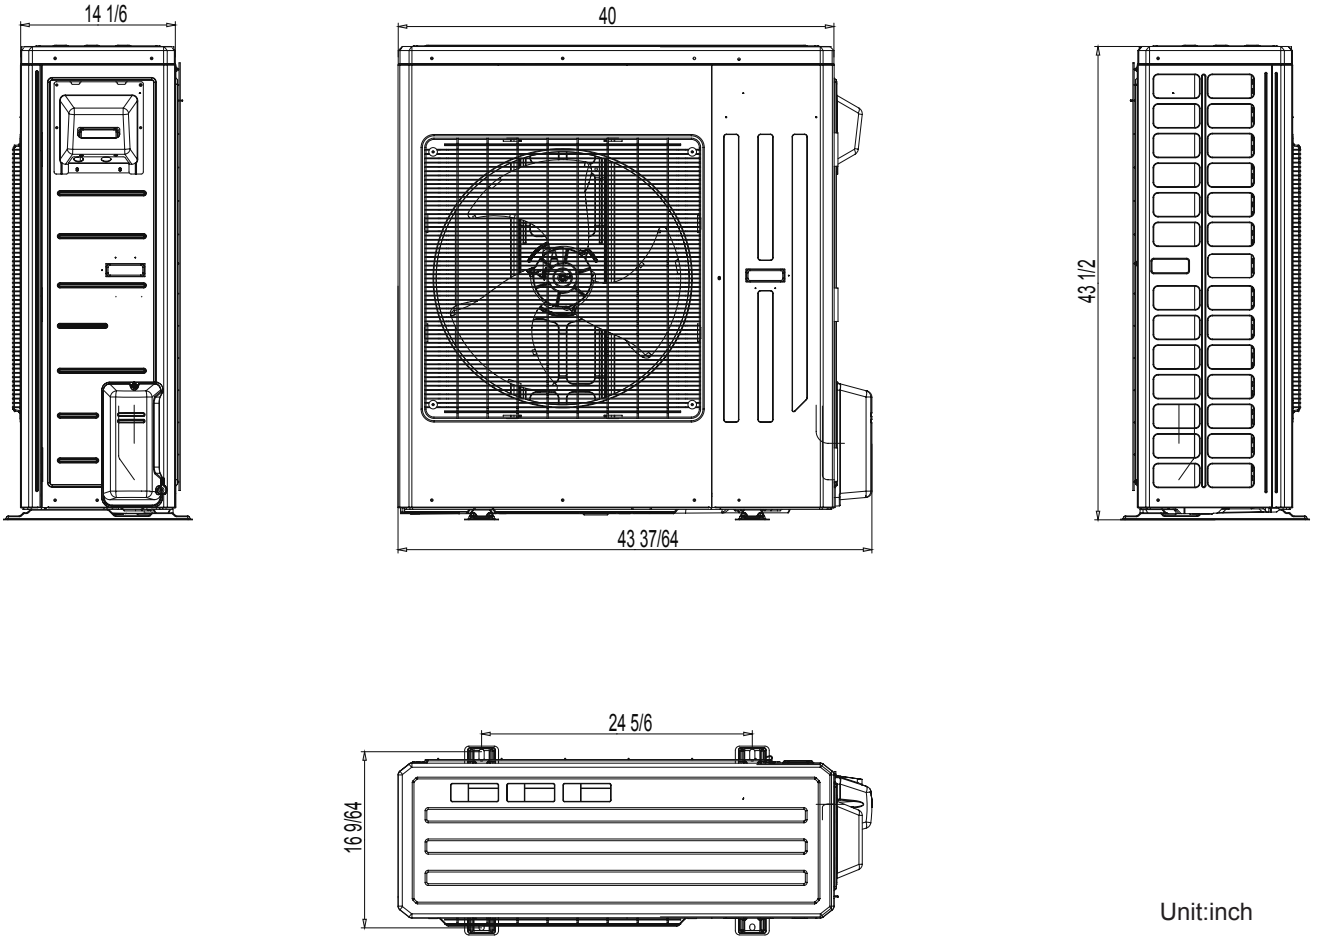


Unit:inch


4. Refrigerant System Diagram

30K except :GWH30QF-D3DNB2I

Cooling only model

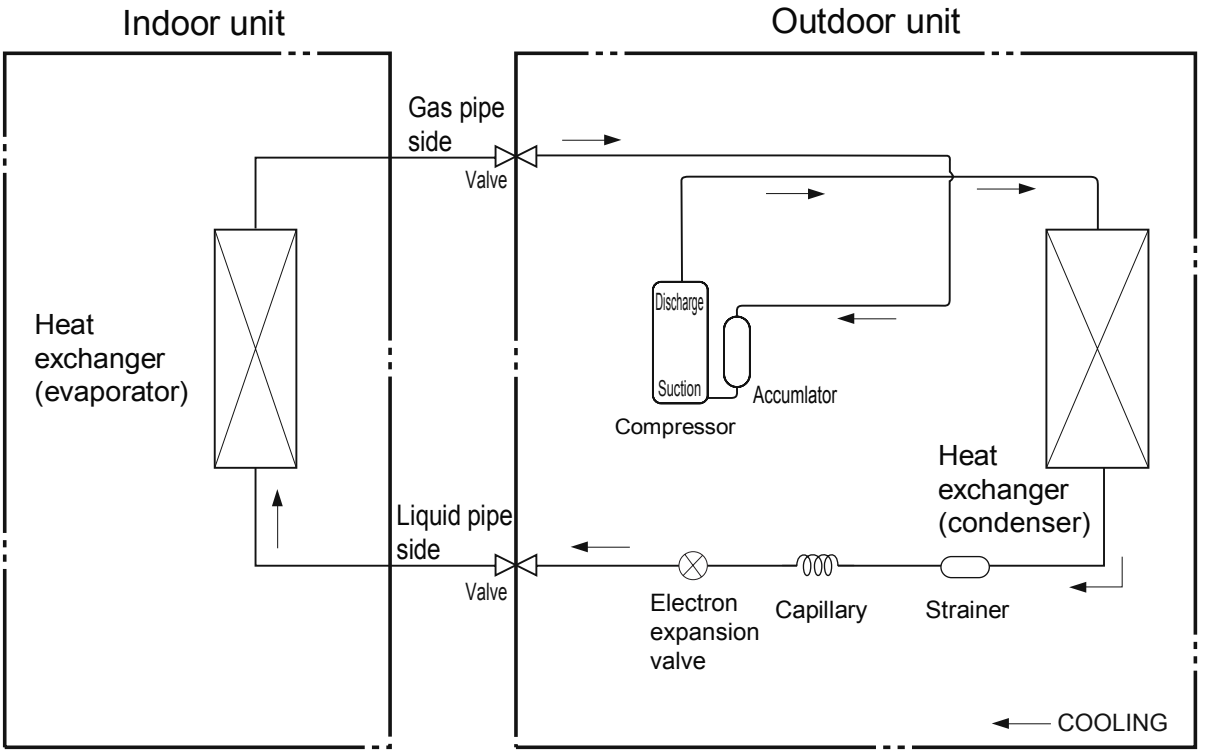

Cooling and heating model

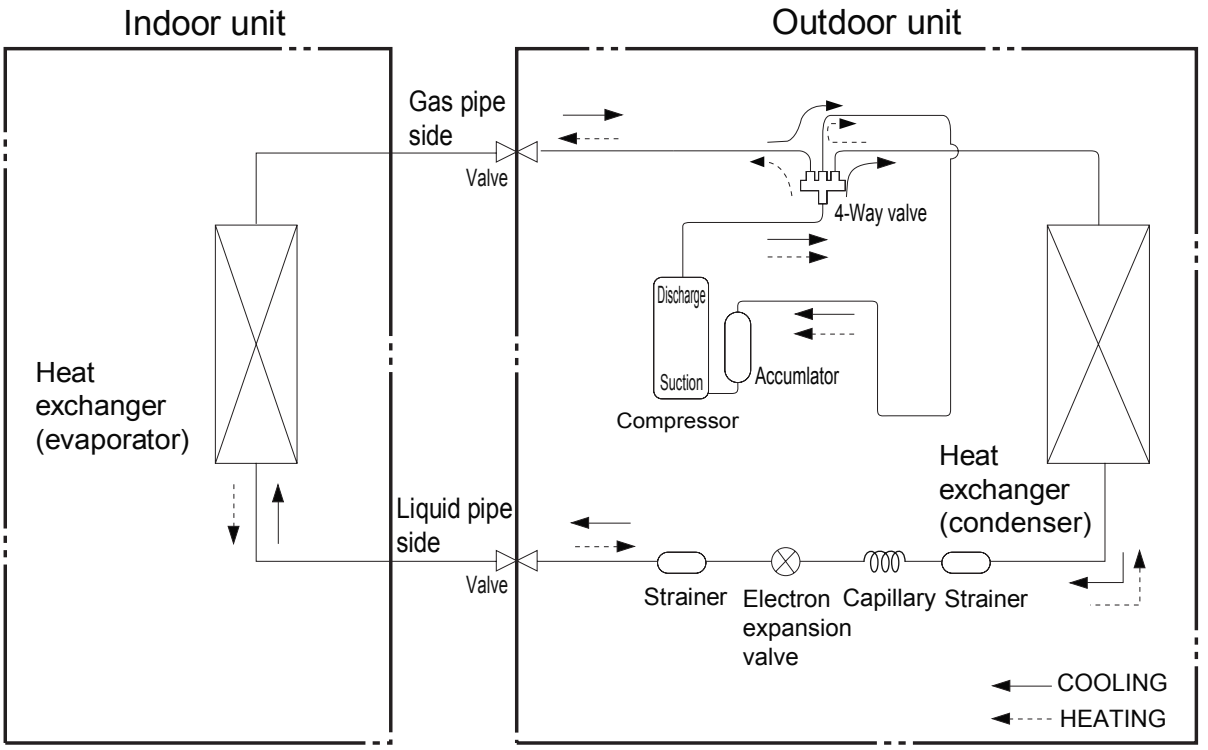


Connection pipe specification

Liquid pipe:1/4 inch


Gas pipe:5/8 inch

36K except SC-36ZPL-HP230

Cooling only model

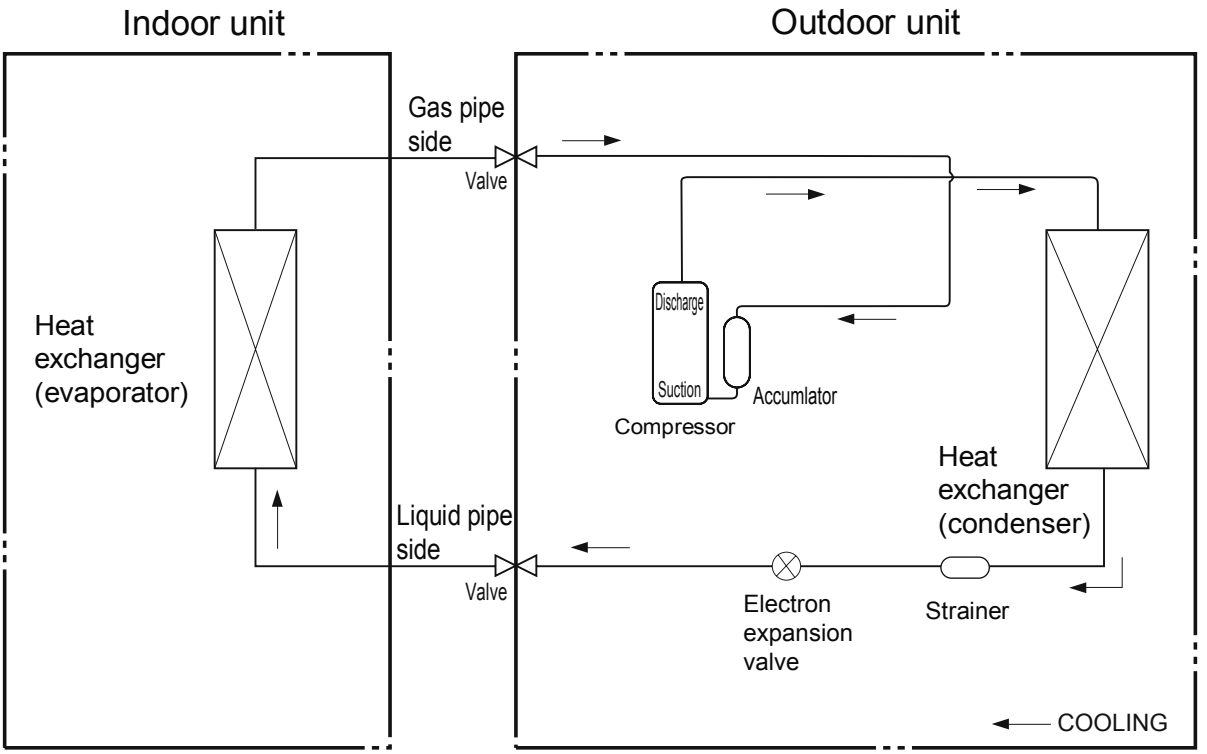

Cooling and heating model

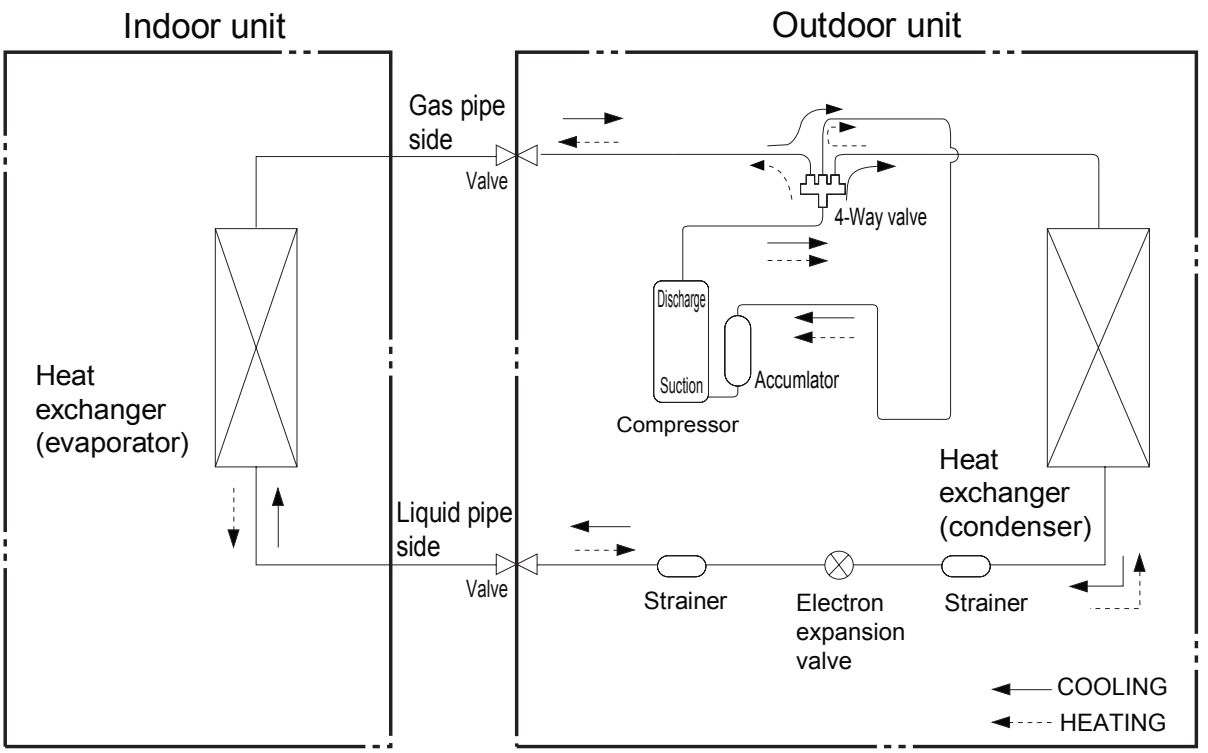


Connection pipe specification

Liquid pipe:1/4 inch

Gas pipe:5/8 inch

SC-36ZPL-HP230/SC-36WPL-HP230

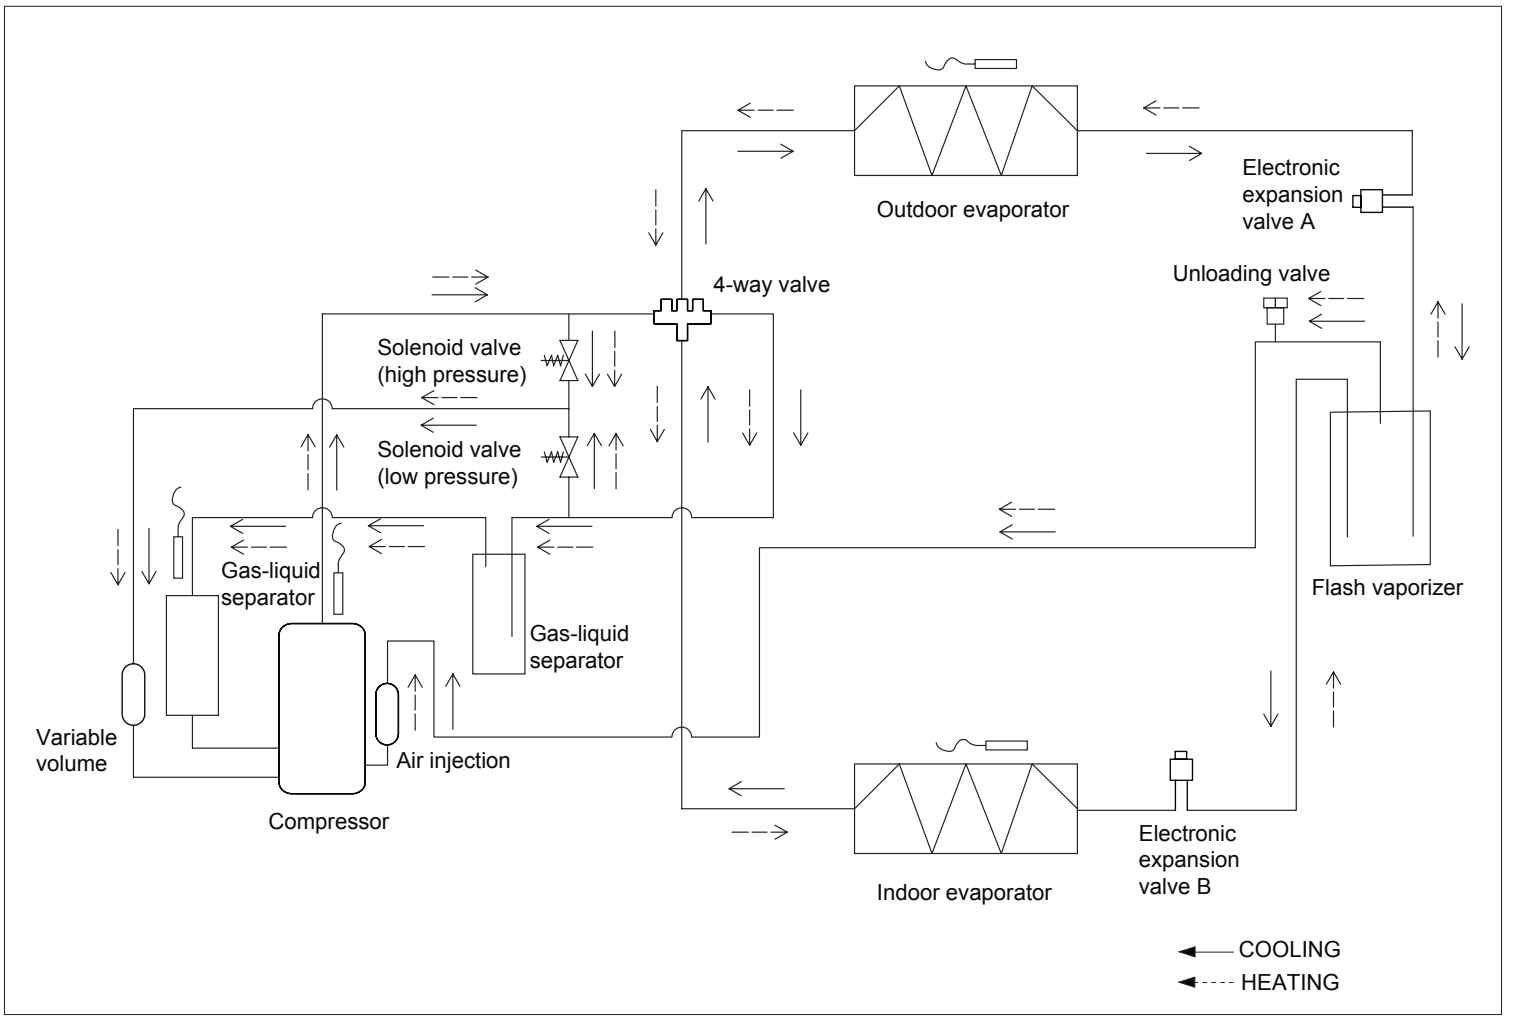

Connection pipe specification

Liquid pipe:1/4 inch

Gas pipe:5/8 inch

5. Electrical Part


5.1 Wiring Diagram

● **Instruction**

Symbol	Symbol Color	Symbol	Symbol Color	Symbol	Name
WH	White	GN	Green	CAP	Jumper cap
YE	Yellow	BN	Brown	COMP	Compressor
RD	Red	BU	Blue	⏚	Grounding wire
YEGN	Yellow/Green	BK	Black	/	/
VT	Violet	OG	Orange	/	/


Note: Jumper cap is used to determine fan speed and the swing angle of horizontal lover for this model.


● **Indoor Unit**

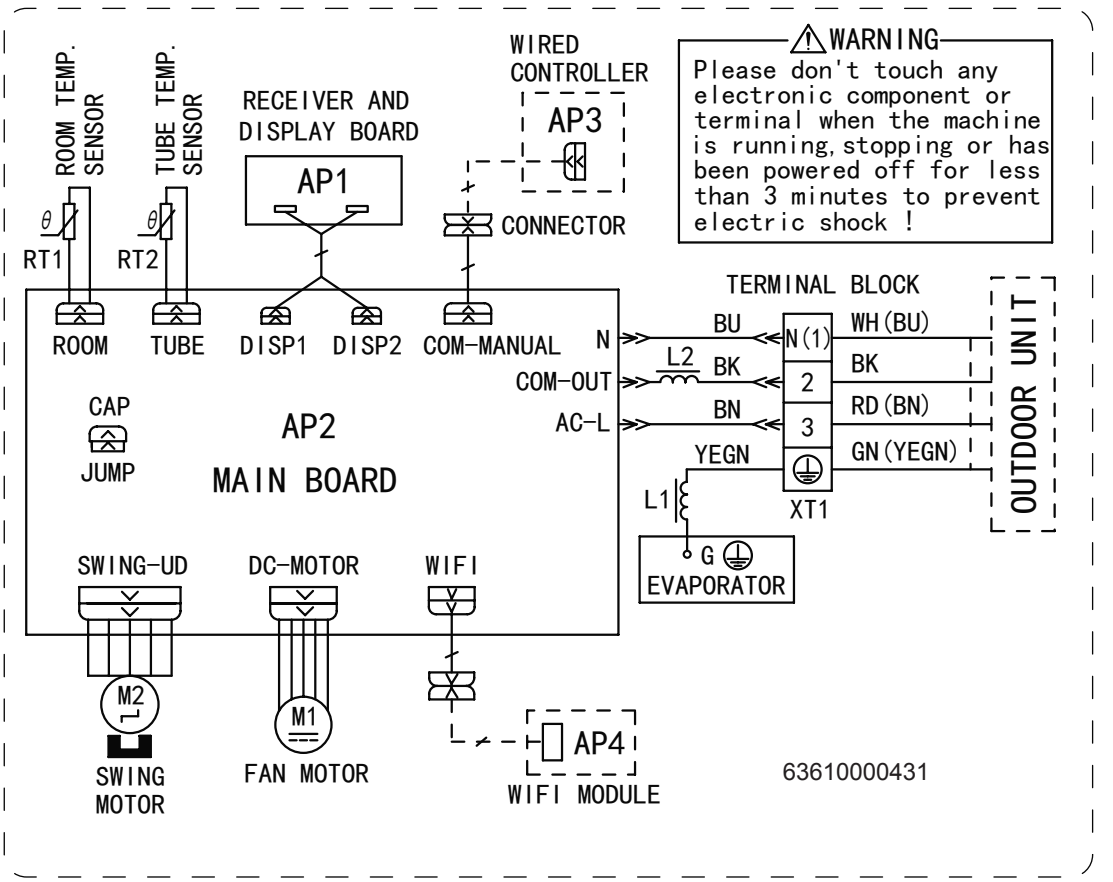


● Outdoor Unit

SC-36ZPL-HP230/SC-36WPL-HP230

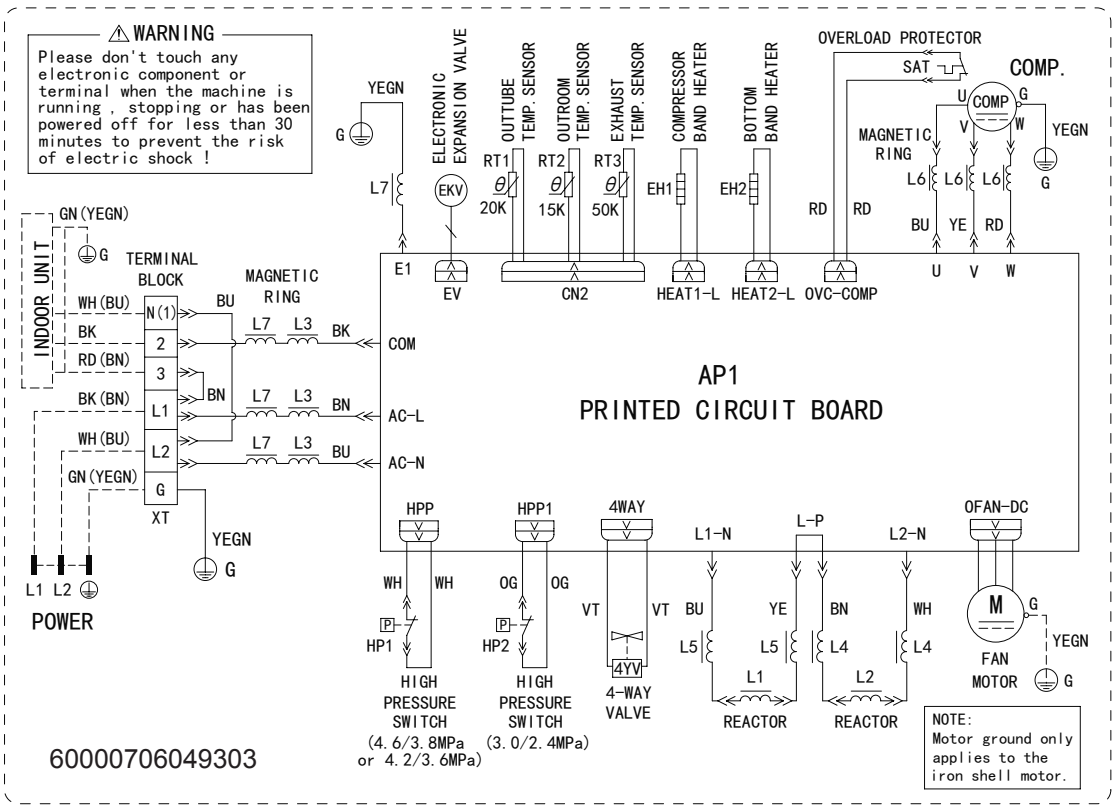

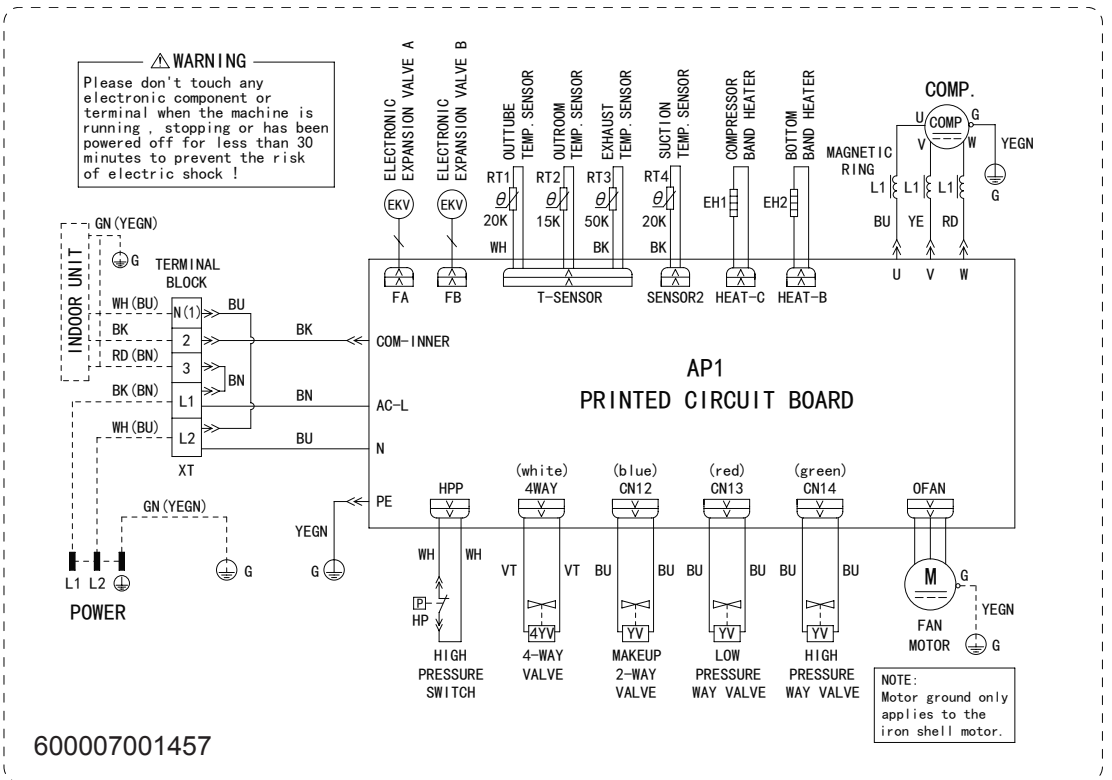

SC-36ZPL-HP230/SC-36WPL-HP230

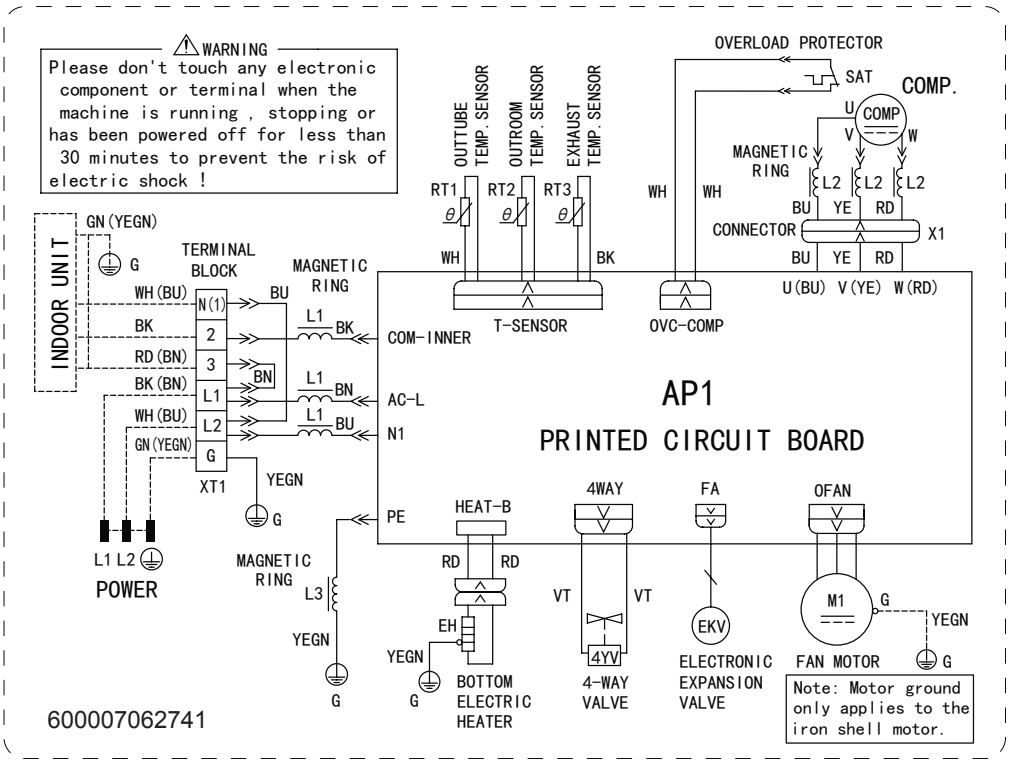


The above data is subject to change without notice. Please refer to the nameplate of the unit.

5.2 PCB Printed Diagram


Indoor Unit

- **Top View**

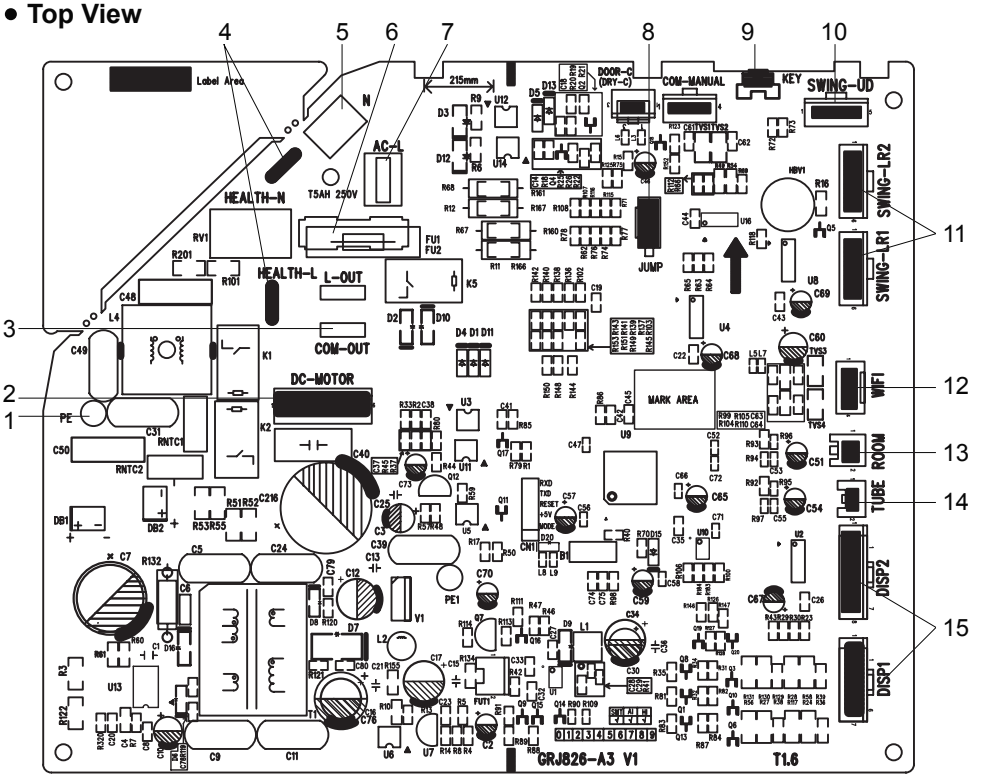


1	Grounding wire
2	DC motor needle stand
3	Communication terminal for outdoor unit
4	Interface of health function(only for the mode with this function)
5	Interface of neutral wire
6	Fuse
7	Interface of live wire
8	Needle stand for jumper cap
9	Auto button
10	up&down swing interface
11	Left&right swing interface
12	Wifi interface
13	Interface of ambient temperature sensor
14	Interface of tube temperature sensor
15	Display interface

- **Bottom View**

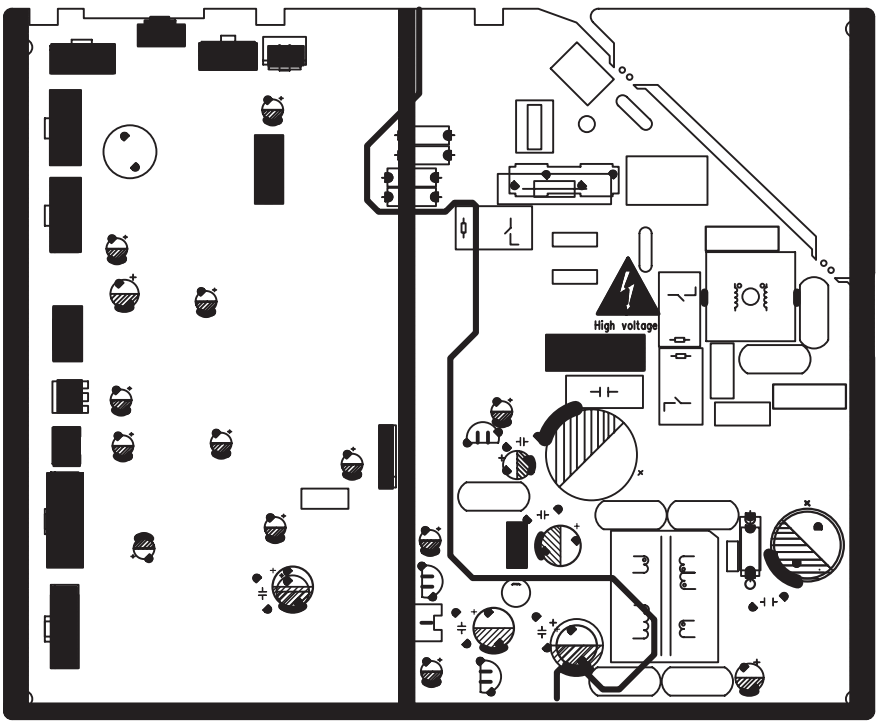


SC-36ZPL-HP230/SC-36WPL-HP230

• Top view

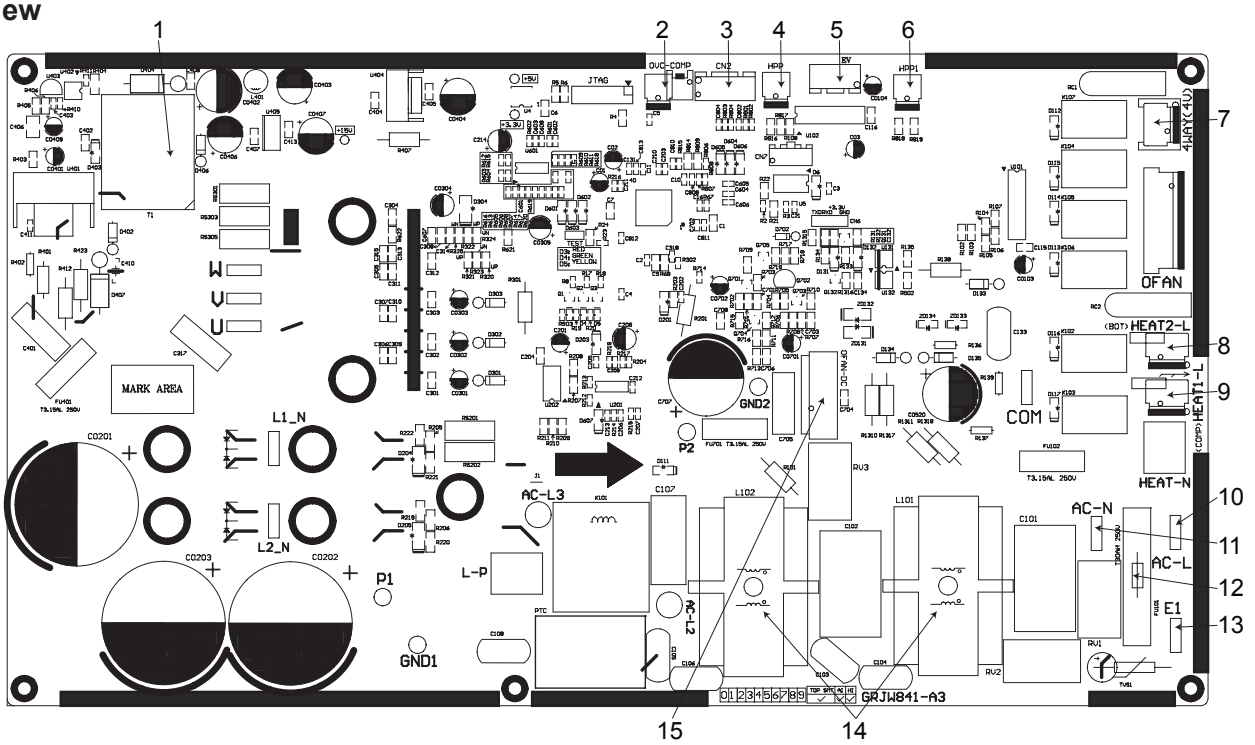


No.	Name	No.	Name	No.	Name
1	High-frequency transformer T1	6	High pressure protection terminal HPP1	11	Terminal of neutral wire
2	Overload protection terminal of compressor OVC-COMP	7	Terminal of 4-way valve	12	Protective tube FU101
3	Terminal of temp sensor CN2	8	Electric heater band of chassis HEAT2-L	13	Terminal of ground wire
4	High pressure protection terminal HPP	9	Electric heater band of compressor HEAT1-L	14	Choke L 101 and L102
5	Electronic expansion valve terminal EV	10	Terminal of live wire	15	Terminal of outdoor fan OFAN-DC

• Bottom view

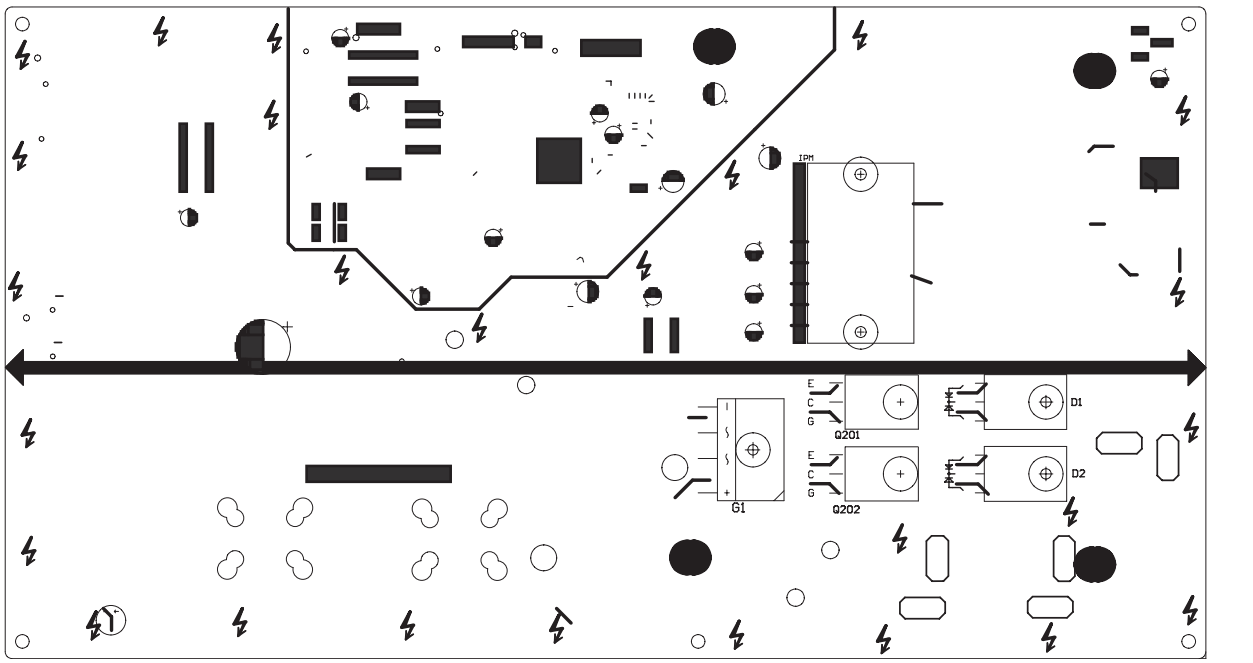


• Top view

SC-36ZPL-HP230/SC-36WPL-HP230

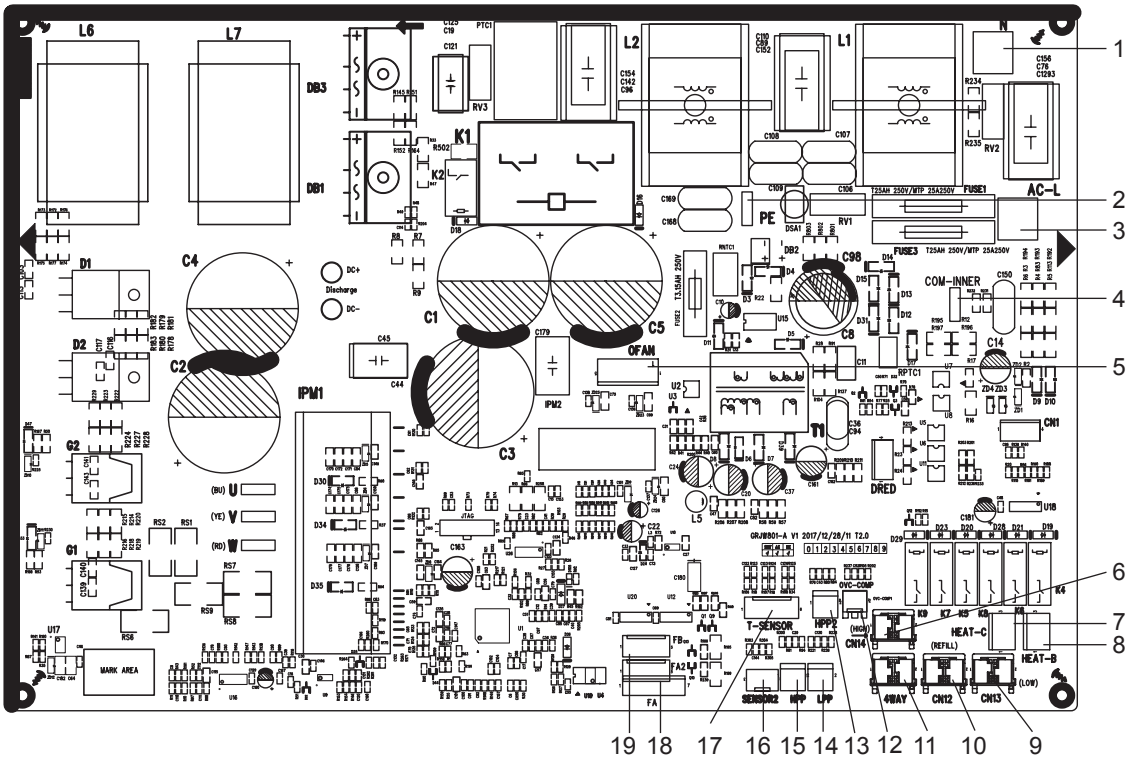

No.	Name	No.	Name	No.	Name
1	Neutral wire	8	Interface B of electric heating	15	Terminal for high pressure protection
2	Grounding wire	9	Terminal of low pressure valve	16	Interface 2 of temperature sensor
3	Live wire	10	Terminal of 2-way valve	17	Interface of temperature sensor
4	Communication interface	11	Terminal of 4-way valve	18	Terminal A of electronic expansion valve
5	Terminal of outdoor fan	12	Terminal of compressor overload protection	19	Terminal B of electronic expansion valve
6	Terminal of high pressure valve	13	Terminal for 2 high pressure protection		
7	Interface C of electric heating	14	Terminal for low pressure protection		

• Bottom view

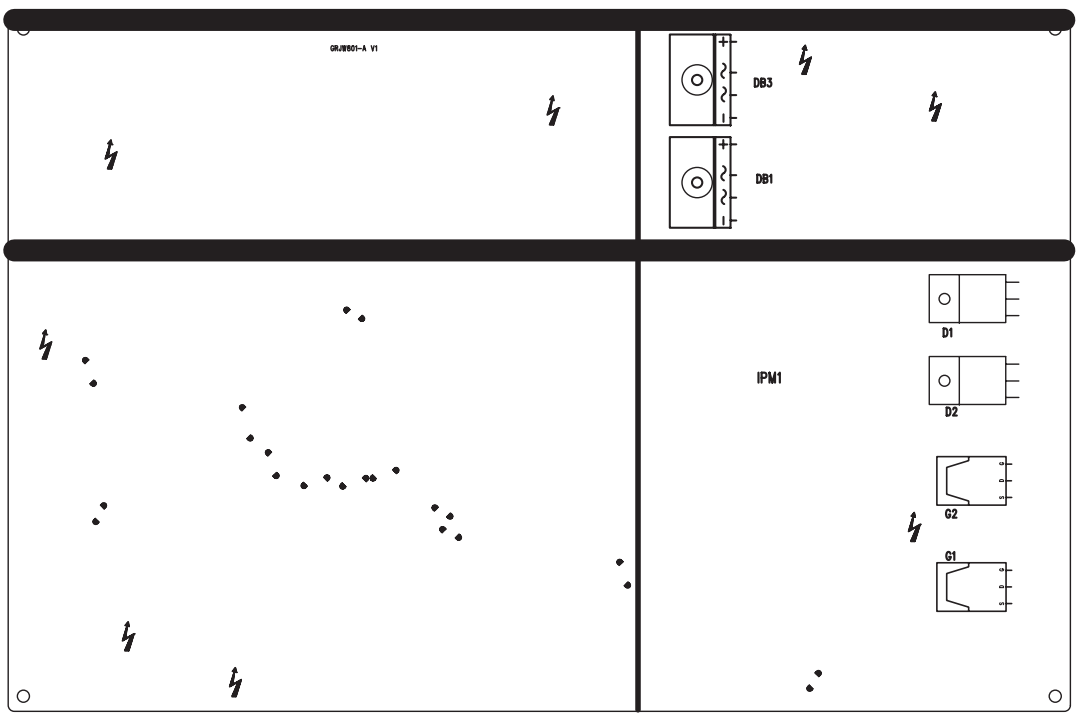


6. Function and Control

6.1 Remote Controller Introduction of YAN1F6F(WiFi)



1. ON/OFF button
2. MODE button
3. FAN button
4. SWING button
5. TURBO button
6. ˜/ bµtto n
7. SLEEP button
8. TEMP button
9. WIFI button
10. LIGHT button
11. CLOCK button
12. TIMER ON / TIMER OFF button

Introduction for icons on display screen

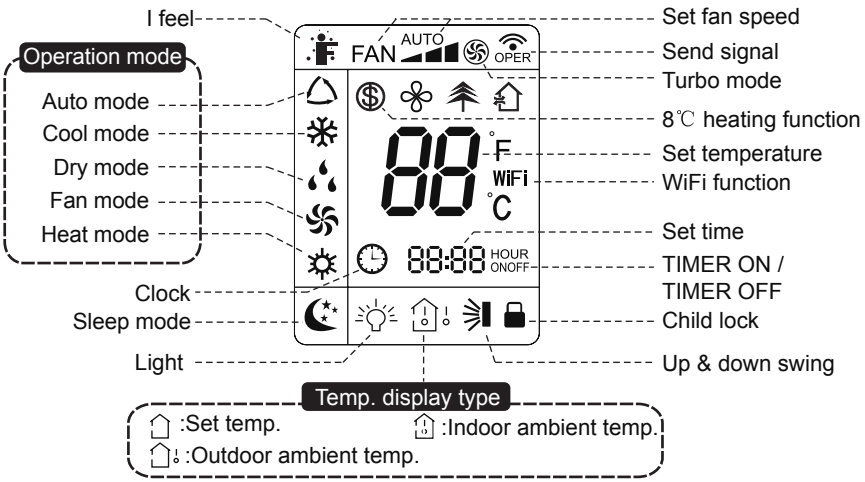

Introduction for buttons on remote controller

Note:

˜ This is a general use remote controller, it could be used for the air conditioners with multifunction; For some function, which the model doesn't have, if press the corresponding button on the remote controller that the unit will keep the original running status.

˜ After putting through the power, the air conditioner will give out a sound. Operation indicator "⏻" is ON (red indicator, the colour is different for different models). After that, you can operate the air conditioner by using remote controller.

˜ Under on status, pressing the button on the remote controller, the signal icon "📶" on the display of remote controller will blink once and the air conditioner will give out a “de” sound, which means the signal has been sent to the air conditioner.


˜ Under off status, set temperature and clock icon will be displayed on the display of remote controller (If timer on, timer off and light functions are set, the corre-sponding icons will be displayed on the display of remote controller at the same time); Under on status, the display will show the corresponding set function icons.

1. ON/OFF button

Press this button to turn on the unit. Press this button again to turn off the unit.

2. MODE button

Press this button to select your required operation mode.




● When selecting auto mode, air conditioner will operate automatically according to ex-factory setting. Set temperature can't be adjusted and will not be displayed as well. Press "FAN" button can adjust fan speed. Press "SWING" button can adjust fan blowing angle.
● After selecting cool mode, air conditioner will operate under cool mode. Cool indicator on indoor unit is ON(This indicator is not available for some models). Press „" or " "button to adjust set temperature. Press "F AN" button to adjust fan speed. Press "SWING" button to adjust fan blowing angle.
● When selecting dry mode, the air conditioner operates at low speed under dry mode. Dry indicator on indoor unit is ON(This indicator is not available for some models). Under dry mode, fan speed can't be adjusted. Press "SWING" button to adjust fan blowing angle.
● When selecting fan mode, the air conditioner will only blow fan, no cooling and no heating. Press "FAN" button to adjust fan speed. Press "SWING" button to adjust fan blowing angle.
● When selecting heating mode, the air conditioner operates under heat mode. Heat indicator on indoor unit is ON(This indicator is not available for some models).Press „" or " ""button to adjust set temperature. Press "F AN" button to adjust fan speed. Press "SWING" button to adjust fan blowing angle. (Cooling only unit won't receive heating mode signal. If setting heat mode with remote controller, press ON/OFF button can't start up the unit).

Note:

● For preventing cold air, after starting up heating mode, indoor unit will delay 1~5 minutes to blow air (actual delay time is depend on indoor ambient temperature).
● Set temperature range from remote controller: 16~30℃ ; Fan speed: auto, low speed, medium speed, high speed.

3. FAN button

Pressing this button can set fan speed circularly as: auto (AUTO), low( ) ,medium( ), high( ).




Note:

● Under AUTO speed, air conditioner will select proper fan speed automatically according to ex-factory setting.
● Fan speed under dry mode is low speed.
● X-FAN function:Hold fan speed button for 2s in COOL or DRY mode, the icon " " is displayed and the indoor fan will continue operation for a few minutes in order to dry the indoor unit even though you have turned off the unit. After energization, X-FAN OFF is defaulted. X-FAN is not available in AUTO, FAN or HEAT mode.
This function indicates that moisture on evaporator of indoor unit will be blowed after the unit is stopped to avoid mould.
●Having set X-FAN function on:After turning off the unit by pressing ON/OFF button indoor fan will continue running for a few minutes.at low speed.In this period,Hold fan speed button for 2s to stop indoor fan directly.
●Having set X-FAN function off: After turning off the unit by pressing ON/OFF button, the complete unit will be off directly.

4. SWING button

Press this button can select up&down swing angle. Fan blow angle can be selected circularly as below:



(horizontal louvers stops at current position)

● When selecting " ", air conditioner is blowing fan automatically. Horizontal louver will automatically swing up & down at maximum angle.
● When selecting " ", air conditioner is blowing fan at fixed position. Horizontal louver will stop at the fixed position.
● When selecting " " , air conditioner is blowing fan at fixed angle. Horizontal louver will send air at the fixed angle.
● Hold " "button above 2s to set your required swing angle. When reaching your required angle, release the button.

Note:

● " " may not be available. When air conditioner receives this signal, the air conditioner will blow fan automatically.

5. TURBO button

Under COOL or HEAT mode, press this button to turn to quick COOL or quick HEAT mode. " " icon is displayed on remote controller. Press this button again to exit turbo function and " " icon will disappear.

6. ¸/ ˜ button

‘ Press "˜" or " ˜" button once increase or decrease set temperature 1℃(1°F). . Holding "˜" or " ˜" button, 2s later, set temperature on remote controller will change quickly. On releasing button after setting is finished, temperature indica- tor on indoor unit will change accordingly. (Temperature can’t be adjusted under auto mode)


‘ When setting TIMER ON, TIMER OFF or CLOCK, press "˜" or " button to adjust time. (Refer to CLOCK, TIMER ON, TIMER OFF buttons)

7. SLEEP button

Under COOL, HEAT or DRY mode, press this button to start up sleep function. " " icon is displayed on remote controller. Press this button again to cancel sleep function and " " icon will disappear.

8. TEMP button

By pressing this button, you can see indoor set temperature, indoor ambient temperature or outdoor ambient temperature on indoor units display. The setting on remote controlleris selected circularly as below:



- When selecting " " or no display with remote controller, temperature indicator on indoor unit displays set temperature.
- When selecting " " with remote controller, temperature indicator on indoor unit displays indoor ambient temperature.
- When selecting " " with remote controller, temperature indicator on indoor unit displays outdoor ambient temperature.

Note:

- Outdoor temperature display is not available for some models. At that time, indoor unit receives " "signal, while it displays indoor set temperature.
- Its defaulted to display set temperature when turning on the unit.There is no display in the remote controller.
- Only for the models whose indoor unit has dual-8 display.
- When selecting displaying of indoor or outdoor ambient temperature, indoor temperature indicator displays corresponding temperature and automatically turn to display set temperature after three or five seconds.

9. WIFI button

Press " **WiFi** " button to turn on or turn off WiFi function. When WiFi function is turned on, the " **WiFi** " icon will be displayed on remote controller; Under status of remote controller off, press "**MODE**" and " **WiFi** " buttons simultaneously for 1s,WiFi modulewill restore to factory default setting.

10. LIGHT button

Press this button to turn off display light on indoor unit. " " icon on remote controller disappears. Press this button again to turn on display light. " " icon is displayed.

11. CLOCK button

Press this button to set clock time. " " icon on remote controller will blink. Press "–" or " –" button within 5s to set clock time. Each pressing of "–" or " –" button, clock time will increase or decrease 1 minute. If hold "–" or " –" button, 2s later, time will change quickly. Release this button when reaching your required time. Press "CLOCK" button to confirm the time. " " icon stops blinking.

Note:

- Clock time adopts 24-hour mode.
- The interval between two operation cant exceeds 5s. Otherwise, remote controller will quit setting status. Operation for TIMER ON/TIMER OFF is the same.

12. TIMER ON / TIMER OFF button

- TIMER ON button

  "TIMER ON" button can set the time for timer on. After pressing this button, " " icon disappears and the word "ON" on remote controller blinks. Press "–" or " –"button to adjust TIMER ON setting. After each pressing "–" or " –" button, TIMER ON setting will increase or decrease 1min. Hold "–" or " –" button, 2s later, the time will change quickly until reaching your required time. Press "TIMER ON" to confirm it. The word "ON" will stop blinking. " " icon resumes displaying. Cancel TIMER ON: Under the condition that TIMER ON is started up, press "TIMER ON" button to cancel it.

- TIMER OFF button

  "TIMER OFF" button can set the time for timer off. After pressing this button," " icon disappears and the word "OFF" on remote controller blinks. Press "–" or " –" button to adjust TIMER OFF setting. After each pressing "–" or " –" button,
  TIMER OFF setting will increase or decrease 1min. Hold "–" or " –" button, 2s later, the time will change quickly until reaching your required time. Press "TIMER OFF" word "OFF" will stop blinking. " " icon resumes displaying. Cancel TIMER OFF. Under the condition that TIMER OFF is started up, press "TIMER OFF" button to cancel it.

Note:

˜ Under on and off status, you can set TIMER OFF or TIMER ON simultaneously.

˜ Before setting TIMER ON or TIMER OFF, please adjust the clock time.

˜ After starting up TIMER ON or TIMER OFF, set the constant circulating valid. After that, air conditioner will be turned on or turned off according to setting time. ON/OFF button has no effect on setting. If you dont need this function, please use remote controller to cancel it.

Function introduction for combination buttons

1. Energy-saving function

Under cooling mode, press "TEMP" and " CLOCK" buttons simultaneously to start up or turn off energy-saving function. When energy-saving function is started up, "SE" will be shown on remote controller, and air conditioner will adjust the set temperature automatically according to ex-factory setting to reach to the best energy-saving effect. Press "TEMP" and "CLOCK"buttons simultaneously again to exit energy-saving function.

Note:

˜ Under energy-saving function, fan speed is defaulted at auto speed and it can't be adjusted.

˜ Under energy-saving function, set temperature can't be adjusted. Press "TURBO"button and the remote controller won't send signal.

˜ Sleep function and energy-saving function can't operate at the same time. If energy-saving function has been set under cooling mode, press sleep button will cancel energy-saving function. If sleep function has been set under cooling mode, start up the energy-saving function will cancel sleep function.

2. 8 ℃ heating function

Under heating mode, press "TEMP" and "CLOCK" buttons simultaneously to start up or turn off 8℃ heating function. When this function is started up, " ⓢ " and "8℃ " will be shown on remote controller, and the air conditioner keep the heating status at 8℃ . Press "TEMP" and "CLOCK" buttons simultaneously again to exit 8℃ heating function.

Note:

˜ Under 8℃ heating function, fan speed is defaulted at auto speed and it can't be adjusted.

˜ Under 8℃ heating function, set temperature can't be adjusted. Press"TURBO" button and the remote controller won't send signal.

˜ Sleep function and 8℃ heating function can't operate at the same time. If 8℃ heating function has been set under cooling mode, press sleep button will cancel 8℃ heating function. If sleep function has been set under cooling mode, start up the 8℃ heating function will cancel sleep function.

˜ Under ℉ temperature display, the remote controller will display 46 ℉ heating.

3. Child lock function

Press "°" and " 。" simultaneously to turn on or turn off child lock function. When child lock function is on, " 🔒 " icon is displayed on remote controller. If you operate the remote controller, the " 🔒 " icon will blink three times without sending signal to the unit.

4. Temperature display switchover function

Under OFF status, press " 。" and "MODE" buttons simultaneously to switch temperature display between ℃ and ℉ .

5. I FELL Function

Press "°" and "MODE" buttons simultaneously to start I FEEL function and " " will be displayed on the remote controller. After this function is set, the remote controller will send the detected ambient temperature to the controller and the unitwill automatically adjust the indoor temperature according to the detected tempera-ture. Press this two buttons simultaneously again to close I FEEL function and " " will disappear.

˜ Please put the remote controller near user when this function is set. Do not put the remote controller near the object of high temperature or low temperature in order to avoid detecting inaccurate ambient temperature.When I FEEL function is turned on, the remote controller should be put within the area where indoor unit can receive the signal sent by the remote controller.

If "H1" is displayed on the remote controller while it's not operated by the professional person/after-sales person, it belongs to the misoperation.

Please operate it as below to cancel it.Under the OFF status of remote controller, hold the MODE button for 5s to cancel "H1" display.

Note:


˜ If remote controller displays "H1", it belongs to the normal function reminder. If the unit is defrosting under heating mode, it operates according to H1 defrosting mode. "H1" won't be displayed on the panel of indoor unit;

˜ Once you set H1 mode, if you turn off unit by remote controller, H1 will display 3 times on the remote controller and then disappear;

˜ Also, when you set H1 mode, when you change to heating mode, H1 will display 3 times on the remote controller and then disappear.

Replacement of batteries in remote controller

1. Press the back side of remote controller marked with " OPEN ", as shown in the fig, and then push out the cover of battery box along the arrow direction.
2. Replace two 7# (AAA 1.5V) dry batteries, and make sure the position of "+" polar and "-" polar are correct.
3. Reinstall the cover of battery box.



Note:


- ˜ During operation, point the remote control signal sender at the receiving window on indoor unit.
- ˜ The distance between signal sender and receiving window should be no more than 8m, and there should be no obstacles between them.
- ● Signal may be interfered easily in the room where there is fluorescent lamp or wireless telephone; remote controller should be close to indoor unit during operation.
- ˜ Replace new batteries of the same model when replacement is required.
- ˜ When you dont use remote controller for a long time, please take out the batteries.
- ˜ If the display on remote controller is fuzzy or theres no display, please replace batteries.

6.2 Remote Controller Introduction of YV1FB9F(WiFi)



1. ON/OFF button
2. ˜ button
3. MODE button
4. SWING button
5. ˷ button
6. FAN button
7. TIMER OFF button
8. CLOCK button
9. TIMER ON button
10. SLEEP button
11. TEMP button
12. TURBO button
13. X-FAN | button
14. WiFi button
15. /⌂ button

Introduction for icons on display screen

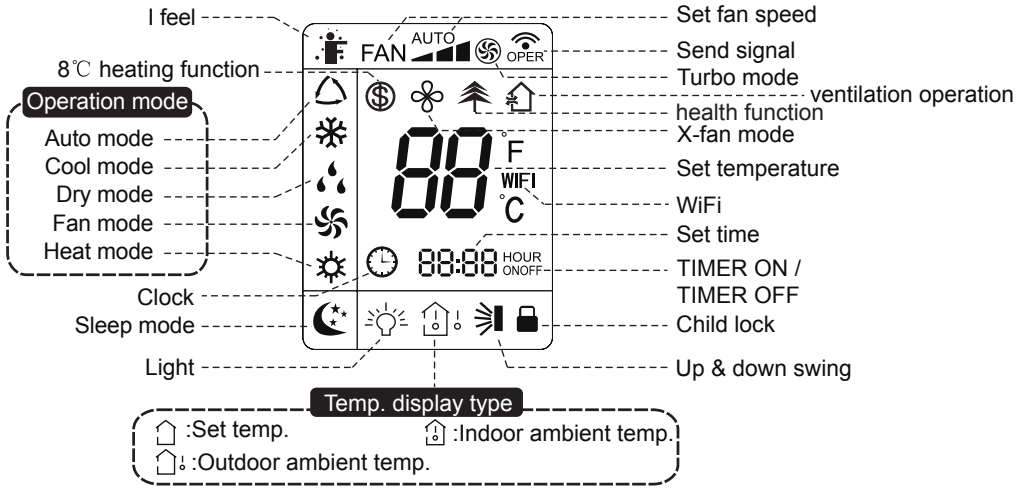

Introduction for buttons on remote controller

Note:

° This is a general use remote controller, it could be used for the air conditioners with multifunction;For some function, whic h the model doesn't have,if press the corresponding button on the remote controller that the unit will keep the original running status.

° After putting through the power, the air conditioner will give out a sound. Operation indicator "⏻" is ON (red indicator, the colour different for different models).After that, you can operate the air conditioner by using remote controller.

° Under on status, pressing the button on the remote controller, the signal icon "((•))" on the display of remote controller will blink once and the air conditioner will give out a “de” sound, which means the signal has been sent to the air conditioner.

° Under off status, set temperature and clock icon will be displayed on the display of remote controller (If timer on, timer off and light functions are set, the corre-sponding icons will be displayed on the display of remote controller at the same time); Under on status, the display will show the corresponding set function icons.

1. ON/OFF button

Press this button to turn on the unit. Press this button again to turn off the unit.

2. ▲ button

Press this button to increase set temperature. Holding it down above 2 seconds rapidly increases set temperature. In AUTO mode, set temperature is not adjustable.

3. MODE button

Each time you press this button,a mode is selected in a sequence that goes from AUTO, COOL, DRY, FAN, and HEAT *, as the following:


AUTO ▶ COOL ▶ DRY ▶ FAN ▶HEAT*

* Note: Only for models with heating function.

After energization, AUTO mode is defaulted. In AUTO mode, the set temperature will not be displayed on the LCD, and the unit will automatically select the suitable operation mode in accordance with the room temperature to make indoor room comfortable.

4. SWING button

Press this button to set up & down swing angle, which circularly changes as below:




This remote controller is universal . If any command , or is sent out,the unit will carry out the command as indicates the guide louver swings as:

5. ▼button

Press this button to decrease set temperature. Holding it down above 2 seconds rapidly decreases set temperature. In AUTO mode, set temperature is not adjustable.

6. FAN button

This button is used for setting Fan Speed in the sequence that goes from AUTO, ,,to , then back to Auto.



7. TIMER OFF button

Press this button to initiate the auto-off timer. To cancel the auto-timer program, simply press the button again.TIMER OFF setting is the same as TIMER ON.

8. CLOCK button

Press CLOCK button, blinking. Within 5 seconds, pressing ▲ or ▼ button adjusts the present time. Holding down either button above 2 seconds increases or decreases the time by 1 minute every 0.5 second and then by 10 minutes every 0.5 second. During blinking after setting, press CLOCK button again to confirm the setting, and then will be constantly displayed.

9. TIMER ON button


Press this button to initiate the auto-ON timer. To cancel the auto-timer program, simply press this button again.After press of this button, disappears and "ON "blinks. 0 0:00 is displayed for ON timesetting. Within 5 seconds, press ▲ or ▼ button to adjust the time value. Every press of either button changes the time setting by 1 minute. Holding down either button rapidly changes the time setting by 1 minute and then 10 minutes. Within 5 Seconds after setting, press TIMER ON button to confirm.

10. SLEEP button

Press this button to go into the SLEEP operation mode. Press it again to cancel this function. This function is available in COOL, HEAT (Only for models with heating function) to maintain the most comfortable temperature for you.

11. TEMP button

Press this button, you can see indoor set temperature, indoor ambient temperature on indoor unit's display. The setting on remote controller is selected circularly as below:



When selecting " " with remote controller or no display, temperature indicator on indoor unit displays set temperature; When selecting " " with remote controller, temperatureindicator on indoor unit displays indoor ambient temperature; 3s later or within 3s itreceives other remote controller signal that will return to display the setting temperature.

Caution:

• This model hasn't outdoor ambient temperature display function. While remote controllercan operate " " and indoor unit displays set temperature.

• It's defaulted to display set temperature when turning on the unit.

• Only for the models with temperature indicator on indoor unit.

12. TURBO button

Press this button to activate / deactivate the Turbo function which enables the unit to reach the preset temperature in the shortest time. In COOL mode, the unit will blow strong cooling air at super high fan speed. In HEAT mode, the unit will blow strong heating air at super high fan speed.

13. X-FAN | button

X-FAN function: In COOL or DRY mode, the icon is displayed and the indoor fan willcontinue operation for 2 minutes in order to dry the indoor unit even though you haveturned off the unit. After energization, X-FAN OFF is defaulted. X-FAN is not available in AUTO, FAN or HEAT mode.

function: turn on the display's light and press this button again to turn off the display's light. If the light is turned on, is displayed. If the light is turned off, disappears.

14. WiFi button

Press " WiFi " button to turn on or turn off WiFi function. When WiFi function is turned on, the " WiFi " icon will be displayed on remote controller; Under status of unit off, press "MODE" and " WiFi " buttons simultaneously for 1s, WiFi module will restore to factory default setting.

‘ This function is only available for some models.

15. / button

Press this button to achieve the on and off of healthy and scavenging functions inoperation status. Press this button for the first time to start scavenging function; LCD displays " ". Press the button for the second time to start healthy and scavengingfunctions simultaneously; LCD displays " " and " ". Press this button for the third time to quit healthy and scavenging functions simultaneously. Press the button for the fourth time to start healthy function; LCD display " ". Press this button again to repeat the operation above. (This function is applicable to partial of models)

Function introduction for combination buttons

Combination of "▲" and "▼" buttons: About lock

Press "▲" and "▼" buttons simultaneously to lock or unlock the keypad. If the remote controller is locked, is displayed. In this case, pressing any button, blinks three times.

Combination of "MODE" and "▼" buttons:
About switch between Fahrenheit and centigrade

At unit OFF, press "MODE" and "▼" buttons simultaneously to switch between ℃ and ℉ .

Combination of "TEMP" and "CLOCK" buttons:
About Energy-saving Function

Press "TEMP" and "CLOCK" simultaneously in COOL mode to start energy-saving function.Nixie tube on the remote controller displays "SE". Repeat the operation to quit the function.

Combination of "TEMP" and "CLOCK" buttons:
About 8℃ Heating Function

Press "TEMP" and "CLOCK" simultaneously in HEAT mode to start 8℃ Heating Function Nixie tube on the remote controller displays " " and a selected temperature of "8℃ ".(46 ℉ if Fahrenheit is adopted). Repeat the operation to quit the function.

I FEEL Function

Press „ and "MODE" buttons simultaneously to start I FEEL function and " " will be displayed on the remote controller. After this function is set, the remote controller will send the detected ambient temperature to the controller and the unit will automatically adjust the indoor temperature according to the detected temperature.

Press this two buttons simultaneously again to close I FEEL function and " " will disappear.

‘ Please put the remote controller near user when this function is set. Do not put the remote controller near the object of hig h temperature or low temperature in order to avoid detecting inaccurate ambient temperature. When I FEEL function is turned on, the remote controller should be put within the area where indoor unit can receive the signal sent by the remote controller.

"If “H1” is displayed on the remote controller while it’s not operated by the professional person/after-sales person, it belongs to the misoperation.

Please operate it as below to cancel it.Under the OFF status of remote controller, hold the “MODE” button and “X-FAN” buttons simultaneously for 5s to cancel “H1” display.

Note:


‘ If remote controller displays “H1”, it belongs to the normal function reminder . If the unit is defrosting under heating mode, it operates according to H1 defrosting mode. “H1” won’t be displayed on the panel of indoor unit;

‘ Once you set H1 mode, if you turn of f unit by remote controller, H1 will display 3 times on the remote controller and then disappear;

‘ Also, when you set H1 mode, when you change to heating mode, H1 will display 3 times on the remote controller and then disappear."

Replacement of batteries in remote controller

1. Press the back side of remote controller marked with" ", as show in the fig, and then push out the cover of battery box along the arrow direction.
2. Replace two 7# (AAA 1.5V) dry batteries, and make sure the position of "▲" polar and "▼" polar are correct.
3. Reinstall the cover of battery box.



Note:

● During operation, point the remote control signal sender at the receiving window on indoor unit.

● The distance between signal sender and receiving window should be no more than 8m, and there should be no obstacles between them.

● Signal may be interfered easily in the room where there is fluorescent lamp or wireless telephone; remote controller should be close to indoor unit during operation.


● Replace new batteries of the same model when replacement is required.

● When you don't use remote controller for a long time, please take out the batteries.

● If the display on remote controller is fuzzy or there's no display, please replace batteries.

6.3 GREE+ App Operation Manual

Control Flow Chart

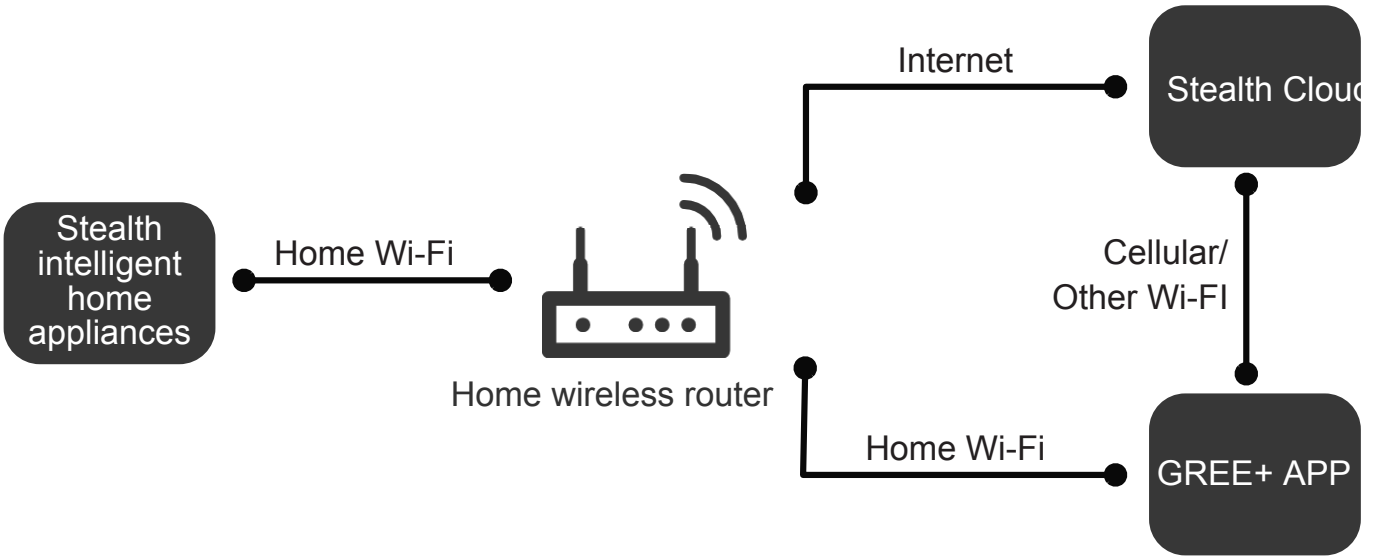

Operating Systems

Requirement for User's smart phone:

iOS system
Support iOS7.0 and above version

Android system
Support Android 4.4 and above version


Download and installation

GREE+ App Download Linkage

Scan the QR code or search "GREE+" in the application market to download and install it. When "GREE+" App is installed, register the account and add the device to achieve long-distance control and LAN control of Stealth smart home appliances.
For more information, please refer to "Help" in App.

6.4 Ewpe Smart App Operation Manual

Control Flow Chart

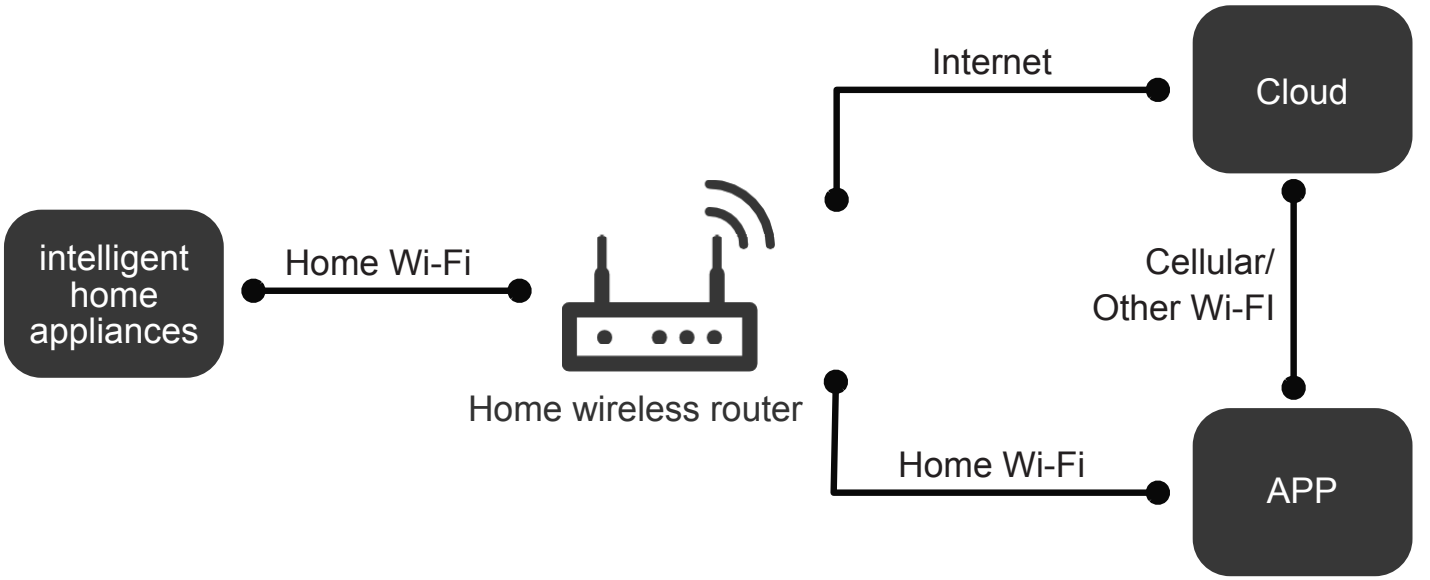

Operating Systems

Requirement for User's smart phone:

iOS system
Support iOS7.0 and above version

Android system
Support Android 4.4 and above version

Download and installation

App Download Linkage

Scan the QR code or search "Ewpe Smart" in the application market to download and install it. When "Ewpe Smart" App is installed, register the account and add the device to achieve long-distance control and LAN control of smart home appliances.
For more information, please refer to "Help" in App.

6.5 Brief Description of Modes and Functions

1. Temperature Parameters

Indoor preset temperature(Tpreset)

Indoor ambient temperature (Tamb.)

2. Basic Functions

Once energized, in no case should the compressor be restarted within less than 3 minutes. In the situation that memory functionis available, for the first energization, if the compressor is at stop before de-energization, the compressor will be started withouta 3-minute lag; if the compressor is in operation before de-energization, the compressor will be started with a 3-minute lag; andonce started, the compressor will not be stopped within 6 minutes regardless of changes in room temperature;

(1) Cooling Mode


① Working conditions and process of cooling

When Tamb. ≥ Tpreset, the unit will enter cooling operation, in which case the indoor fan, the outdoor fan and the compressor willwork and the indoor fan will run at preset speed.

When Tamb.≤Tpreset+28.4°F, the compressor will stop, the outdoor fan will stop with a time lag of 60s, and the indoor fan will run atpreset speed.

When Tpreset+28.4°F < Tamb.< Tpreset, the unit will remain at its previous state.

Under this mode, the four-way valve will be de-energized and temperature can be set within a range from 61°F~86°F. If the compressor is shut down for some reason, the indoor fan and the swing device will operate at original state.

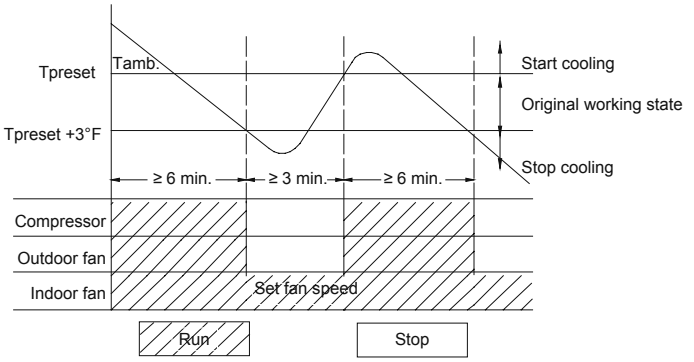

② Protection

Antifreeze protection

Under cooling and dehumidifying mode, 6 minutes after the compressor is started:

If Tevap ≤ 35.6°F, the compressor will operate at reduced frequency.

If Tevap ≤ 30.2°F is detected for durative 3 minutes, the compressor will stop, and after 60 seconds, the outdoor fan will stop;and under cooling mode, the indoor fan and the swing motor will remain at the original state.

If Tevap. ≥ 42.8°F and the compressor has remained at OFF for at least 3 minutes, the compressor will resume its original operation state.

Total current up and frequency down protection

If I_{total} ≤ 16A, frequency rise will be allowed; if I_{total} ≥ 17A, frequency rise will not be allowed; if I_{total} ≥ 18A, the compressor will run at reduced frequency; and if I_{total} ≥ 20A, the compressor will stop and the outdoor fan will stop with a time lag of 60s.

(2) Dehumidifying Mode

① Working conditions and process of dehumidifying

If Tamb. > Tpreset, the unit will enter cooling and dehumidifying mode, in which case the compressor and the outdoor fan will operate and the indoor fan will run at low speed.

If Tpreset+28.4°F ≤ Tamb. ≤ Tpreset the compressor remains at its original operation state.

If Tamb.< Tpreset , the compressor will stop, the outdoor fan will stop with a time lag of 60s, and the indoor fan will operate at low speed.

② Protection

Protection is the same as that under the cooling mode.

(3) Heating Mode

① Working conditions and process of heating

If Tamb. ≤ Tpreset+35.6°F($T_{indoor\ ambient}$≤ $T_{setting}$ + 2 ℃ , start with heating mode), the unit enters heating mode, in which case the four-way valve, the compressor and the outdoor fan will operate simultaneously, and the indoor fan will run at preset speed in the condition of preset cold air prevention.

If Tamb. ≥ Tpreset+37.4°F($T_{indoor\ ambient}$ ≥$T_{setting}$+3℃ , it stops when reaches temperature point), the compressor will stop, the outdoor fan will stop with a time lag of 60s, and the indoor fan will stop after 60-second blow at low speed.

If Tpreset < Tamb.<Tpreset+37.4°F($T_{setting}$ ＜ $T_{indoor\ ambient}$ ＜ $T_{setting}$+3℃ , maintain heating mode), the unit will maintain its original operating status.

Under this mode, the four-way valve is energized and temperature can be set within a range of 61°F~86°F. The operatingsymbol, the heating symbol and preset temperature are revealed on the display.

② Condition and process of defrost

When duration of successive heating operation is more than 45 minutes, or accumulated heating time more than 90 minutes, andone of the following conditions is reached, the unit will enter the defrost mode after 3 minutes.

a. Toutdoor amb. ≥ 41°F, Toutdoor pipe ≤ 28.4°F;

b. 28.4°F ≤ Toutdoor amb. ≤ 41°F,Toutdoor pipe - Tcompensation≤ 23°F

c. 23°F < Toutdoor amb. ≤ 28.4°F, Toutdoor pipe - Tcompensation≤ 17.6°F;

d. 14°F < Toutdoor amb. < 23°F, Toutdoor pipe- Tcompensation ≤ Toutdoor amb.+26.6°F;

e. Toutdoor amb. < 14°F, Toutdoor pipe- Tcompensation ≤ Toutdoor amb.+26.6°F;

After energization, when defrosting for the first time Tcompensation=0°F. If it is not the firstly time for defrosting, the Tcompensation is determined by the Toutdoor pipe of last time quitting defrosting.

a.Toutdoor pipe > 35.6°F, Tcompensation=32°F; b. Toutdoor pipe ≤ 35.6°F, Tcompensation=33.8°F.

At that time, the indoor fan stops and the compressor stops, and after 60 seconds the outer fan will stop, and then after 30seconds, the four-way valve will stop. After 30 seconds, the compressor is initiated for raising the frequency to defrost frequency.

When the compressor has operated under defrost mode for 10 minutes, or Touter tube ≥ 50°F, the compressor will be converted to 46Hz operation.After 30 seconds, the compressor will stop. And after another 30 seconds, the four-way valve will be opened, and after60 seconds, the compressor and the outer fan will be started, the indoor fan will run under preset cold air prevention conditions,and H1 will be displayed at temperature display area on the display panel. Defrost frequency is 70 Hz.

3.Protection

Cold air prevention

The unit is started under heating mode (the compressor is ON):

① In the case of Tindoor amb. < 75°F: if T tube ≤ 104°F and the indoor fan is at stop state, the indoor fan will begin to run at low speed witha time lag of 2 minutes. Within 2 minutes, if T tube > 104°F, the indoor fan also will run at low speed; and after 1 minute operation atlow speed, the indoor fan will be converted to operation at preset speed. Within 1 minute low speed operation or 2 minute non-operation, if T tube > 108°F, the fan will run at present speed.

② In the case of Tindoor amb. < 75°F: if Ttube ≤ 108°F, the indoor fan will run at low speed, and after one minute, the indoor fan will beconverted to preset speed. Within 1 minute low speed operation, if Ttube > 104°F, the indoor fan will be converted to preset speed.Note: Tindoor amb. indicated in ① and ② refers to, under initially heating mode, the indoor ambient temperature before the command to start the compressor is performed according to the program, or after the unit is withdrawn from defrost, the indoor ambient temperature before the defrost symbol is cleared.

Total current up and frequency down protection

If the total current I_{total} ≤ 16A, frequency rise will be allowed; if I_{total} ≥ 17A,frequency rise will not be allowed; if Itotal18A,the compressorwill run at reduced frequency; and if Itotal20A, the compressor will stop and the outdoor fan will stop with a time lag of 60s.

(4) Fan Mode

Under the mode, the indoor fan will run at preset speed and the compressor, the outdoor fan, the four-way valve and the electricheater will stop.

Under the mode, temperature can be set within a range of 61°F~86°F.

(5) AUTO Mode

① Working conditions and process of AUTO mode

Under AUTO mode, standard cooling temperature Tpreset is 77°F and standard heating temperature Tpreset is 68°F.

a. Once energized, if Tamb. ≤ 71.6°F, the unit will be started under heating mode; if 71.6°F < Tamb.< 78.8°F, the unit will run under fanmode and the run indicator will be bright; and if Tamb. ≥ 78.8°F, the unit will be started under cooling mode.

b.Under AUTO mode,if Tamb. ≥ Tpreset +1.8ºF is detected,the unit will select to run under cooling mode,in which case implicit presettemperature is 77°F; if Tamb. ≤ Tpreset-1.8°F, the compressor will stop, the outdoor fan will stop with a time lag of 1 minute, andtheindoor fan will run at preset speed; and if Tpreset-1.8°F < Tamb. < Tpreset+1.8ºF, the unit will remain at its original state.

c.Under AUTO mode, if Tamb. ≤ Tpreset+3.6°F is detected, the unit will select to run under heating mode, in which case implicit preset temperature is 64°F; if Tamb. ≥ Tpreset+9°F, the compressor will stop, the outdoor fan will stop with a time lag of 1 minute,and the indoor fan will run under the mode of residue heat blowing; and if Tpreset+3.6°F < Tamb.< Tpreset+41°F, the unit will remainatits original state. The cooling-only unit will run under fan mode.

d.Under AUTO mode, if 71.6°F < Tamb.< 78.8°F, the unit will remain at its original state.

② Protection

a. In cooling operation, protection is the same as that under the cooling mode;

b. In heating operation, protection is the same as that under the heating mode;

c. When ambient temperature changes, operation mode will be converted preferentially. Once started, the compressor willremain unchanged for at least 6 minutes.

(6) Common Protection Functions and Fault Display under COOL, HEAT, DRY and AUTO Modes

① Overload protection

Ttube:measured temperature of outdoor heat exchanger under cooling mode; and measured temperature of indoor heat ex-changer under heating mode.

1) Cooling overloada.

a. If Ttube ≤ 126°F, the unit will return to its original operation state.

b. If Ttube ≥ 131°F, frequency rise is not allowed.

c. If Ttube ≥ 136°F, the compressor will run at reduced frequency.

d. If Ttube ≥ 144°F, the compressor will stop and the indoor fan will run at preset speed.

2) Heating overload

a. If Ttube ≤ 126°F, the unit will return to its original operation state.

b. If Ttube ≥ 131°F, frequency rise is not allowed.

c. If Ttube ≥ 136°F, the compressor will run at reduced frequency.

d. If Ttube ≥ 144°F,the compressor will stop and the indoor fan will blow residue heat and then stop.

② Exhaust temperature protection of compressor

If exhaust temperature ≥ 208°F, frequency is not allowed to rise.

If exhaust temperature ≥ 217°F, the compressor will run at reduced frequency.

If exhaust temperature ≥ 230°F, the compressor will stop.

If exhaust temperature ≤ 194°F, the compressor has stayed at stop for at least 3 minutes, the compressor will resume itsoperation.

③ Communication fault

If the unit fails to receive correct signals for durative 3 minutes, communication fault can be justified and the whole system will stop

④ Module protection

Under module protection mode, the compressor will stop. When the compressor remains at stop for at least 3 minutes, thecompressor will resume its operation. If module protection occurs six times in succession, the compressor will not be startedagain.

⑤ Overload protection

If temperature sensed by the overload sensor is over 239°F, the compressor will stop and the outdoor fan will stop with atime lag of 30 seconds. If temperature is below 203°F, the overload protection will be relieved.

If voltage on the DC bus is below 150V or over 420V, the compressor will stop and the outdoor fan will stop with a timelag of 30 seconds. When voltage on the DC bus returns to its normal value and the compressor has stayed at stop for at least3 minutes, the compressor will resume its operation.

⑥ Faults of temperature sensors

Designation of sensors	Faults
Indoor ambient temperature	The sensor is detected to be open-circuited or short-circuited for successive 5 seconds
Indoor tube temperature	The sensor is detected to be open-circuited or short-circuited for successive 5 seconds
Outdoor ambient temperature	The sensor is detected to be open-circuited or short-circuited for successive 30 seconds
Outdoor tube temperature	The sensor is detected to be open-circuited or short-circuited forsuccessive 30 seconds, and no detection is performed within 10 minutesafter defrost begins.
Exhaust	After the compressor has operated for 3 minutes, the sensor is detectedto be open-circuited or short-circuited for successive 30 seconds.
Overload	After the compressor has operated for 3 minutes, the sensor is detectedto be open-circuited or short-circuited for successive 30 seconds.

Part Ⅱ : Installation and Maintenance

7. Notes for Installation and Maintenance

Safety Precautions: Important!

Please read the safety precautions carefully before installation and maintenance.
The following contents are very important for installation and maintenance.

Please follow the instructions below.

●The installation or maintenance must accord with the instructions.
●Comply with all national electrical codes and local electrical codes.
●Pay attention to the warnings and cautions in this manual.
●All installation and maintenance shall be performed by distributor or qualified person
●All electric work must be performed by a licensed technician according to local regulations and the instructions given in this manual.
●Be caution during installation and maintenance. Prohibit incorrect operation to prevent electric shock, casualty and other accidents.

Warnings

Electrical Safety Precautions:

1. Cut off the power supply of air conditioner before checking and maintenance.
2. The air condition must apply specialized circuit and prohibit share the same circuit with other appliances.
3. The air conditioner should be installed in suitable location and ensure the power plug is touchable.
4. Make sure each wiring terminal is connected firml during installation and maintenance.
5. Have the unit adequately grounded. The grounding wire cant be used for other purposes.
6. Must apply protective accessories such as protective boards, cable-cross loop and wire clip.
7. The live wire, neutral wire and grounding wire of power supply must be corresponding to the live wire, neutral wire and grounding wire of the air conditioner.
8. The power cord and power connection wires cant be pressed by hard objects.
9. If power cord or connection wire is broken, it must be replaced by a qualified person
10. If the power cord or connection wire is not long enough, please get the specialized power cord or connection wire from the manufacture or distributor. Prohibit prolong the wire by yourself.
11. For the air conditioner without plug, an air switch must be installed in the circuit. The air switch should be all-pole parting and the contact parting distance should be more than 1/8 inch.
12. Make sure all wires and pipes are connected properly and the valves are opened before energizing.
13. Check if there is electric leakage on the unit body. If yes, please eliminate the electric leakage.
14. Replace the fuse with a new one of the same specificatio if it is burnt down; dont replace it with a cooper wire or conducting wire.
15. If the unit is to be installed in a humid place, the circuit breaker must be installed.

Installation Safety Precautions:

1. Select the installation location according to the require-ment of this manual.(See the requirements in installation part)
2. Handle unit transportation with care; the unit should not be carried by only one person if it is more than 44.09lb.
3. When installing the indoor unit and outdoor unit, a suffi-cient fixing bolt must be installed; make sure the installatio support is firm
4. Ware safety belt if the height of working is above 78 3/4 inch.
5. Use equipped components or appointed components dur-ing installation.
6. Make sure no foreign objects are left in the unit after fi -ishing installation.

Refrigerant Safety Precautions:

When refrigerant leaks or requires discharge during installation, maintenance, or disassembly, it should be handled by certified professionals or otherwise in compliance with local laws and regulations.

1. Avoid contact between refrigerant and fire as it generate poisonous gas; Prohibit prolong the connection pipe by welding.
2. Apply specified refrigerant onl . Never have it mixed with any other refrigerant. Never have air remain in the refrigerant line as it may lead to rupture or other hazards.
3. Make sure no refrigerant gas is leaking out when installation is completed.
4. If there is refrigerant leakage, please take sufficient measur to minimize the density of refrigerant.
5. Never touch the refrigerant piping or compressor without wearing glove to avoid scald or frostbite.

Improper installation may lead to fire hazard, explosion electric shock or injury.

Safety Precautions for Installing and Relocating the Unit

To ensure safety, please be mindful of the following precautions.

Warnings

1. When installing or relocating the unit, be sure to keep the refrigerant circuit free from air or substances other than the specified refrigerant

Any presence of air or other foreign substance in the refrigerant circuit will cause system pressure rise or compressor rupture, resulting in injury.

2.When installing or moving this unit, do not charge the refrigerant which is not comply with that on the nameplate or unqualified refrigerant

Otherwise, it may cause abnormal operation, wrong action, mechanical malfunction or even series safety accident.

3.When refrigerant needs to be recovered during relocating or repairing the unit, be sure that the unit is running in cooling mode.Then, fully close the valve at high pressure side (liquid valve).About 30-40 seconds later, fully close the valve at low pressure side (gas valve), immediately stop the unit and disconnect power. Please note that the time for refrigerant recovery should not exceed 1 minute.

If refrigerant recovery takes too much time, air may be sucked in and cause pressure rise or compressor rupture, resulting in injury.

4.During refrigerant recovery, make sure that liquid valve and gas valve are fully closed and power is disconnected before detaching the connection pipe.

If compressor starts running when stop valve is open and connection pipe is not yet connected, air will be sucked in and cause pressure rise or compressor rupture, resulting in injury.

5.When installing the unit, make sure that connection pipe is securely connected before the compressor starts running.

If compressor starts running when stop valve is open and connection pipe is not yet connected, air will be sucked in and cause pressure rise or compressor rupture, resulting in injury.

6.Prohibit installing the unit at the place where there may be leaked corrosive gas or flammable gas

If there leaked gas around the unit, it may cause explosion and other accidents.

7.Do not use extension cords for electrical connections. If the electric wire is not long enough, please contact a local service center authorized and ask for a proper electric wire.

Poor connections may lead to electric shock or fire

8.Use the specified types of wires for electrical connections between the indoor and outdoor units. Firmly clamp the wires so that their terminals receive no external stresses.


Electric wires with insufficient capacit , wrong wire connections and insecure wire terminals may cause electric shock or fire

Main Tools for Installation and Maintenance


1. Level meter, measuring tape 	**2. Screw driver** 	**3. Impact drill, drill head, electric drill** 
4. Electroprobe 	**5. Universal meter** 	**6. Torque wrench, open-end wrench, inner hexagon spanner** 
7. Electronic leakage detector 	**8. Vacuum pump** 	**9. Pressure meter** 
10. Pipe pliers, pipe cutter   	**11. Pipe expander, pipe bender**  	**12. Soldering appliance, refrigerant container electronic scale**  

8. Installation

8.1 Installation Dimension Diagram

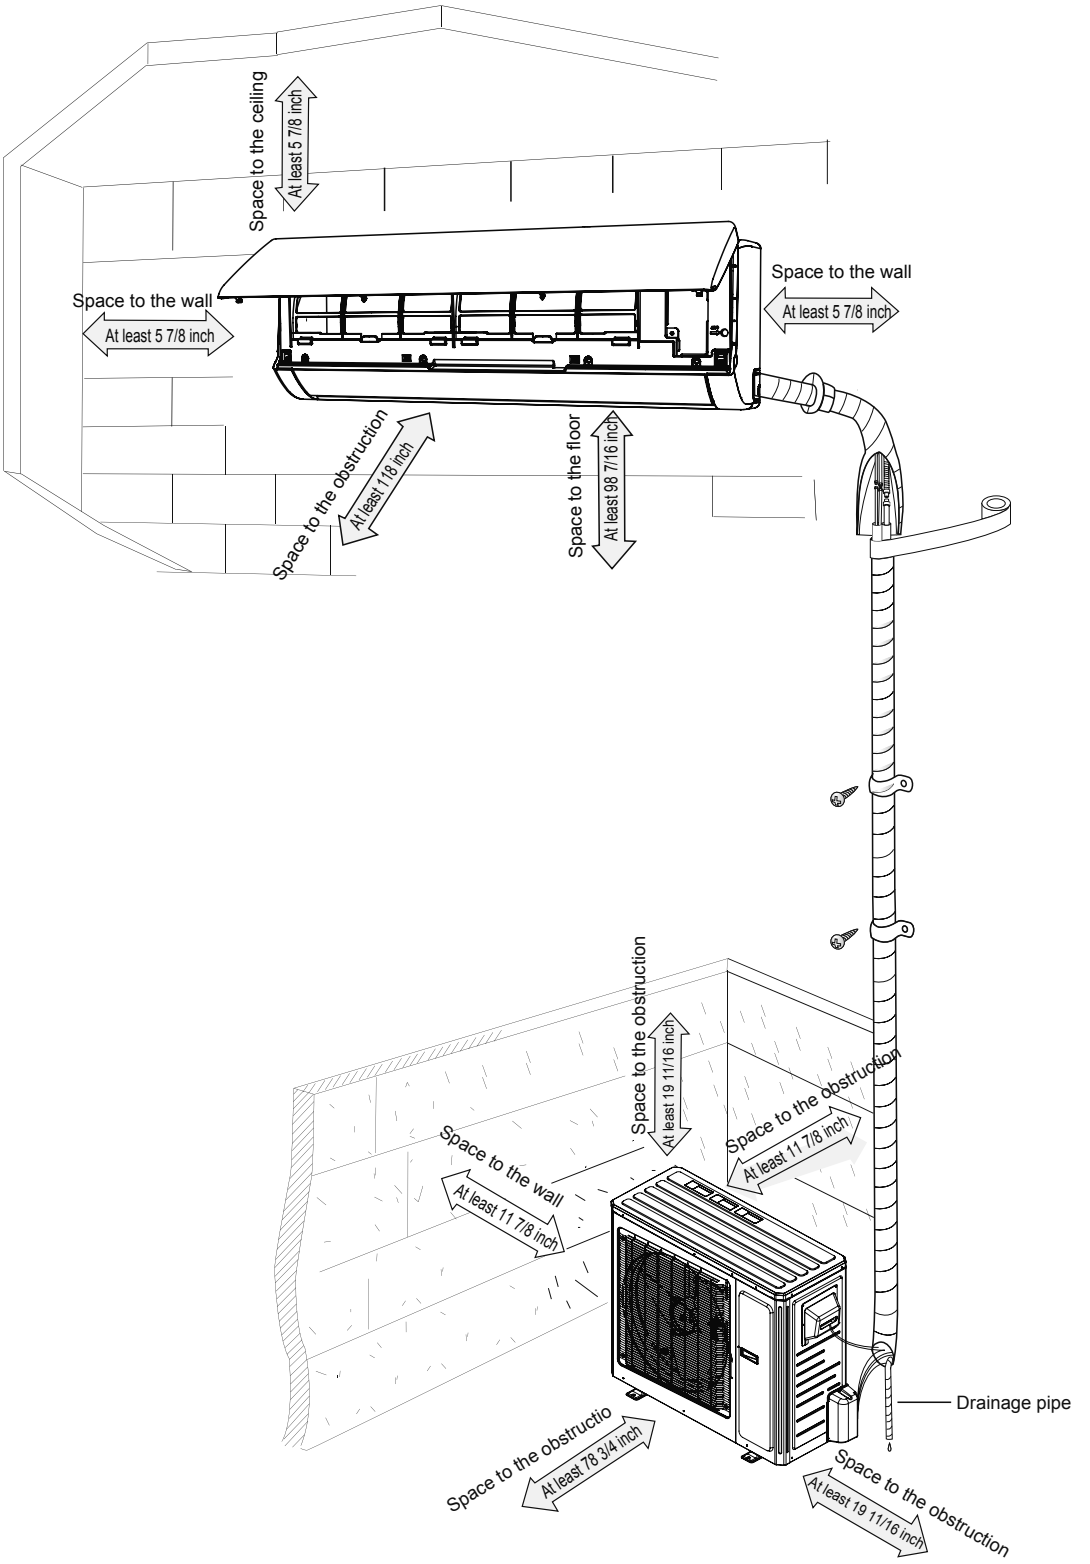

Installation procedures

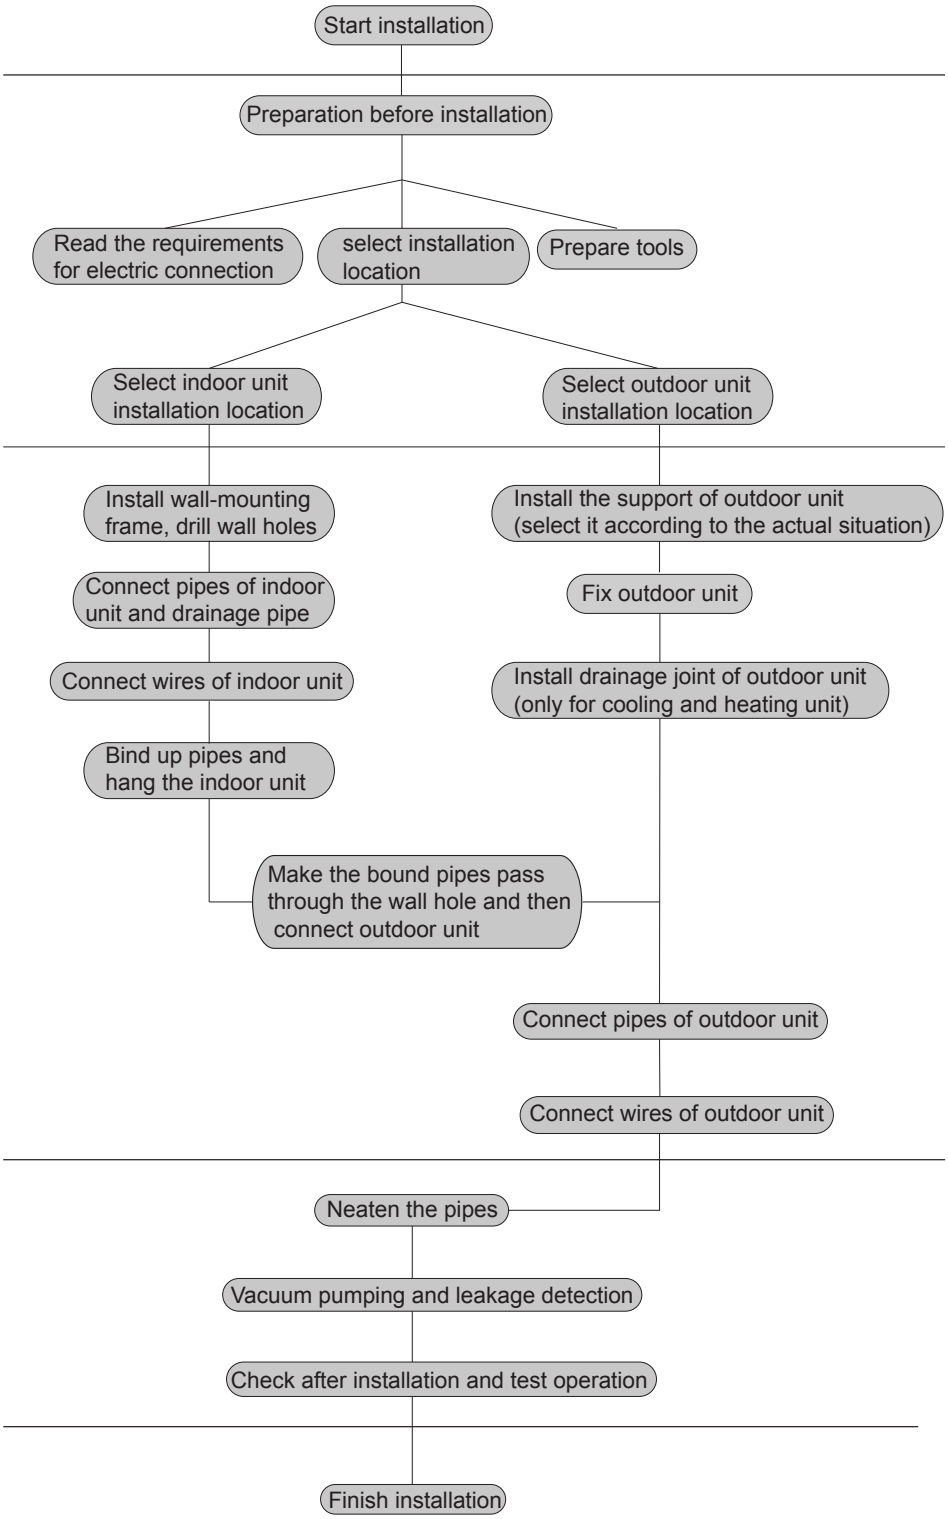

Note: this flow is only for reference; please find the more detailed installation steps in this section.

8.2 Installation Parts-checking

No.	Name	No.	Name
1	Indoor unit	8	Sealing gum
2	Outdoor unit	9	Wrapping tape
3	Connection pipe	10	Support of outdoor unit
4	Drainage pipe	11	Fixing screw
5	Wall-mounting frame	12	Drainage plug(cooling and heating unit)
6	Connecting cable(power cord)	13	Owners manual, remote controller
7	Wall pipe		

⚠ **Note:**
1.Please contact the local agent for installation.
2.Dont use unqualified power cord

8.3 Selection of Installation Location

1. Basic Requirement:
Installing the unit in the following places may cause malfunction. If it is unavoidable, please consult the local dealer:
(1) The place with strong heat sources, vapors, flammable or explosive gas, or volatile objects spread in the air.
(2) The place with high-frequency devices (such as welding machine, medical equipment).
(3) The place near coast area.
(4) The place with oil or fumes in the air.
(5) The place with sulfureted gas.
(6) Other places with special circumstances.
(7) Do not use the unit in the immediate surroundings of a laundry a bath a shower or a swimming pool.

2. Indoor Unit:
(1) There should be no obstruction near air inlet and air outlet.
(2) Select a location where the condensation water can be dispersed easily and wont affect other people.
(3) Select a location which is convenient to connect the outdoor unit and near the power socket.
(4) Select a location which is out of reach for children.
(5) The location should be able to withstand the weight of indoor unit and wont increase noise and vibration.
(6) The appliance must be installed 98 7/16 inch above floo .
(7) Dont install the indoor unit right above the electric appliance.
(8) The appliance shall not be installed in the laundry.

3. Outdoor Unit:
(1) Select a location where the noise and outflow air emitted by the outdoor unit will not affect neighborhood.
(2) The location should be well ventilated and dry, in which the outdoor unit wont be exposed directly to sunlight or strong wind.
(3) The location should be able to withstand the weight of outdoor unit.
(4) Make sure that the installation follows the requirement of installation dimension diagram.
(5)Select a location which is out of reach for children and far away from animals or plants.If it is unavoidable, please add fence for safety purpose.

8.4 Requirements for electric connection

1. Safety Precaution
(1) Must follow the electric safety regulations when installing the unit.
(2) According to the local safety regulations, use qualified power supply circuit and air switch.
(3) Make sure the power supply matches with the requirement of air conditioner. Unstable power supply or incorrect wiring may result in electric shock,fire hazard or malfunction. Please install proper power supply cables before using the air conditioner.

Air-conditioner	Air switch capacity
30K except VIRU30HP230V1A	30A
VIRU30HP230V1A	50A
36K except VIRU36HP230V1A	40A
VIRU36HP230V1A	50A

(4) Properly connect the live wire, neutral wire and grounding wire of power socket.
(5) Be sure to cut off the power supply before proceeding any work related to electricity and safety.
(6) Do not put through the power before finishing installation
(7) If the supply cord is damaged,it must be replaced by the manufacturer,its service agent or similarly qualified persons in order to avoid a hazard.
(8) The temperature of refrigerant circuit will be high, please keep the interconnection cable away from the copper tube.
(9) The appliance shall be installed in accordance with national wiring regulations.
(10)Installation must be performed in accordance with the requirement of NEC and CEC by authorized personnel only.

2. Grounding Requirement:
(1) The air conditioner is fir t class electric appliance. It must be properly grounding with specialized grounding device by a professional. Please make sure it is always grounded effectively, otherwise it may cause electric shock.
(2) The yellow-green wire in air conditioner is grounding wire, which cant be used for other purposes.
(3) The grounding resistance should comply with national electric safety regulations.
(4) The appliance must be positioned so that the plug is accessible.
(5) An all-pole disconnection switch having a contact separation of at least 1/8 inch in all poles should be connected in fixed wiring.
(6) Including an air switch with suitable capacity, please note the following table. Air switch should be included magnet buckle and heating buckle function, it can protect the circuit-short and overload. (Caution: please do not use the fuse only for protect the circuit)

8.5 Installation of Indoor Unit

1. Choosing Installation location
Recommend the installation location to the client and then confirm it with the client

2. Install Wall-mounting Frame
(1) Hang the wall-mounting frame on the wall; adjust it in horizontal position with the level meter and then point out the screw fixing holes on the wall
(2) Drill the screw fixing holes on the wall with impact drill (the specification of drill head should be the same as the plastic expansion particle) and then fill the plastic expansion particle

in the holes.
(3) Fix the wall-mounting frame on the wall with tapping screws and then check if the frame is firmly installed by pulling the frame. If the plastic expansion particle is loose, please drill another fixing hole nearb .

3. Install Wall-mounting Frame

(1) Choose the position of piping hole according to the direction of outlet pipe. The position of piping hole should be a little lower than the wall-mounted frame.(As show in Fig.1)

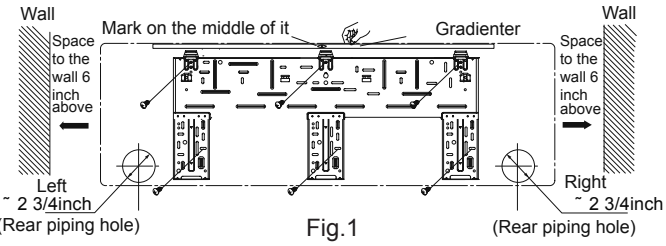


Fig.1

(2) Open a piping hole with the diameter of Φ2 3/4inch on the selected outlet pipe position.In order to drain smoothly, slant the piping hole on the wall slightly downward to the outdoor side with the gradient of 5-10°.(As show in Fig.2)

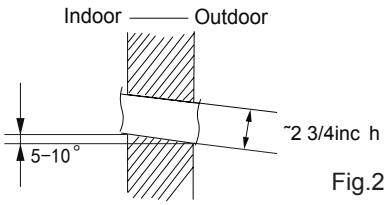


Fig.2

⚠ **Note:**

(1) Pay attention to dust prevention and take relevant safety measures when opening the hole.

4. Outlet Pipe

(1) The pipe can be led out in the direction of right, rear right, left or rear left.(As show in Fig.3)
(2) When selecting leading out the pipe from left or right, please cut off the corresponding hole on the bottom case.(As show in Fig.4)

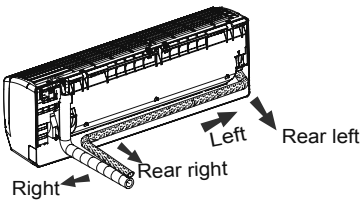


Fig.3

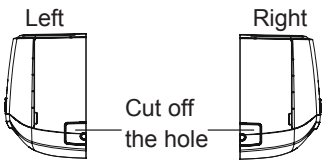


Fig.4

5. Connect the Pipe of Indoor Unit

(1) Aim the pipe joint at the corresponding bellmouth.(As show in Fig.5)
(2) Pretightening the union nut with hand.
(3) Adjust the torque force by referring to the following sheet. Place the open-end wrench on the pipe joint and place the torque wrench on the union nut. Tighten the union nut with torque wrench.(As show in Fig.6)
(4) Wrap the indoor pipe and joint of connection pipe with insulating pipe, and then wrap it with tape.(As show in Fig.7)

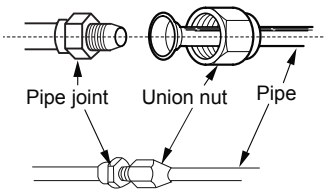


Fig.5

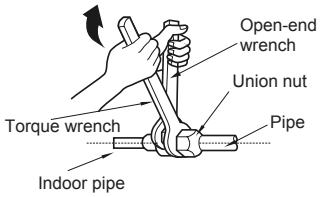


Fig.6




Fig.7

Refer to the following table for wrench moment of force:

Hex nut diameter(inch)	Tightening torque(ft·lbf)
Φ1/4	11.10~14.75
Φ3/8	20.12~29.50
Φ1/2	33.19~40.56
Φ5/8	44.24~47.94
Φ3/4	51.32~55.31

6. Install Drain Hose

(1) Connect the drain hose to the outlet pipe of indoor unit.(As show in Fig.8)
(2) Bind the joint with tape.(As show in Fig.9)

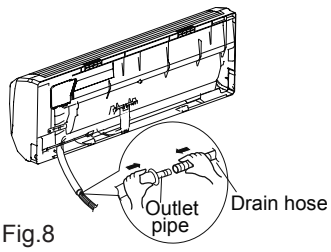


Fig.8




Fig.9

⚠ **Note:**

(1) Add insulating pipe in the indoor drain hose in order to prevent condensation.
(2) The plastic expansion particles are not provided.
(As show in Fig.10)

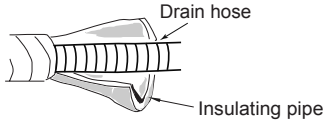


Fig.10

7. Connect Wire of Indoor Unit

(1) Open the panel, remove the screw on the wiring cover and then take down the cover.(As show in Fig.11)

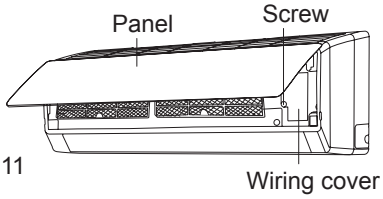


Fig.11

(2) Fix the wire crossing board on connection wire sleeve at the bottom case; let the connection wire sleeve go through the wire crossing hole at the back of indoor unit, and then pull it out from the front.(As show in Fig.12)

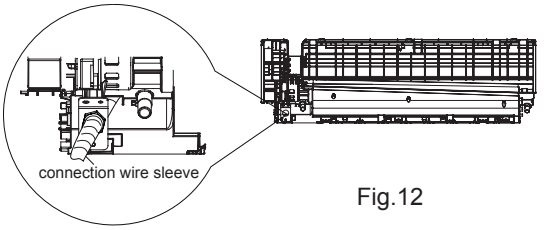


Fig.12

(3) Remove the wire clip; connect the power connection wire to the wiring terminal according to the color; tighten the screw and then fix the power connection wire with wire clip.(As show in Fig.13)


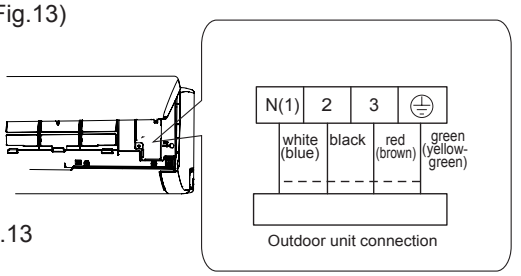


Fig.13

Note: the wiring board is for reference only,please refer to the actual one.

(4) Put wiring cover back and then tighten the screw.
(5) Close the panel.
(6) Install the Conduit assy.
a. Fix the conduit assy on the conduit board and then let the connection wire between indoor unit and outdoor unit go through the conduit.
b. Fix the conduit assy on the chassis with 3 screws.
● Conduit assy consists of conduit, conduit connector and lock nut.(Not the standard part, which should be purchased by customer.)
● The length of conduit can be calculated according to the length of connection wire.

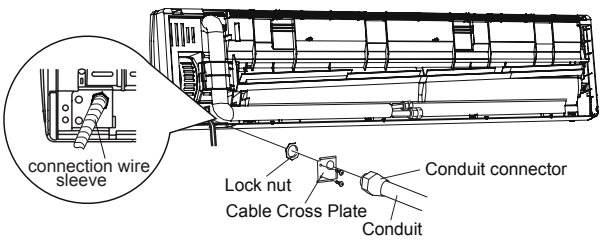

⚠ **Note:**
(1) All wires of indoor unit and outdoor unit should be connected by a professional.
(2) If the length of power connection wire is insufficient, please contact the supplier for a new one. Avoid extending the wire by yourself.
(3) For the air conditioner with plug, the plug should be reachable after finishing installation
(4) For the air conditioner without plug, an air switch must be installed in the line. The air switch should be all-pole parting and the contact parting distance should be more than 1/8inch.

8. Bind up Pipe

(1) Bind up the connection pipe, power cord and drain hose with the band.(As show in Fig.14)
(2) Reserve a certain length of drain hose and power cord for installation when binding them. When binding to a certain degree, separate the indoor power and then separate the drain hose.(As show in Fig.15)
(3) Bind them evenly.
(4) The liquid pipe and gas pipe should be bound separately at the end.

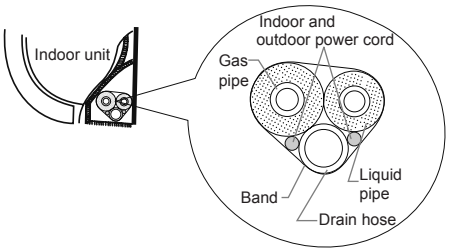


Fig.14

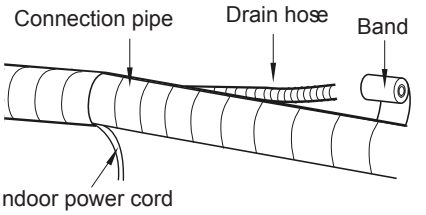


Fig.15

⚠ **Note:**
(1) The power cord and control wire cant be crossed or winding.
(2) The drain hose should be bound at the bottom.

9. Hang the Indoor Unit

(1) Put the bound pipes in the wall pipe and then make them pass through the wall hole.
(2) Hang the indoor unit on the wall-mounting frame.
(3) Stuff the gap between pipes and wall hole with sealing gum.
(4) Fix the wall pipe.(As show in Fig.16)
(5) Check if the indoor unit is installed firmly and closed to the wall.(As show in Fig.17)


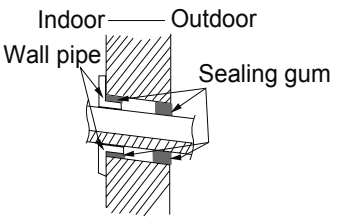


Fig.16

Fig.17



⚠ **Note:**
Do not bend the drain hose too excessively in order to prevent blocking.

8.6 Installation of Outdoor Unit


1. Fix the Support of Outdoor Unit(Select it according to the actual installation situation)

(1) Select installation location according to the house structure.
(2) Fix the support of outdoor unit on the selected location with expansion screws.

⚠ **Note:**

(1) Take sufficient protective measures when installing the outdoor unit.
(2) Make sure the support can withstand at least four times the unit weight.
(3) The outdoor unit should be installed at least 1 11/64 inch above the floor in order to install drain joint.(As show in Fig.18
(4) For the unit with cooling capacity of 2300W~5000W, 6 expansion screws are needed; for the unit with cooling capacity of 6000W~8000W, 8 expansion screws are needed; for the unit with cooling capacity of 10000W~16000W, 10 expansion screws are needed.

Fig.18



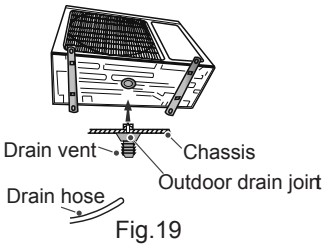


Fig.19

2. Install Drain Joint(Only for cooling and heating unit)

(1) Connect the outdoor drain joint into the hole on the chassis.
(2) Connect the drain hose into the drain vent.
(As show in Fig.19)

3. Fix Outdoor Unit

(1) Place the outdoor unit on the support.
(2) Fix the foot holes of outdoor unit with bolts.
(As show in Fig.20)




Fig.20

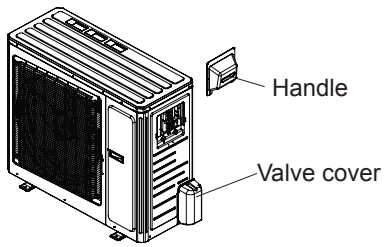



Fig.22

4. Connect Indoor and Outdoor Pipes

(1) Remove the screw cap of valve and aim the pipe joint at the bellmouth of pipe.(As show in Fig.21)
(2) Pretightening the union nut with hand..(As show in Fig.22)






Fig.21


(3) Tighten the union nut with torque wrench by referring to the sheet below.

Hex nut diameter(inch)	Tightening torque(ft·lbf)
Φ1/4	11.10~14.75
Φ3/8	20.12~29.50
Φ1/2	33.19~40.56
Φ5/8	44.24~47.94
Φ3/4	51.32~55.31

5. Connect Outdoor Electric Wire

(1) Remove the handle from the outdoor unit.
(2) Fasten the power supply cord and the connection cord to the retaining plate using the lock nut.(open the knock out holes if necessary)
(3) Connect the power supply cord and the connection cord to terminal.
(4) Fasten the power supply cord and connection cord with cord clamp.
(5) Install the handle.
The screws are packed with the terminal board.
(6) Fix the power connection wire and signal control wire with wire clip (only for cooling and heating unit).

Fig.23

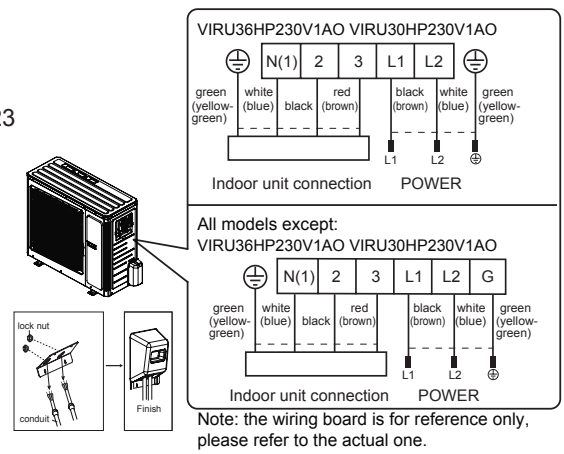

Note: the wiring board is for reference only, please refer to the actual one.

⚠ **Note:**

(1) After tightening the screw, pull the power cord slightly to check if it is firm
(2) Never cut the power connection wire to prolong or shorten the distance.

6. Neaten the Pipes

(1) The pipes should be placed along the wall, bent reasonably and hidden possibly. Min. semidiameter of bending the pipe is 4 inch.
(2) If the outdoor unit is higher than the wall hole, you must set a U-shaped curve in the pipe before pipe goes into the room, in order to prevent rain from getting into the room.(As show in Fig.24)

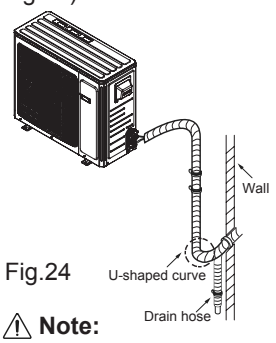


Fig.24

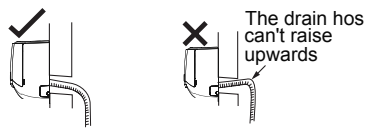


Fig.25

⚠ **Note:**

(1) The through-wall height of drain hose shouldnt be higher than the outlet pipe hole of indoor unit.(As show in Fig.25)
(2) Slant the drain hose slightly downwards. The drain hose cant be curved, raised and fluctuant, etc.(As show in Fig.26

(3) The water outlet cant be placed in water in order to drain smoothly.(As show in Fig.27)

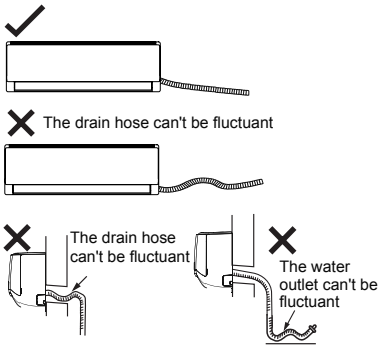


Fig.26




Fig.27

8.7 Vacuum Pumping and Leak Detection

1. Use Vacuum Pump

(1) Remove the valve caps on the liquid valve and gas valve and the nut of refrigerant charging vent.

(2) Connect the charging hose of piezometer to the refrigerant charging vent of gas valve and then connect the other charging hose to the vacuum pump.

(3) Open the piezometer completely and operate for 10-15min to check if the pressure of piezometer remains in -0.1MPa.

(4) Close the vacuum pump and maintain this status for 1-2min to check if the pressure of piezometer remains in -0.1MPa. If the pressure decreases, there may be leakage.

(5) Remove the piezometer, open the valve core of liquid valve and gas valve completely with inner hexagon spanner.

(6) Tighten the screw caps of valves and refrigerant charging vent.(As show in Fig.28)

(7) Reinstall the handle.

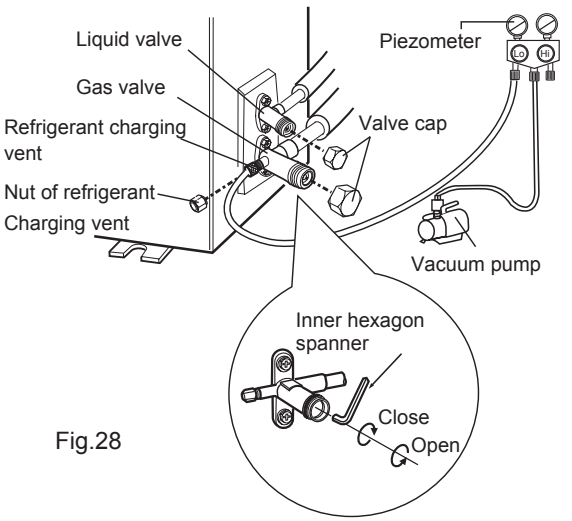


Fig.28

2. Leakage Detection

(1) With leakage detector:

Check if there is leakage with leakage detector.

(2) With soap water:

If leakage detector is not available, please use soap water for leakage detection. Apply soap water at the suspected position and keep the soap water for more than 3min. If there are air bubbles coming out of this position, theres a leakage.

8.8 Check after Installation and Test Operation

1. Check after Installation

Check according to the following requirement after finishing installation.

NO.	Items to be checked	Possible malfunction
1	Has the unit been installed firmly	The unit may drop, shake or emit noise.
2	Have you done the refrigerant leakage test?	It may cause insufficient cooling (heating) capacity.
3	Is heat insulation of pipeline sufficient	It may cause condensation and water dripping.
4	Is water drained well?	It may cause condensation and water dripping.
5	Is the voltage of power supply according to the voltage marked on the nameplate?	It may cause malfunction or damage the parts.
6	Is electric wiring and pipeline installed correctly?	It may cause malfunction or damage the parts.
7	Is the unit grounded securely?	It may cause electric leakage.
8	Does the power cord follow the specification	It may cause malfunction or damage the parts.
9	Is there any obstruction in air inlet and air outlet?	It may cause insufficient cooling (heating)capacity.
10	The dust and sundries caused during installation are removed?	It may cause malfunction or damaging the parts.
11	The gas valve and liquid valve of connection pipe are open completely?	It may cause insufficient cooling (heating) capacity.
12	Is the inlet and outlet of piping hole been covered?	It may cause insufficient cooling(heating) capacity or waster eletricity.

2. Test Operation

(1) Preparation of test operation

- The client approves the air conditioner installation.
- Specify the important notes for air conditioner to the client.

(2) Method of test operation

- Put through the power, press ON/OFF button on the remote controller to start operation.
- Press MODE button to select AUTO, COOL, DRY, FAN and HEAT to check whether the operation is normal or not.
- If the ambient temperature is lower than 16ºC(61ºF), the air conditioner cant start cooling.

9. Troubleshooting

9.1 Flashing LED of Indoor/Outdoor Unit and Primary Judgement

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
1	High pressure protection of system	E1	OFF 3s and blink once			During cooling and drying operation, except indoor fan operates, all loads stop operation. During heating operation, the complete unit stops.	Possible reasons: 1. Refrigerant was superabundant; 2. Poor heat exchange (including filth blockage of heat exchanger and bad radiating environment); Ambient temperature is too high.
2	Antifreezing protection	E2	OFF 3S and blink twice			During cooling and drying operation, compressor and outdoor fan stop while indoor fan operates.	1. Poor air-return in indoor unit; 2. Fan speed is abnormal; 3. Evaporator is dirty.
3	In defect of refrigerant	F0				The Dual-8 Code Display will show F0 and the complete unit stops.	1.In defect of refrigerant; 2.Indoor evaporator temperature sensor works abnormally; 3.The unit has been plugged up somewhere.
4	High discharge temperature protection of compressor	E4	OFF 3S and blink 4 times			During cooling and drying operation, compressor and outdoor fan stop while indoor fan operates. During heating operation, all loads stop.	Please refer to the malfunction analysis (discharge protection, overload).
5	Overcurrent protection	E5	OFF 3S and blink 5 times			During cooling and drying operation, compressor and outdoor fan stop while indoor fan operates. During heating operation, all loads stop.	1. Supply voltage is unstable; 2. Supply voltage is too low and load is too high; 3. Evaporator is dirty.
6	Communi-cation Malfunction	E6	OFF 3S times			During cooling operation, compressor stops while indoor fan motor operates. During heating operation, the complete unit stops.	Refer to the corresponding malfunction analysis.
7	High temperature resistant protection	E8	OFF 3S and blink 8 times			During cooling operation: compressor will stop while indoor fan will operate. During heating operation, the complete unit stops.	Refer to the malfunction analysis (overload, high temperature resistant).
8	EEPROM malfunction	EE			OFF 3S and blink 15 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	Replace outdoor control panel AP1
9	Limit/ decrease frequency due to high temperature of module	EU		OFF 3S and blink 6 times	OFF 3S and blink 6 times	All loads operate normally, while operation frequency for compressor is decreased	Discharging after the complete unit is de-energized for 20mins, check whether the thermal grease on IPM Module of outdoor control panel AP1 is sufficient and whether the radiator is inserted tightly. If its no use, please replace control panel AP1.
10	Malfunction protection of jumper cap	C5	OFF 3S and blink 15 times			Wireless remote receiver and button are effective, but can not dispose the related command	1. No jumper cap insert on mainboard. 2. Incorrect insert of jumper cap. 3. Jumper cap damaged. 4. Abnormal detecting circuit of mainboard.

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
11	Gathering refrigerant	Fo	OFF 3S and blink 1 times			When the outdoor unit receive signal of Gathering refrigerant ,the system will be forced to run under cooling mode for gathering refrigerant	Nominal cooling mode
12	Indoor ambient temperature sensor is open/short circuited	F1		OFF 3S and blink once		During cooling and drying operation, indoor unit operates while other loads will stop; during heating operation, the complete unit will stop operation.	1. Loosening or bad contact of indoor ambient temp. sensor and mainboard terminal. 2. Components in mainboard fell down leads short circuit. 3. Indoor ambient temp. sensor damaged.(check with sensor resistance value chart) 4. Mainboard damaged.
13	Indoor evaporator temperature sensor is open/short circuited	F2		OFF 3S and blink twice		AC stops operation once reaches the setting temperature. Cooling, drying: internal fan motor stops operation while other loads stop operation; heating: AC stop operation	1. Loosening or bad contact of Indoor evaporator temp. sensor and mainboard terminal. 2. Components on the mainboard fall down leads short circuit. 3. Indoor evaporator temp. sensor damaged.(check temp. sensor value chart for testing) 4. Mainboard damaged.
14	Outdoor ambient temperature sensor is open/short circuited	F3		OFF 3S and blink 3 times		During cooling and drying operating, compressor stops while indoor fan operates; During heating operation, the complete unit will stop operation	Outdoor temperature sensor hasnt been connected well or is damaged. Please check it by referring to the resistance table for temperature sensor)
15	Outdoor condenser temperature sensor is open/short circuited	F4		OFF 3S and blink 4 times		During cooling and drying operation, compressor stops while indoor fan will operate; During heating operation, the complete unit will stop operation.	Outdoor temperature sensor hasnt been connected well or is damaged. Please check it by referring to the resistance table for temperature sensor)
16	Outdoor discharge temperature sensor is open/short circuited	F5		OFF 3S and blink 5 times		During cooling and drying operation, compressor will sop after operating for about 3 mins, while indoor fan will operate; During heating operation, the complete unit will stop after operating for about 3 mins.	1.Outdoor temperature sensor hasnt been connected well or is damaged. Please check it by referring to the resistance table for temperature sensor) 2.The head of temperature sensor hasnt been inserted into the copper tube
17	Limit/ decrease frequency due to overload	F6		OFF 3S and blink for 6 times		All loads operate normally, while operation frequency for compressor is decreased	Refer to the malfunction analysis (overload, high temperature resistant)
18	Decrease frequency due to overcurrent	F8		OFF 3S and blink 8 times		All loads operate normally, while operation frequency for compressor is decreased	The input supply voltage is too low; System pressure is too high and overload

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
19	Decrease frequency due to high air discharge	F9		OFF 3S and blink 9 times		All loads operate normally, while operation frequency for compressor is decreased	Overload or temperature is too high; Refrigerant is insufficient; Malfunction of electric expansion valve (EKV)
20	Limit/ decrease frequency due to antifreezing	FH		OFF 3S and blink 2 times	OFF 3S and blink 2 times	All loads operate normally, while operation frequency for compressor is decreased	Poor air-return in indoor unit or fan speed is too low
21	Voltage for DC bus-bar is too high	PH		OFF 3S and blink 11 times		During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	1. Measure the voltage of position L and N on wiring board (XT), if the voltage is higher than 265VAC, turn on the unit after the supply voltage is increased to the normal range. 2.If the AC input is normal, measure the voltage of electrolytic capacitor C on control panel (AP1), if its normal, theres malfunction for the circuit, please replace the control panel (AP1)
22	Voltage of DC bus-bar is too low	PL			OFF 3S and blink 21 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	1. Measure the voltage of position L and N on wiring board (XT), if the voltage is higher than 150VAC, turn on the unit after the supply voltage is increased to the normal range. 2.If the AC input is normal, measure the voltage of electrolytic capacitor C on control panel (AP1), if its normal, theres malfunction for the circuit, please replace the control panel (AP1)
23	Compressor Min frequence in test state	P0		(during blinking, ON 0.25s and OFF 0.25s)	(during blinking, ON 0.25s and OFF 0.25s)		Showing during min. cooling or min. heating test
24	Compressor rated frequence in test state	P1		(during blinking, ON 0.25s and OFF 0.25s)	(during blinking, ON 0.25s and OFF 0.25s)		Showing during nominal cooling or nominal heating test
25	Compressor maximum frequence in test state	P2		(during blinking, ON 0.25s and OFF 0.25s)	(during blinking, ON 0.25s and OFF 0.25s)		Showing during max. cooling or max. heating test

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
26	Compressor intermediate frequence in test state	P3		(during blinking, ON 0.25s and OFF 0.25s)	(during blinking, ON 0.25s and OFF 0.25s)		Showing during middle cooling or middle heating test
27	Overcurrent protection of phase current for compressor	P5		OFF 3S and blink 15 times		During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	Refer to the malfunction analysis (IPM protection, loss of synchronism protection and overcurrent protection of phase current for compressor.
28	Charging malfunction of capacitor	PU			OFF 3S and blink 17 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	Refer to the part three—charging malfunction analysis of capacitor
29	Malfunction of module temperature sensor circuit	P7			OFF 3S and blink 18 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	Replace outdoor control panel AP1
30	Module high temperature protection	P8			OFF 3S and blink 19 times	During cooling operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	After the complete unit is de-energized for 20mins, check whether the thermal grease on IPM Module of outdoor control panel AP1 is sufficient and whether the radiator is inserted tightly. If its no use, please replace control panel AP1.
31	Decrease frequency due to high temperature resistant during heating operation	H0			OFF 3S and blink 10 times	All loads operate normally, while operation frequency for compressor is decreased	Refer to the malfunction analysis (overload, high temperature resistant)
32	Static dedusting protection	H2			OFF 3S and blink twice		
33	Overload protection for compressor	H3			OFF 3S and blink 3 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	1. Wiring terminal OVC-COMP is loosened. In normal state, the resistance for this terminal should be less than 1ohm. 2.Refer to the malfunction analysis (discharge protection, overload)

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
34	System is abnormal	H4			OFF 3S and blink 4 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	Refer to the malfunction analysis (overload, high temperature resistant)
35	IPM protection	H5			OFF 3S and blink 5 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	Refer to the malfunction analysis (IPM protection, loss of synchronism protection and overcurrent protection of phase current for compressor.
36	PFC protection	HC				During cooling and drying operation, compressor will stopwhile indoor fan will operate;During heating operation, the complete unit will stop operation.	Replace outdoor control panel AP1 or Reactor
37	Internal motor (fan motor) do not operate	H6	OFF 3S and blink 11 times			Internal fan motor, external fan motor, compressor and electric heater stop operation,guide louver stops at present location.	1. Bad contact of DC motor feedback terminal. 2. Bad contact of DC motor control end. 3. Fan motor is stalling. 4. Motor malfunction. 5. Malfunction of mainboard rev detecting circuit.
38	Desynchro-nizing of compressor	H7			OFF 3S and blink 7 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	Refer to the malfunction analysis (IPM protection, loss of synchronism protection and overcurrent protection of phase current for compressor.
39	Malfunction of detecting plate(WIFI)	JF				Loads operate normally, while the unit can't be normally controlled by APP	1.Main board of indoor unit is damaged; 2.Detection board is damaged; 3.The connection between indoor unit and detection board is not good;
40	Outdoor DC fan motor malfunction	L3	OFF 3S and blink 23 times			Outdoor DC fan motor malfunction lead to compressor stop operation,	DC fan motor malfunction or system blocked or the connector loosed
41	power protection	L9	OFF 3S and blink 20 times			compressor stop operation and Outdoor fan motor will stop 30s latter , 3 minutes latter fan motor and compressor will restart	To protect the electronical components when detect high power
42	Indoor unit and outdoor unit doesn't match	LP	OFF 3S and blink 19 times			compressor and Outdoor fan motor can't work	Indoor unit and outdoor unit doesn't match
43	Failure start-up	LC			OFF 3S and blink 11 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop operation.	Refer to the malfunction analysis

NO.	Malfunction Name	Display Method of Indoor Unit				A/C status	Possible Causes
		Dual-8 Code Display	Indicator Display (during blinking, ON 0.5s and OFF 0.5s)				
			Operation Indicator	Cool Indicator	Heating Indicator		
44	Malfunction of phase current detection circuit for compressor	U1			OFF 3S and blink 13 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	Replace outdoor control panel AP1
45	Malfunction of voltage dropping for DC bus-bar	U3			OFF 3S and blink 20 times	During cooling and drying operation, compressor will stop while indoor fan will operate; During heating operation, the complete unit will stop	Supply voltage is unstable
46	Malfunction of complete units current detection	U5		OFF 3S and blink 13 times		During cooling and drying operation, the compressor will stop while indoor fan will operate; During heating operating, the complete unit will stop operation.	Theres circuit malfunction on outdoor units control panel AP1, please replace the outdoor units control panel AP1.
47	The four-way valve is abnormal	U7		OFF 3S and blink 20 times		If this malfunction occurs during heating operation, the complete unit will stop operation.	1.Supply voltage is lower than AC175V; 2.Wiring terminal 4V is loosened or broken; 3.4V is damaged, please replace 4V.
48	Zero-crossing malfunction of outdoor unit	U9	OFF 3S and blink 18 times			During cooling operation, compressor will stop while indoor fan will operate; during heating,the complete unit will stop operation.	Replace outdoor control panel AP1
49	Defrosting				once (during blinking, ON 10s and OFF	heating mode. Compressor will operate while indoor fan will stop	Its the normal state

50	Undefined outdoor unit error	oE				Cool: compressor and outdoor fan stops operation, while indoor fan operates; Heat: compressor, outdoor fan and indoor fan stop operation.	1. Outdoor ambient temperature exceeds the operation range of unit (eg: less than-20oC or more than 60oC for cooling; more than 30oC for heating); 2. Failure startup of compressor? 3. Are wires of compressor not connected tightly? 4. Is compressor damaged? 5. Is main board damaged?
51	Anti-freezing protection for evaporator	E2				Not the error code. It's the status code for the operation.	
52	Cold air prevention protection	E9				Not the error code. It's the status code for the operation.	
53	Refrigerant recovery mode	Fo				Refrigerant recovery. The Serviceman operates it for maintenance	

Analysis or processing of some of the malfunction display:

1. Compressor discharge protection

Possible reasons: shortage of refrigerant; blockage of air filter; poor ventilation or air flow short pass for condenser;the system has noncondensing gas (such as air, water etc.); blockage of capillary assy (including filter); l akage inside four-way valve causes incorrect operation; malfunction of compressor; malfunction of protection relay; malfunction of discharge sensor; outdoor temperature too high.

Processing method: refer to the malfunction analysis in the above section.

2. Low voltage overcurrent protection

Possible reason: Sudden drop of supply voltage.

3. Communic ation malfun ction

Processing method: Check if communic ation signal cable is connected reliably.

4. Sensor open or short circuit

Processing method: Check whethers ensor is normal, connected with the corre sponding position on the controller and if damage of lead wire is found.

5. Compressor over load protection

Possible reasons: insufficient or too much refrigrant; blockage of capillary an dincrease of suction temp.; improper running of compressor, burning in or stuck of bearing, damage of discharge valve; malfunction of protector.

Processing method: adjust refrige rant amount; replace the capillary; replace the compressor; use univers al meter to check if the contactor of compress or is fine when it is not over heated, if not replace the protecto .

6. System malfun ction

Overload protection.When tube temperature(Check the temperature of outdoor heat exchanger when cooling and check the temperature of indoor heat exchanger when heating) is too high, protection will beactivated.

Possible reasons: Outdoor tempera ture is too high when cooling; insufficient outdoor air circulation; refrigerant flow malfunctio

Please refer to the malfunction analysis in the previous section for handling method .

7. IPM module protection

Processing method:Once the module malfunction happens,if it persists for a long time and can not be self-canceled, cut off the power and turn off the unit,and then re-energize the unit again after about 10 min.After repeating the procedure for sever times, if the malfunction still exists,replace the module.

9.2 How to Check Simply the Main Part


Indoor unit

1. Malfunction of Temperature Sensor F1, F2


Main detection points:

- Is the wiring terminal between the temperature sensor and the controller loosened or poorly contacted?
- Is there short circuit due to trip-over of the parts?
- Is the temperature sensor broken?
- Is mainboard broken?

Malfunction diagnosis process:

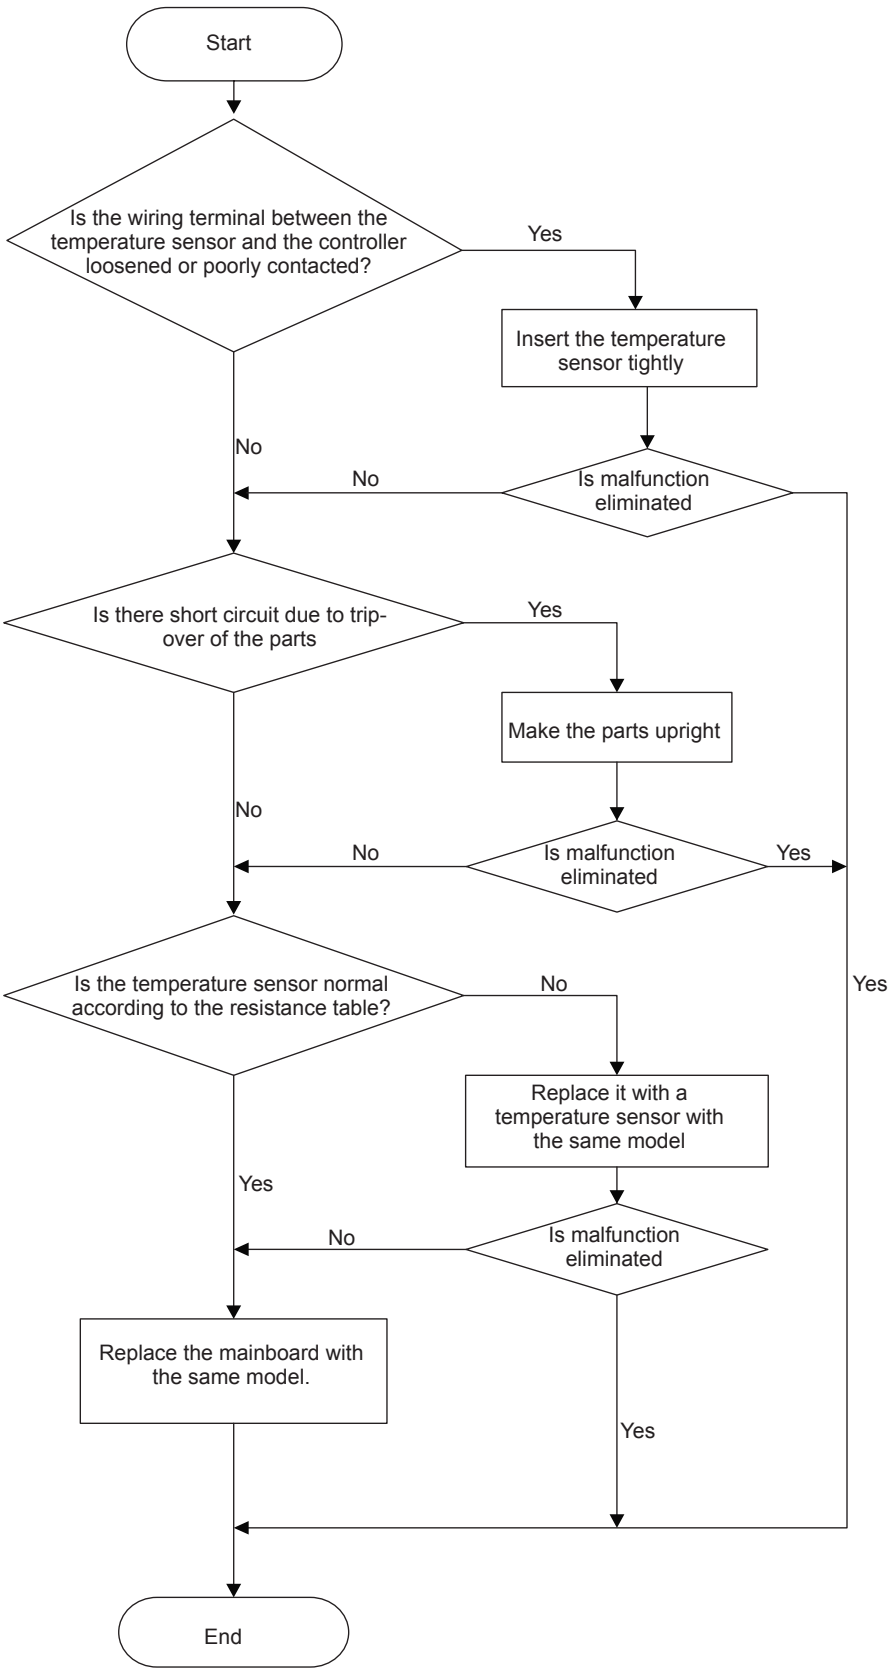

2.Malfunction of Blocked Protection of IDU Fan Motor H6

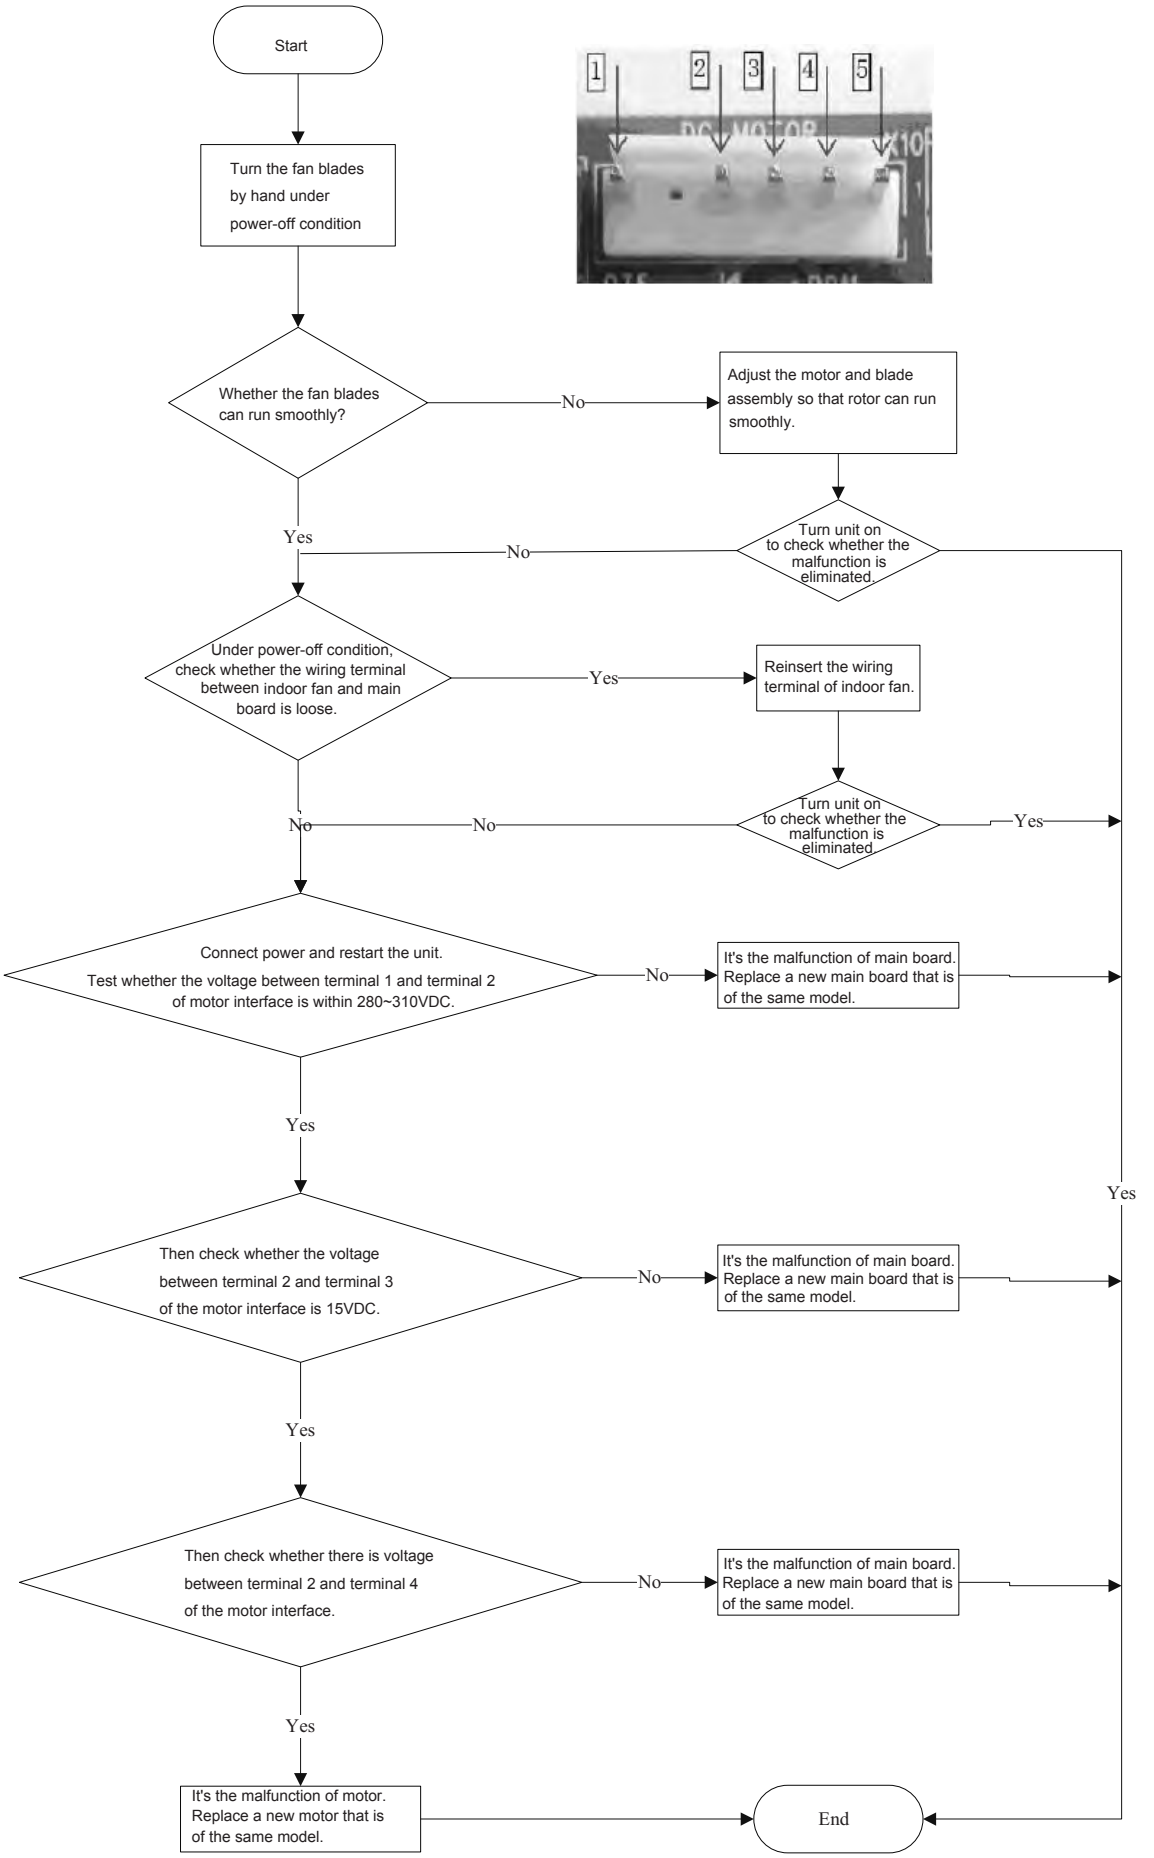


3. Malfunction of Protection of Jumper Cap C5

Main detection points:

- Is there jumper cap on the mainboard?
- Is the jumper cap inserted correctly and tightly?
- The jumper is broken?
- The motor is broken?
- Detection circuit of the mainboard is defined abnormal

Malfunction diagnosis process:

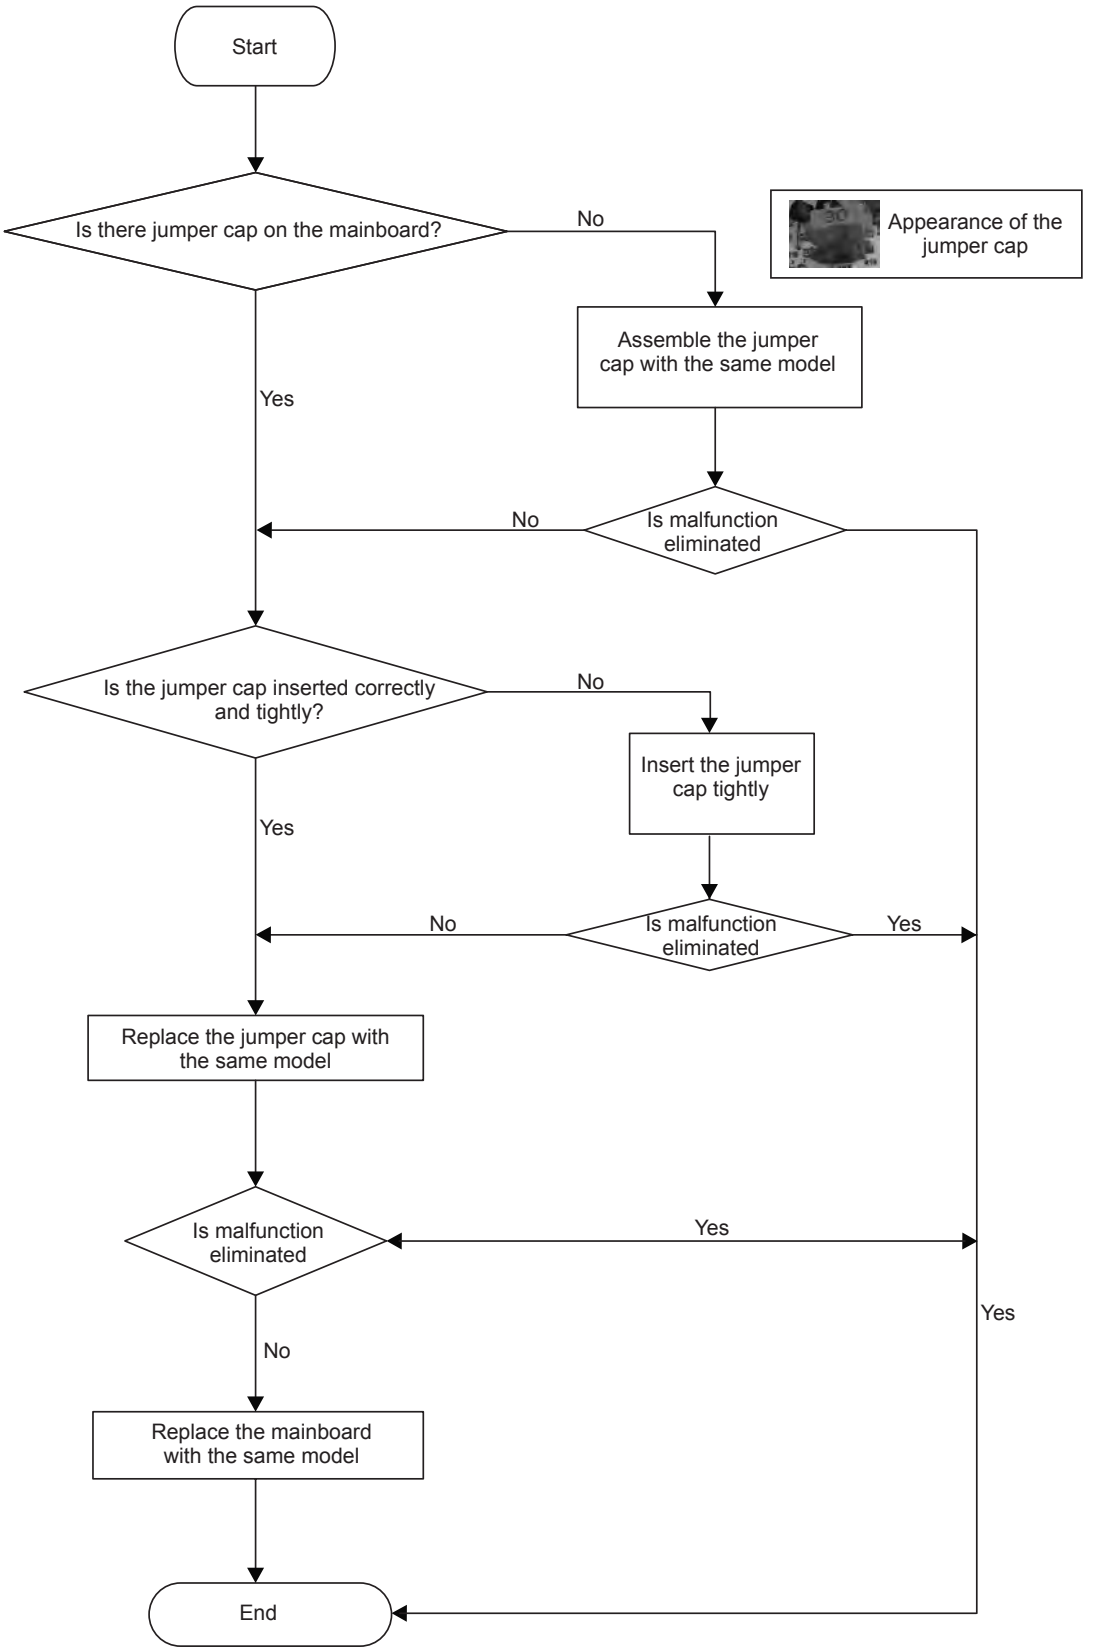


4. Malfunction of Overcurrent Protection E5

Main detection points:

- Is the supply voltage unstable with big fluctuation
- Is the supply voltage too low with overload?
- Hardware trouble?

Malfunction diagnosis process:

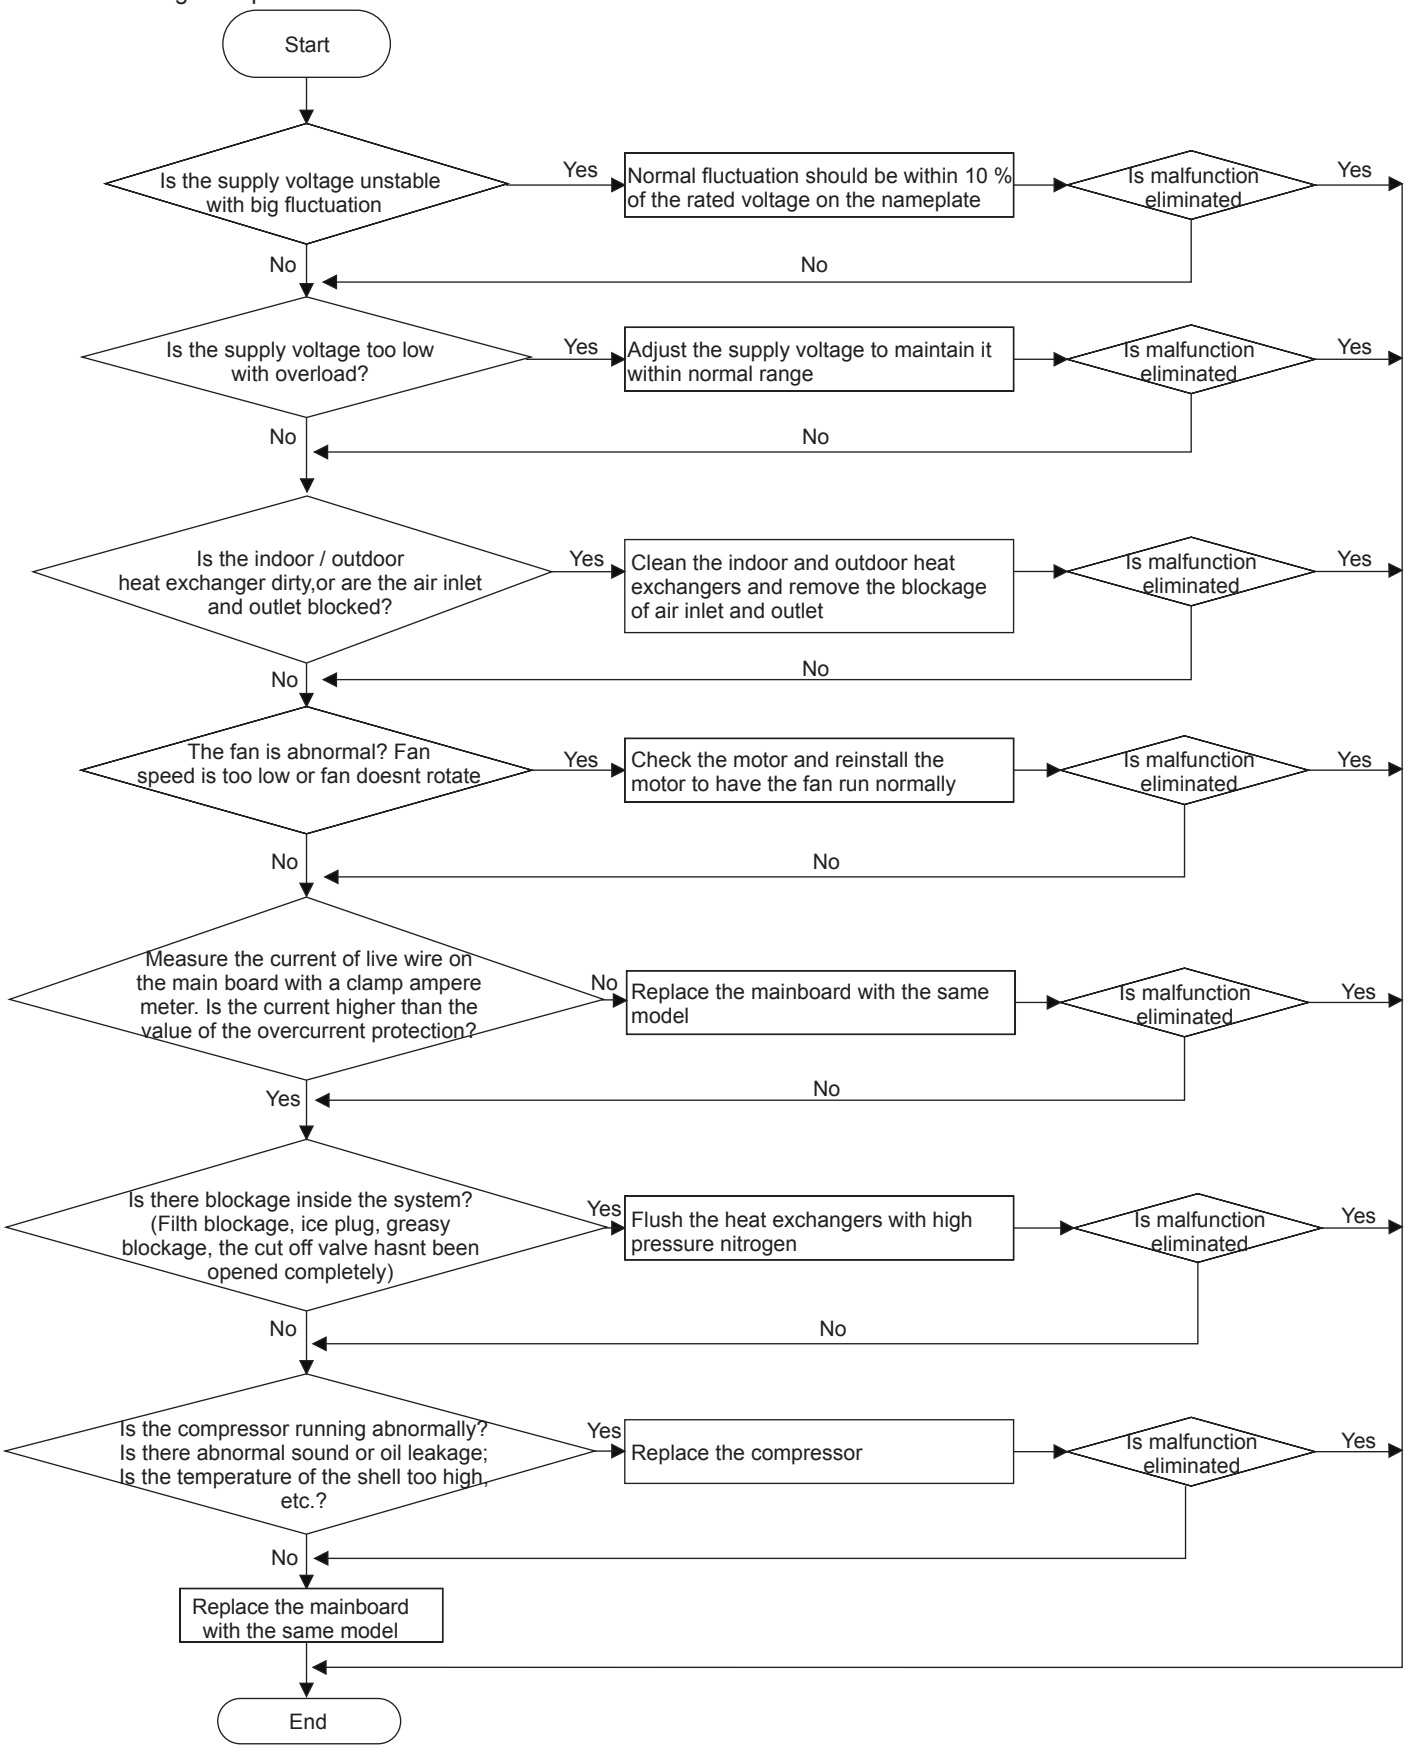


5. Malfunction of Zero-crossing Inspection Circuit Malfunction of the IDU Fan Motor U8

Main detection points:

● Instant energization afte de-energization while the capacitordischarges slowly?

● The zero-cross detectioncircuit of the mainboard is defined abnormal

Malfunction diagnosis process:

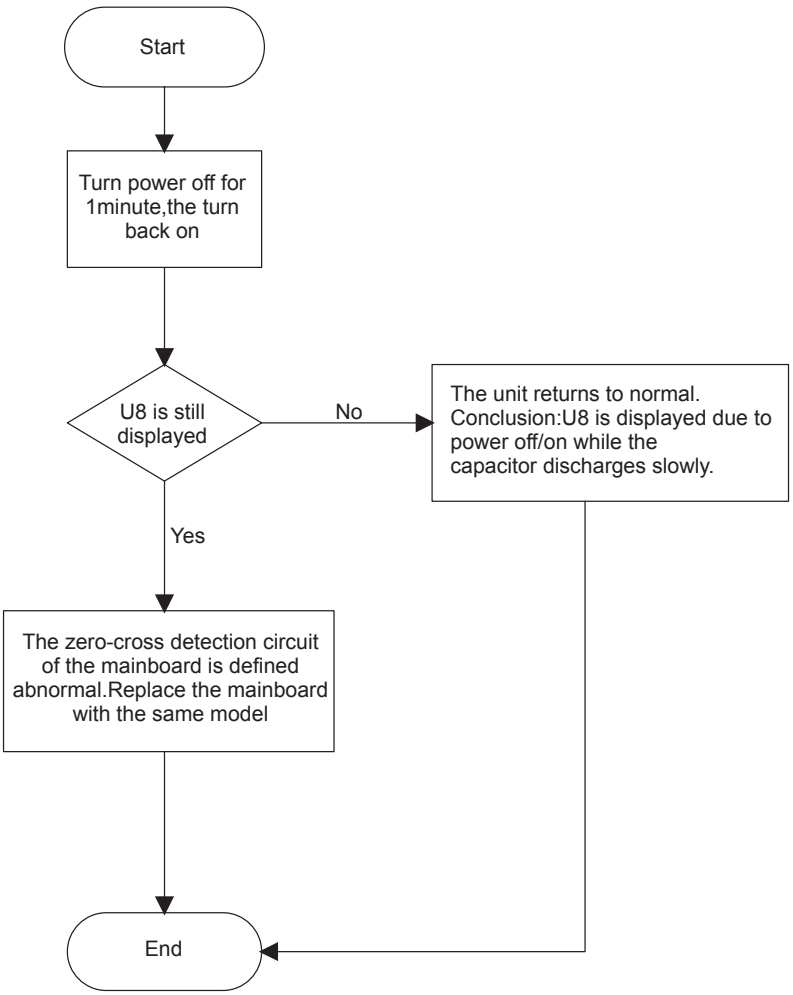


6.Malfunction of communication E6

Main detection points:


● Check if the connection wire and the built-in wiring of indoor and outdoor unit are connected well and without damage;

● If the communication circuit of indoor mainboard is damaged? If the communication circuit of outdoor mainboard (AP1) is damaged?

Malfunction diagnosis process:

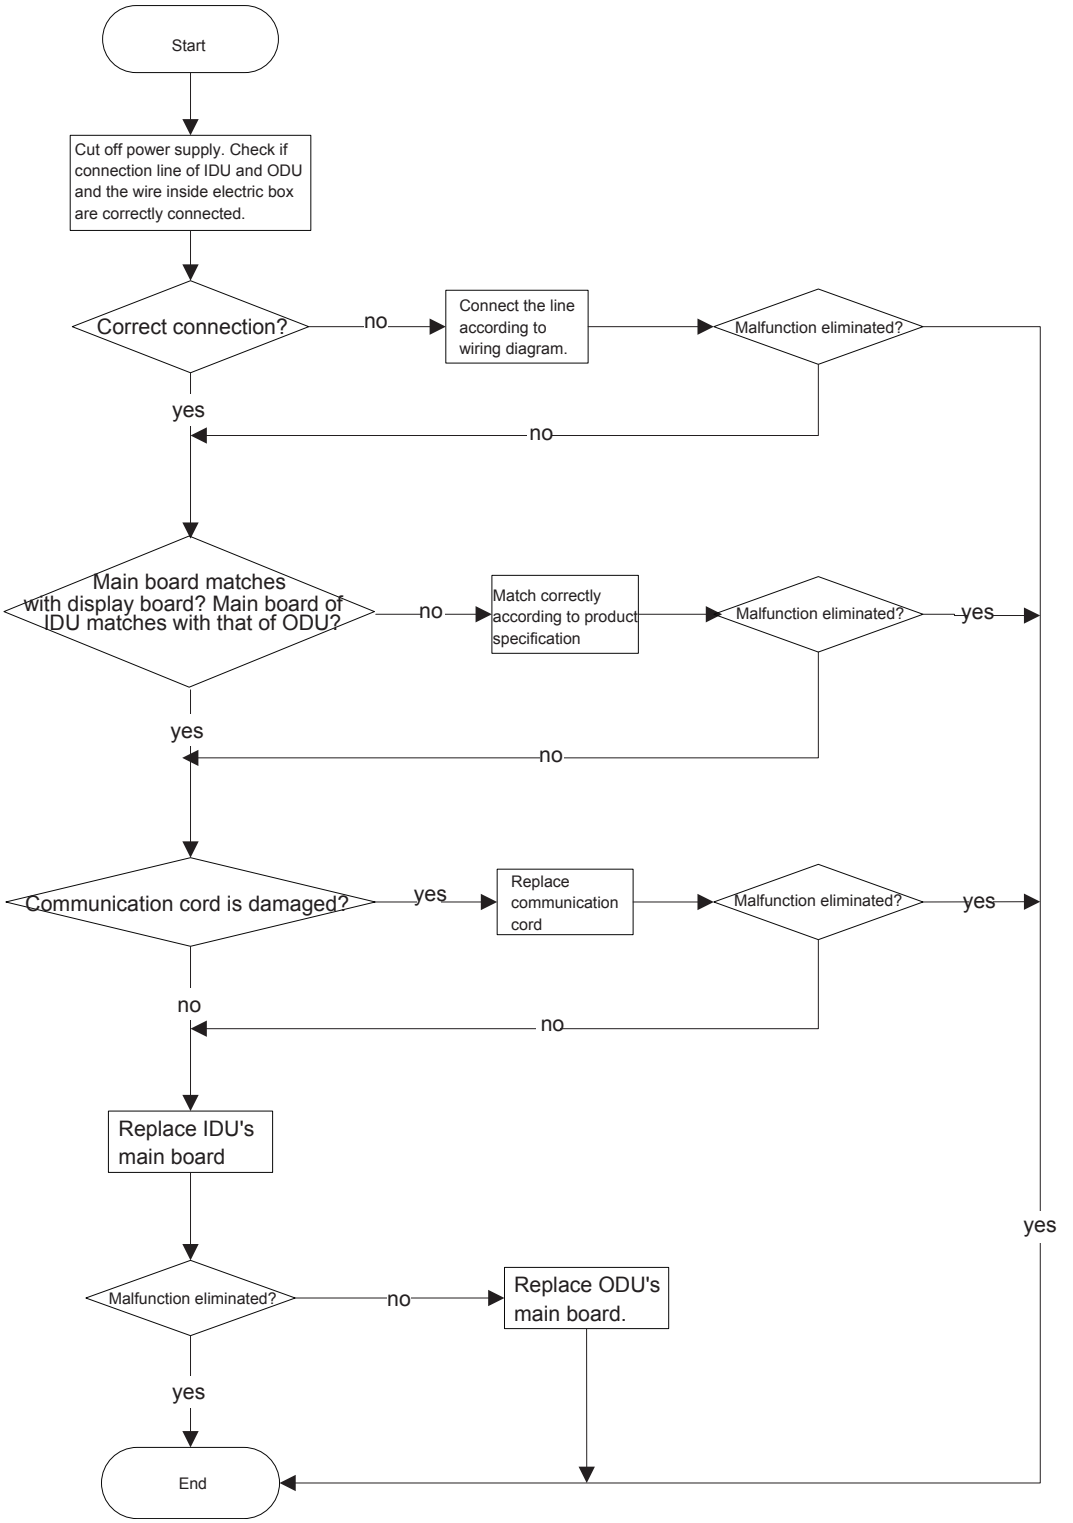

7. Malfunction of detecting plate(WIFI) JF

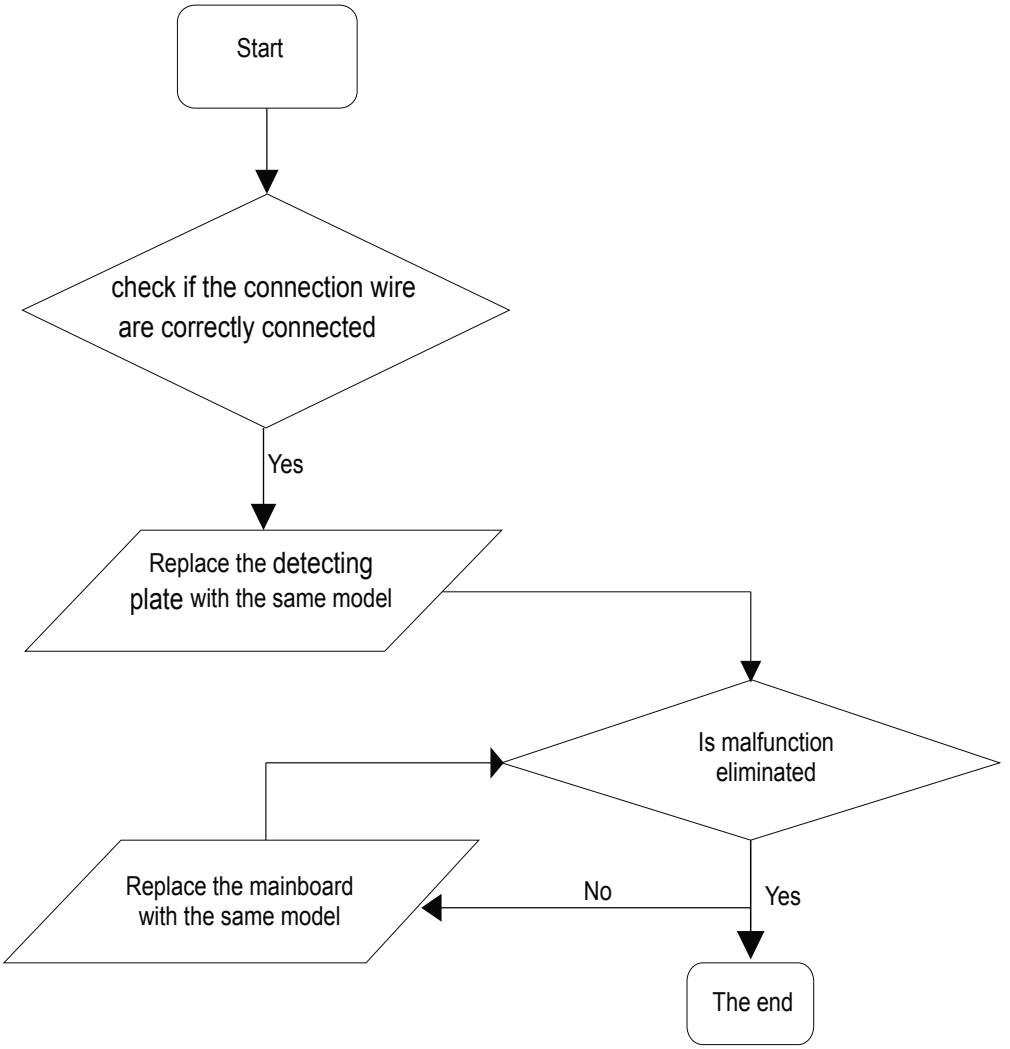


Outdoor unit

(1) Capacitor charge fault (Fault with outdoor unit) (AP1 below refers to the outdoor control panel)

Main Check Points:

- Use AC voltmeter to check if the voltage between terminal L and N on the wiring board is within 210VAC~240VAC.
- If the reactor (L) is correctly connected? If the connection is loose or fallen? If the reactor (L) is damaged?

Fault diagnosis process:

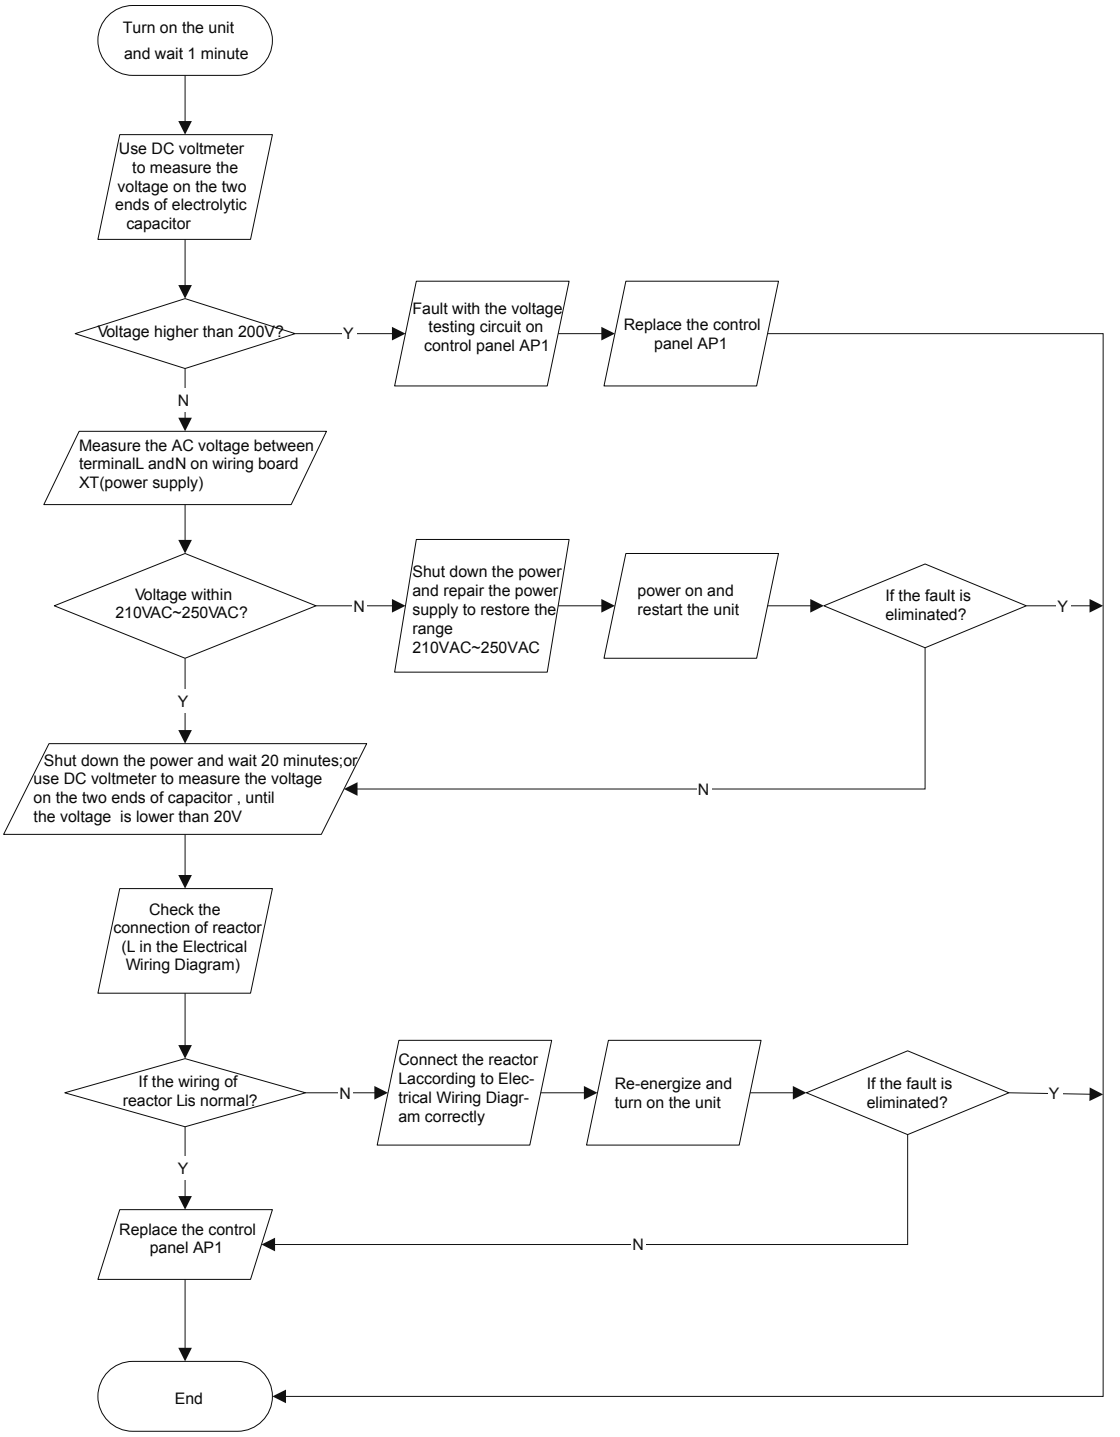


(2) **IPM protection, phase current overcurrent (the control board as below indicates the control board of outdoor unit) H5/P5**

Mainly detect:

(1) Compressor COMP terminal (2) voltage of power supply (3) compressor
(4) Refrigerant-charging volume (5) air outlet and air inlet of outdoor/indoor unit

Troubleshooting:

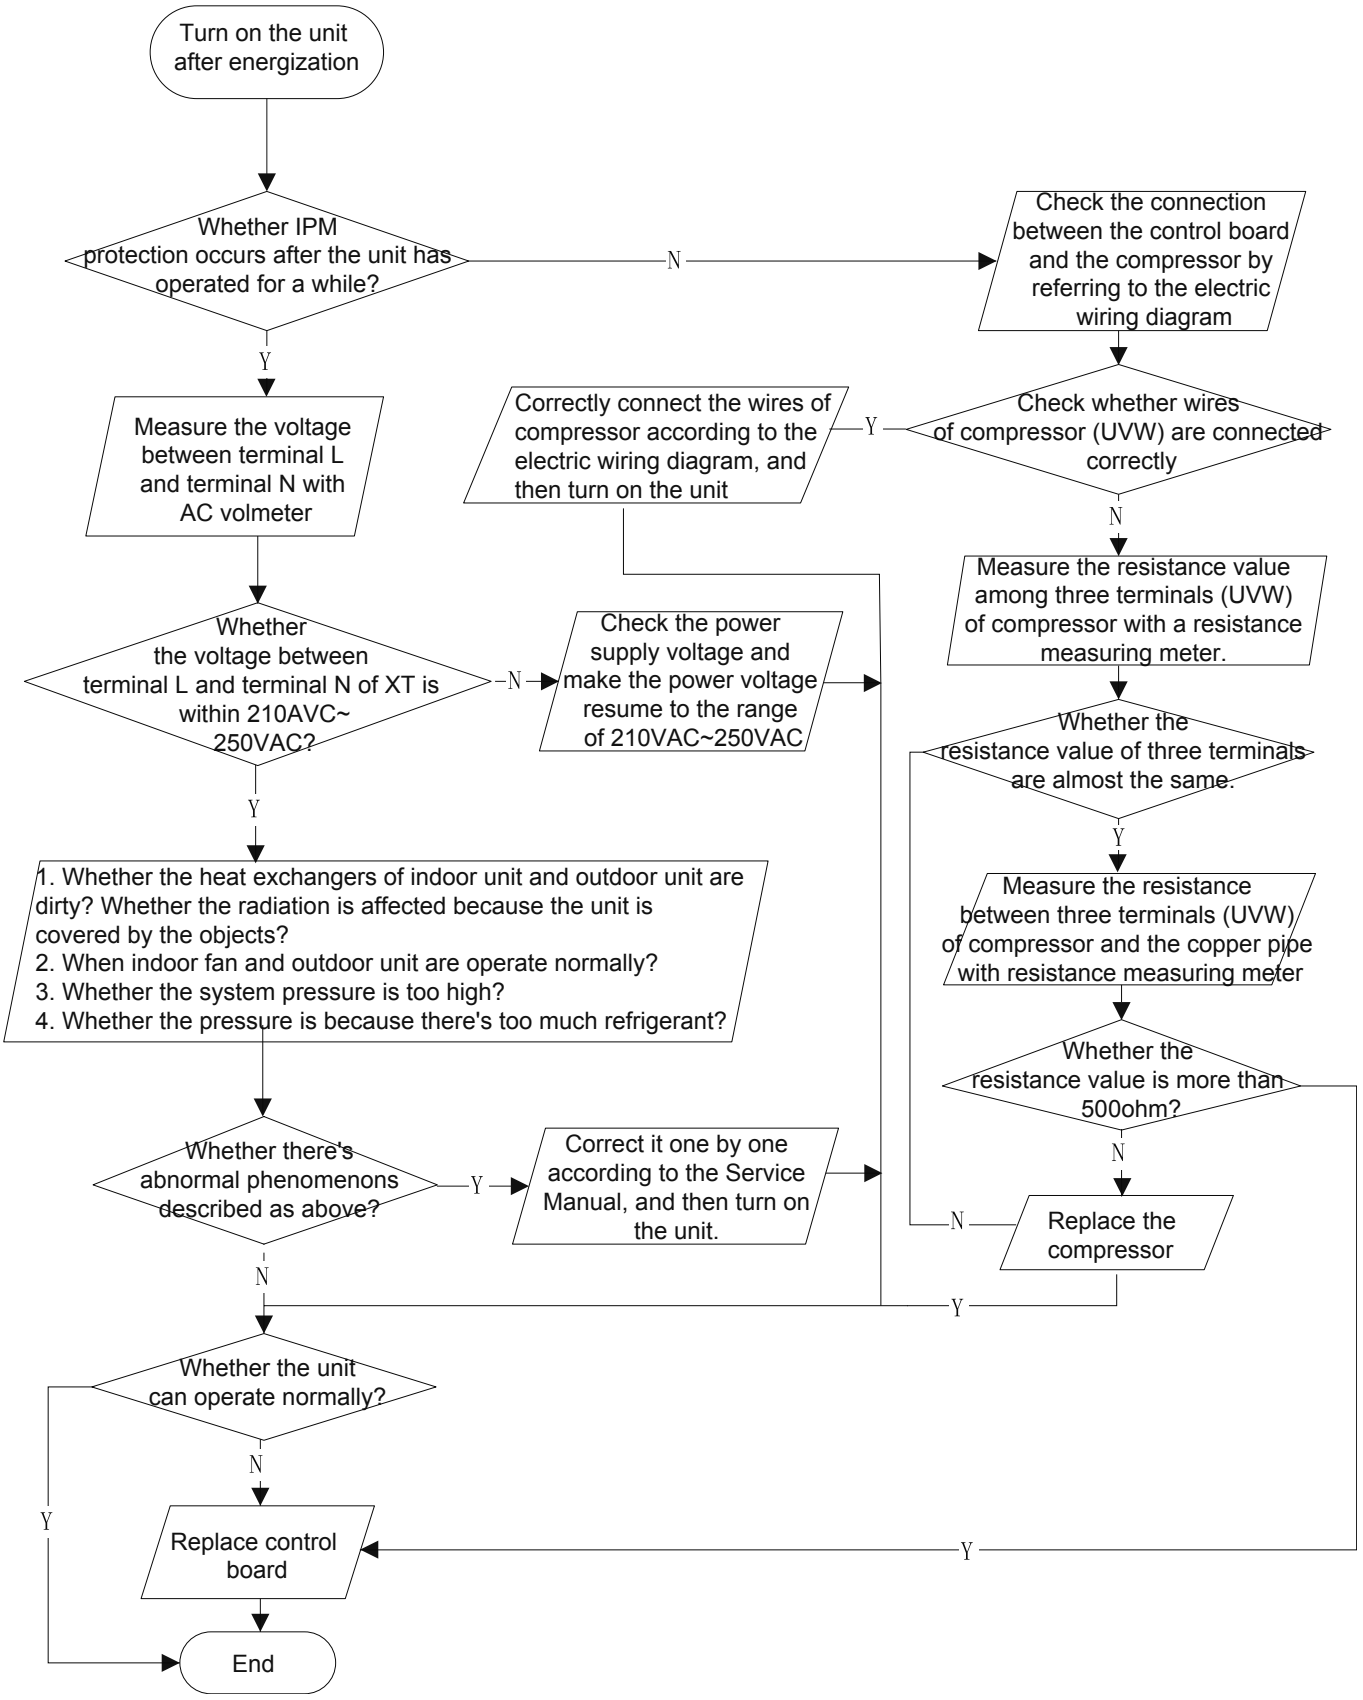


(3)High temperature and overload protection diagnosis (AP1 hereinafter refers to the control board of the outdoor unit)

Mainly detect:

- Is outdoor ambient temperature in normal range?
- Are the outdoor and indoor fans operating normally?
- Is the heat dissipation environment inside and outside the unit is good?

Fault diagnosis process:

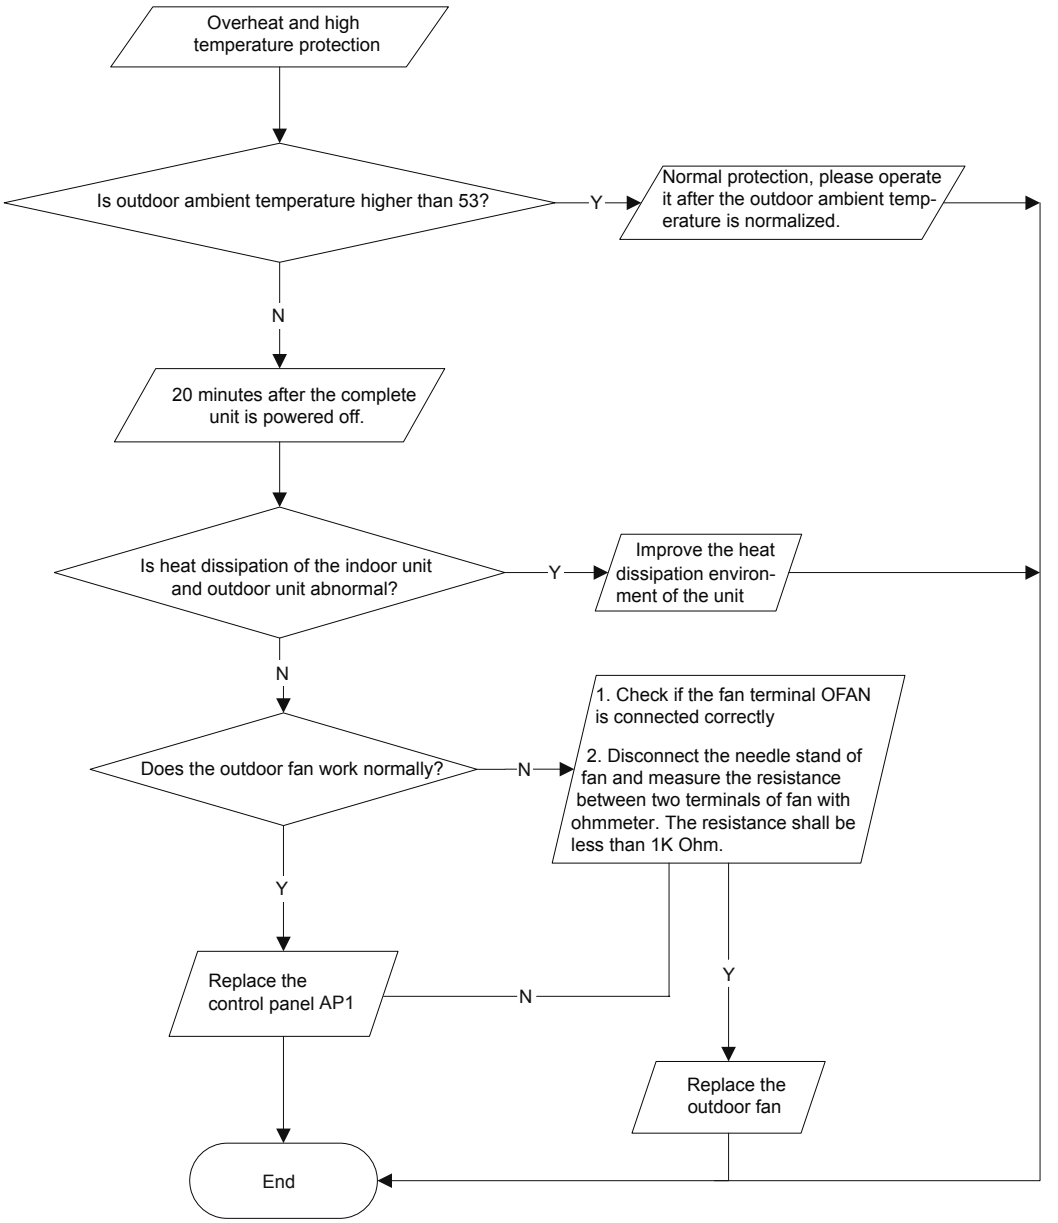


(4) Start-up failure (following AP1 for outdoor unit control board)

Mainly detect:

- Whether the compressor wiring is connected correct?
- Is compressor broken?
- Is time for compressor stopping enough?

Fault diagnosis process:

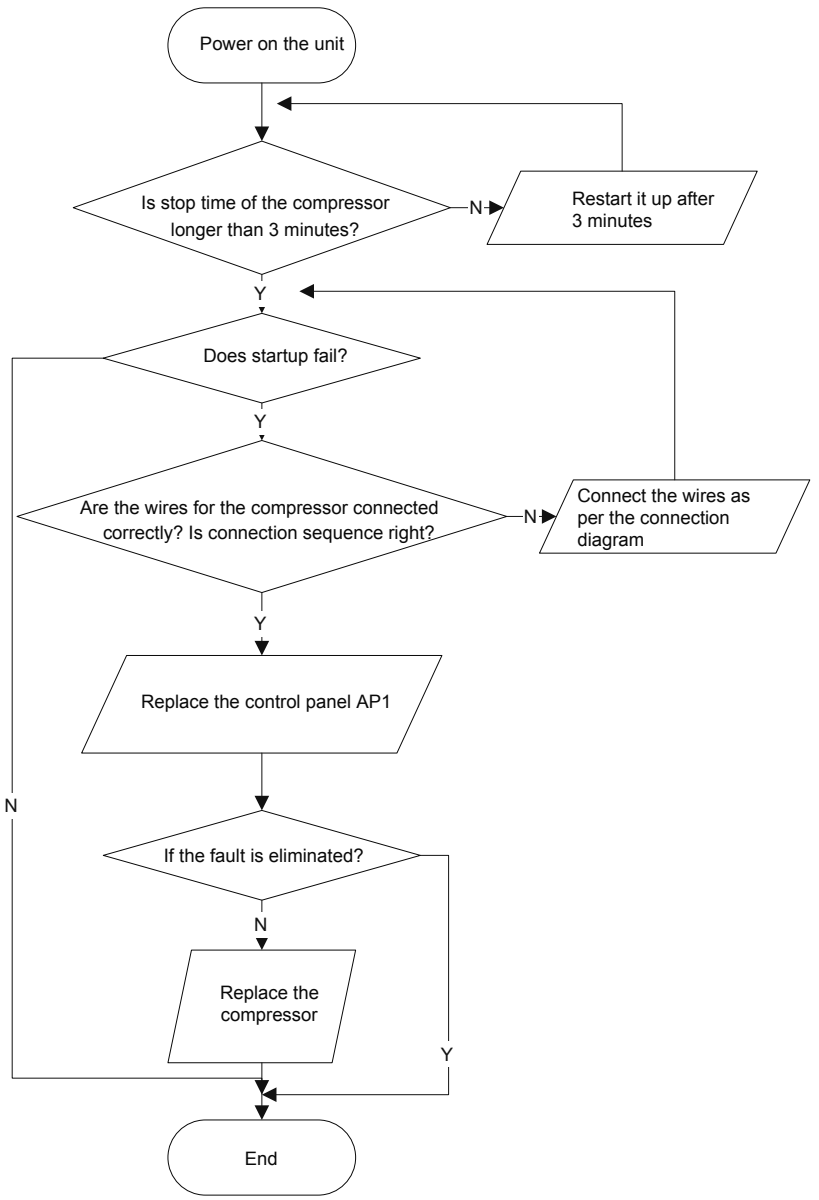


(5) Out of step diagnosis for the compressor (AP1 hereinafter refers to the control board of the outdoor unit)

Mainly detect:

- Whether the system pressure is too high?
- Whether the input voltage is too low?

Fault diagnosis process:

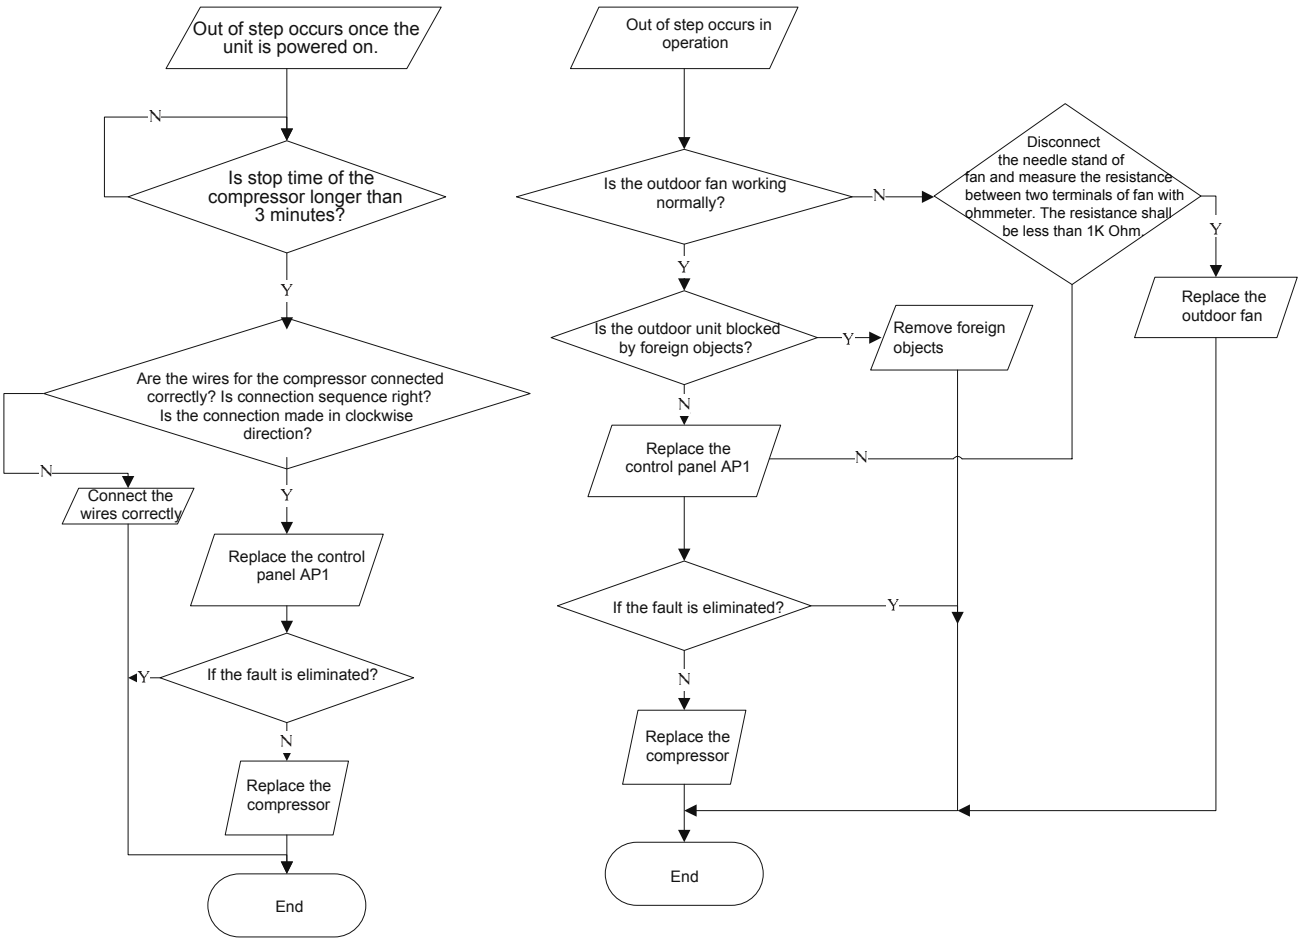


(6)Overload and air exhaust malfunction diagnosis (following AP1 for outdoor unit control board)


Mainly detect:

- Wether the PMV is connected well or not? Is PMV damaged?
- Is refrigerant leaked?

Fault diagnosis process:

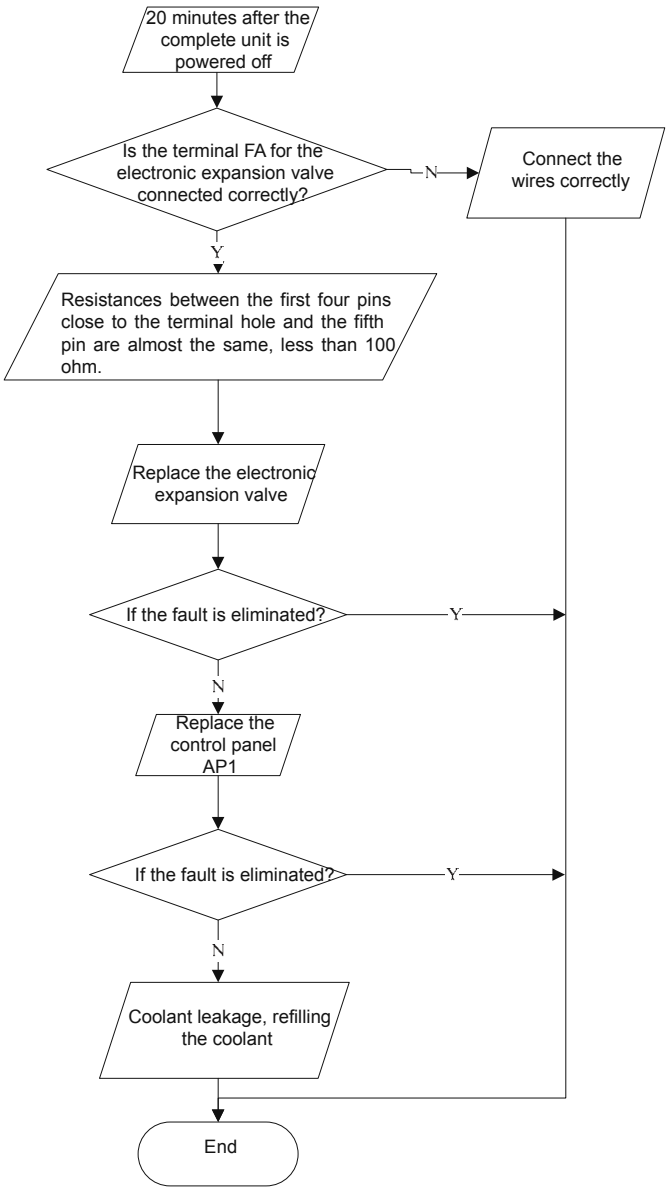

(7) High-pressure Protection

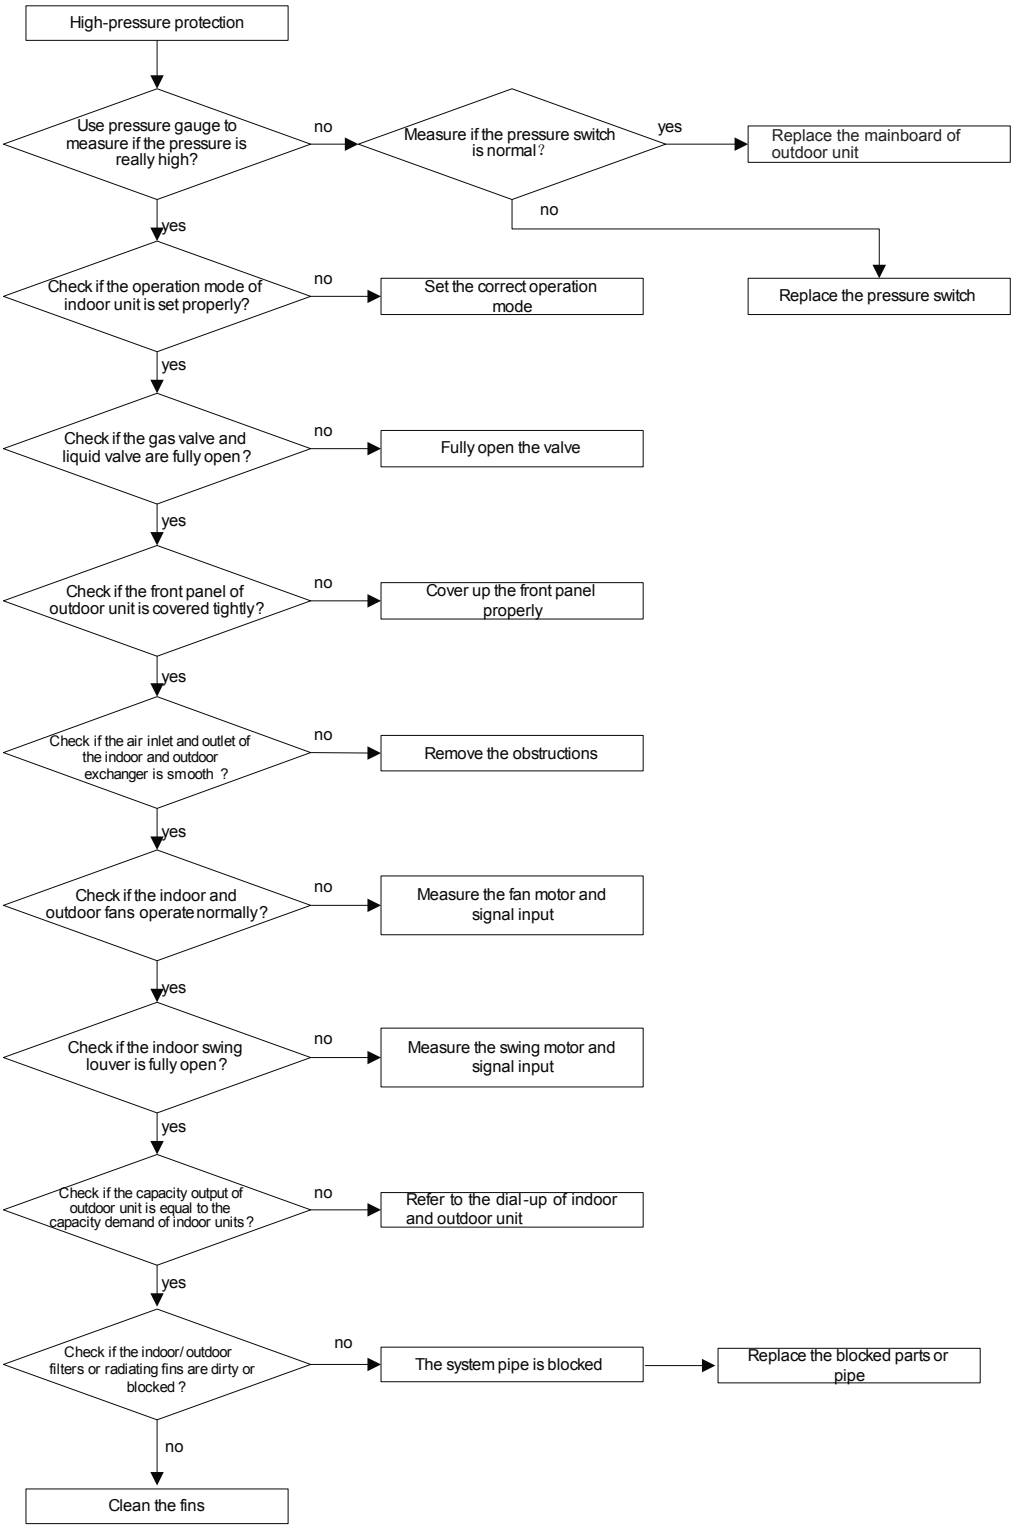


(8) Communication malfunction: (following AP1 for outdoor unit control board)

Mainly detect:

● Is there any damage for the indoor unit mainboard communication circuit? Is communication circuit damaged?

● Detect the indoor and outdoor units connection wire and indoor and outdoor units inside wiring is connect well or not, if is there any damage?

Fault diagnosis process:

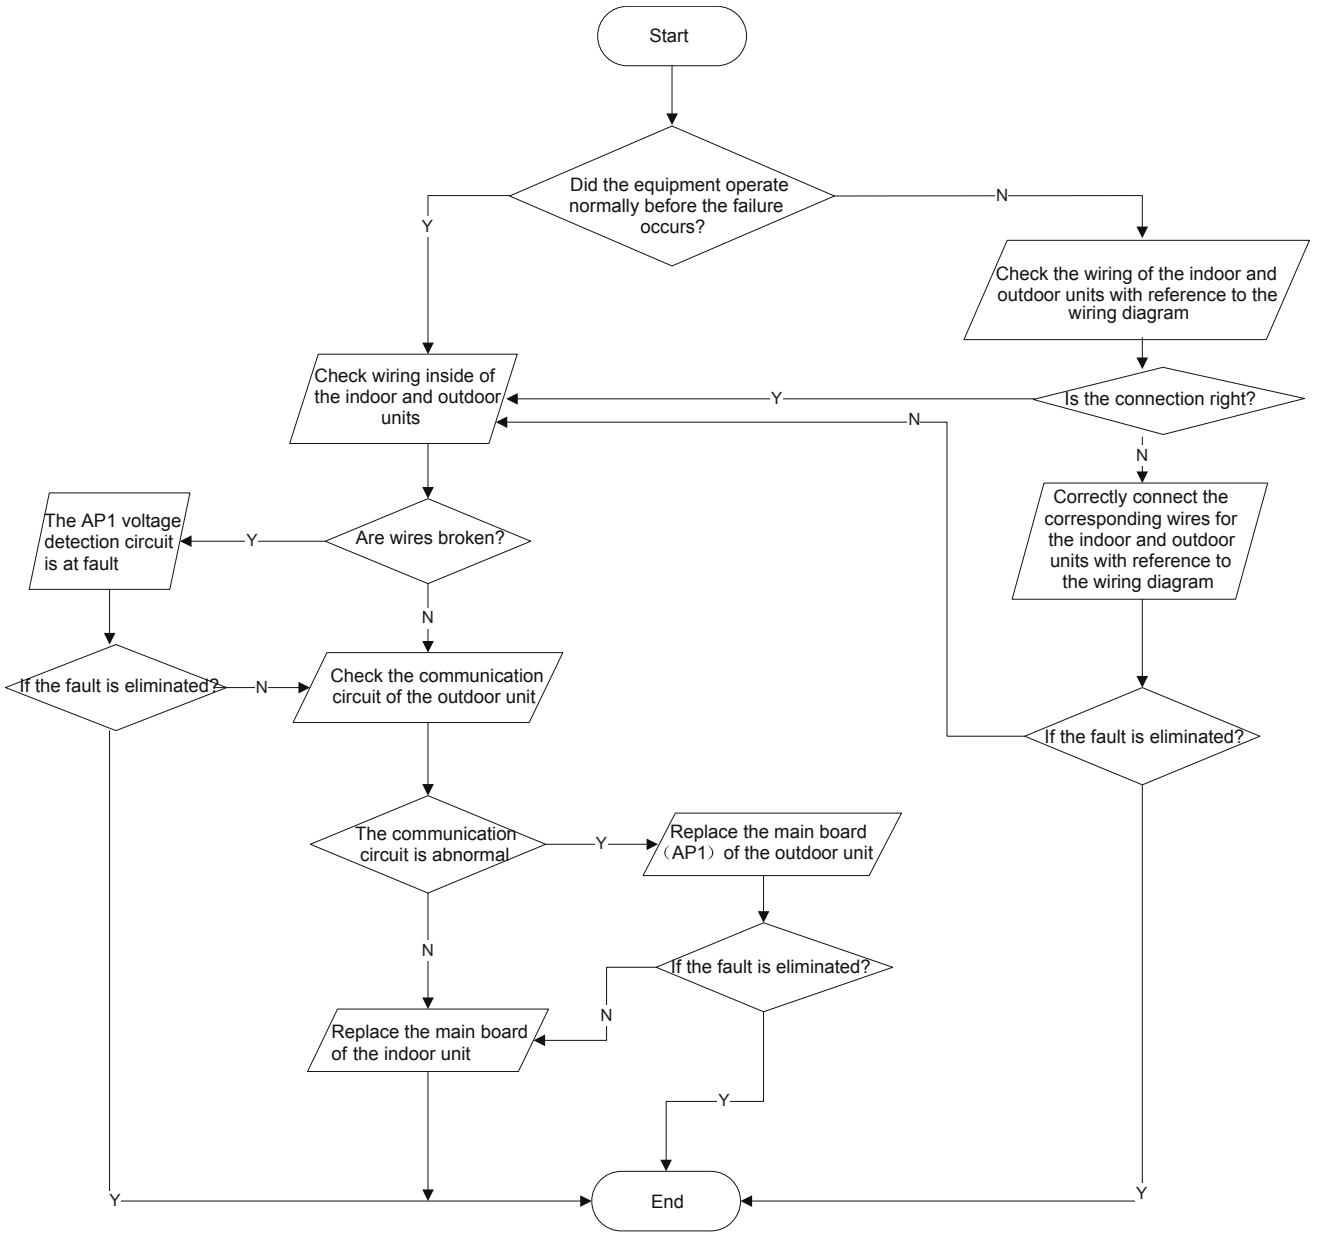


(9) Communication malfunction:(following AP1 for outdoor unit control board)

Mainly detect:

Detect the indoor and outdoor units connection wire and indoor and outdoor units inside wiring is connect well or not, If is there any damage?

Is there any damage for the indoor unit mainboard communication circuit? Is communication circuit damaged?

The flow chart fir malfunction detect:

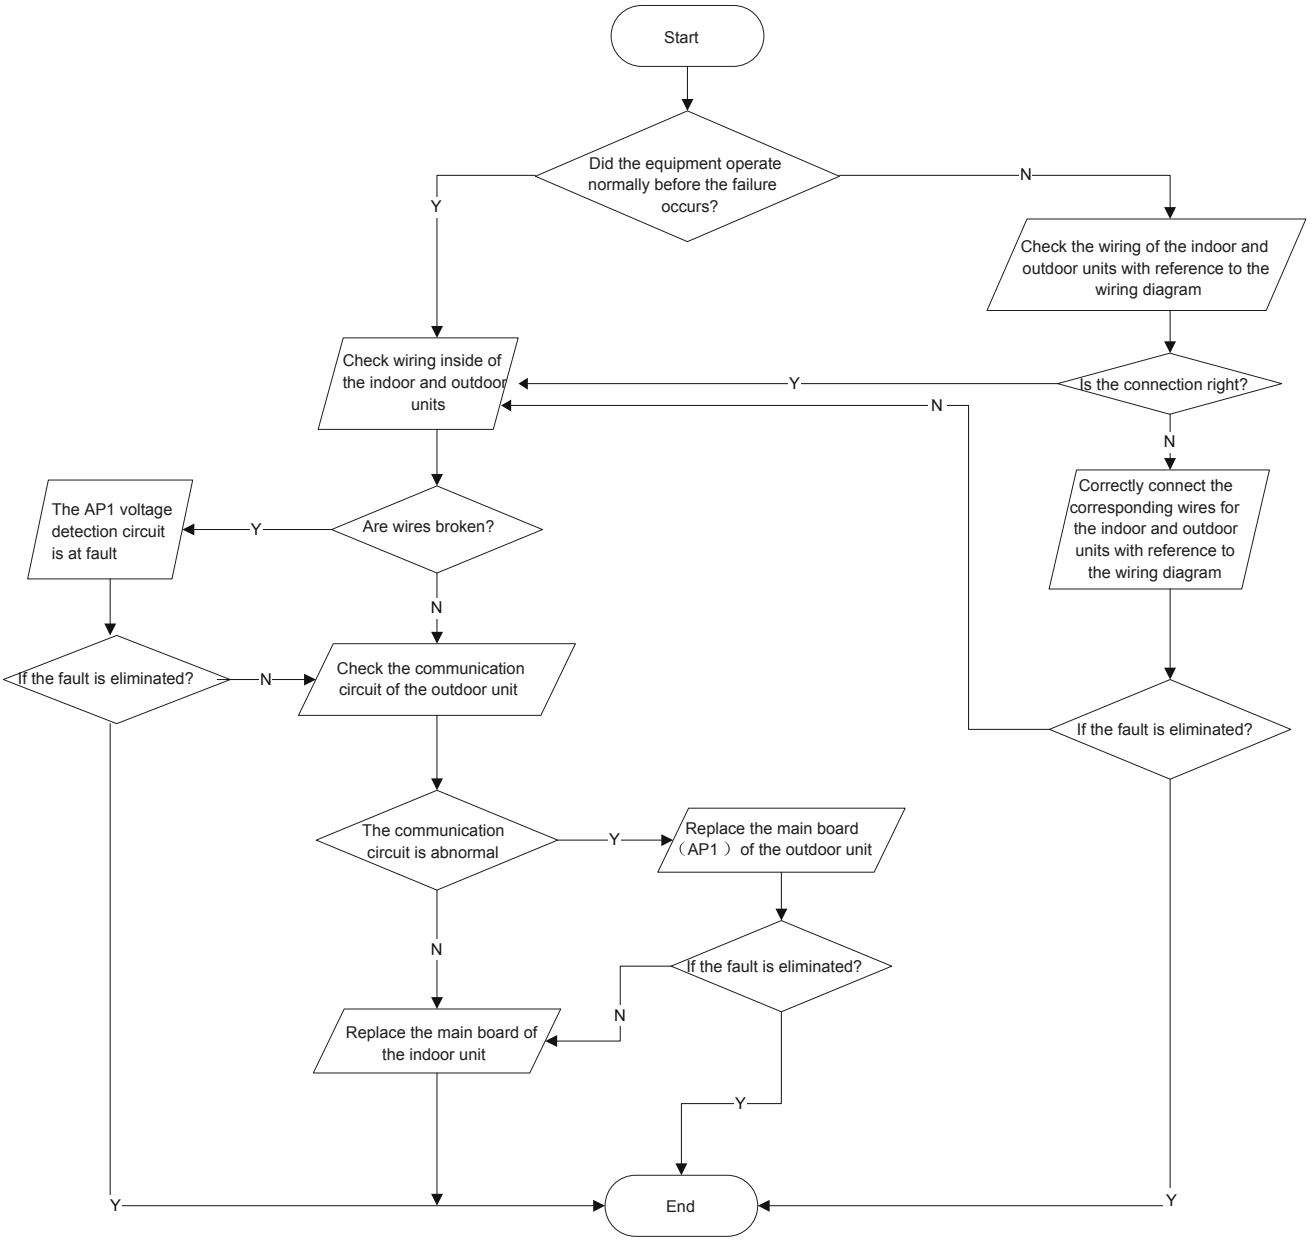

9.3 Troubleshooting for Normal Malfunction

1. Air Conditioner Cant be Started Up

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
No power supply, or poor connection for power plug	After energization, operation indicator isnt bright and the buzzer cant give out sound	Confirm whether its due to power failure. If yes, wait for power recovery. If not, check power supply circuit and make sure the power plug is connected well.
Wrong wire connection between indoor unit and outdoor unit, or poor connection for wiring terminals	Under normal power supply circumstances, operation indicator isnt bright after energization	Check the circuit according to circuit diagram and connect wires correctly. Make sure all wiring terminals are connected firml
Electric leakage for air conditioner	After energization, room circuit breaker trips off at once	Make sure the air conditioner is grounded reliably Make sure wires of air conditioner is connected correctly Check the wiring inside air conditioner. Check whether the insulation layer of power cord is damaged; if yes, place the power cord.
Model selection for air switch is improper	After energization, air switch trips off	Select proper air switch
Malfunction of remote controller	After energization, operation indicator is bright, while no display on remote controller or buttons have no action.	Replace batteries for remote controller Repair or replace remote controller

2. Poor Cooling (heating) for Air Conditioner

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
Set temperature is improper	Observe the set temperature on remote controller	Adjust the set temperature
Rotation speed of the IDU fan motor is set too low	Small wind blow	Set the fan speed at high or medium
Filter of indoor unit is blocked	Check the filter to see its blocked	Clean the filter
Installation position for indoor unit and outdoor unit is improper	Check whether the installation postion is proper according to installation requirement for air conditioner	Adjust the installation position, and install the rainproof and sunproof for outdoor unit
Refrigerant is leaking	Discharged air temperature during cooling is higher than normal discharged wind temperature; Discharged air temperature during heating is lower than normal discharged wind temperature; Units pressure is much lower than regulated range	Find out the leakage causes and deal with it. Add refrigerant.
Malfunction of 4-way valve	Blow cold wind during heating	Replace the 4-way valve
Malfunction of capillary	Discharged air temperature during cooling is higher than normal discharged wind temperature; Discharged air temperature during heating is lower than normal discharged wind temperature; Unitt pressure is much lower than regulated range. If refrigerant isnt leaking, part of capillary is blocked	Replace the capillary
Flow volume of valve is insufficient	The pressure of valves is much lower than that stated in the specificatio	Open the valve completely
Malfunction of horizontal louver	Horizontal louver cant swing	Refer to point 3 of maintenance method for details
Malfunction of the IDU fan motor	The IDU fan motor cant operate	Refer to troubleshooting for H6 for maintenance method in details
Malfunction of the ODU fan motor	The ODU fan motor cant operate	Refer to point 4 of maintenance method for details
Malfunction of compressor	Compressor cant operate	Refer to point 5 of maintenance method for details

3. Horizontal Louver Cant Swing

Possible Causes	Discriminating Method (Air conditioner Status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firml
Stepping motor is damaged	Stepping motor cant operate	Repair or replace stepping motor
Main board is damaged	Others are all normal, while horizontal louver cant operate	Replace the main board with the same model

4. ODU Fan Motor Cant Operate

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firml
Capacity of the ODU fan motor is damaged	Measure the capacity of fan capacitor with an universal meter and find that the capacity is out o the deviation range indicated on the nameplate of fan capacitor.	Replace the capacity of fan
Power voltage is a little low or high	Use universal meter to measure the power supply voltage. The voltage is a little high or low	Suggest to equip with voltage regulator
Motor of outdoor unit is damaged	When unit is on, cooling/heating performance is bad and ODU compressor generates a lot of noise and heat.	Change compressor oil and refrigerant. If no better, replace the compressor with a new one

5. Compressor Cant Operate

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Wrong wire connection, or poor connection	Check the wiring status according to circuit diagram	Connect wires according to wiring diagram to make sure all wiring terminals are connected firml
Capacity of compressor is damaged	Measure the capacity of fan capacitor with an universal meter and find that the capacity is out o the deviation range indicated on the nameplate of fan capacitor.	Replace the compressor capacitor
Power voltage is a little low or high	Use universal meter to measure the power supply voltage. The voltage is a little high or low	Suggest to equip with voltage regulator
Coil of compressor is burnt out	Use universal meter to measure the resistance between compressor terminals and its 0	Repair or replace compressor
Cylinder of compressor is blocked	Compressor cant operate	Repair or replace compressor

6. Air Conditioner is Leaking

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
Drain pipe is blocked	Water leaking from indoor unit	Eliminate the foreign objects inside the drain pipe
Drain pipe is broken	Water leaking from drain pipe	Replace drain pipe
Wrapping is not tight	Water leaking from the pipe connection place of indoor unit	Wrap it again and bundle it tightly


7. Abnormal Sound and Vibration

Possible causes	Discriminating method (air conditioner status)	Troubleshooting
When turn on or turn off the unit, the panel and other parts will expand and theres abnormal sound	Theres the sound of "PAPA"	Normal phenomenon. Abnormal sound will disappear after a few minutes.
When turn on or turn off the unit, theres abnormal sound due to flow of refrigerant inside air conditioner	Water-running sound can be heard	Normal phenomenon. Abnormal sound will disappear after a few minutes.
Foreign objects inside the indoor unit or therere parts touching together inside the indoor unit	Theres abnormal sound fro indoor unit	Remove foreign objects. Adjust all parts position of indoor unit, tighten screws and stick damping plaster between connected parts
Foreign objects inside the outdoor unit or therere parts touching together inside the outdoor unit	Theres abnormal sound fro outdoor unit	Remove foreign objects. Adjust all parts position of outdoor unit, tighten screws and stick damping plaster between connected parts
Short circuit inside the magnetic coil	During heating, the way valve has abnormal electromagnetic sound	Replace magnetic coil
Abnormal shake of compressor	Outdoor unit gives out abnormal sound	Adjust the support foot mat of compressor, tighten the bolts
Abnormal sound inside the compressor	Abnormal sound inside the compressor	If add too much refrigerant during maintenance, please reduce refrigerant properly. Replace compressor for other circumstances.

10. Exploded View and Parts List

10.1 Indoor Unit

For some models:

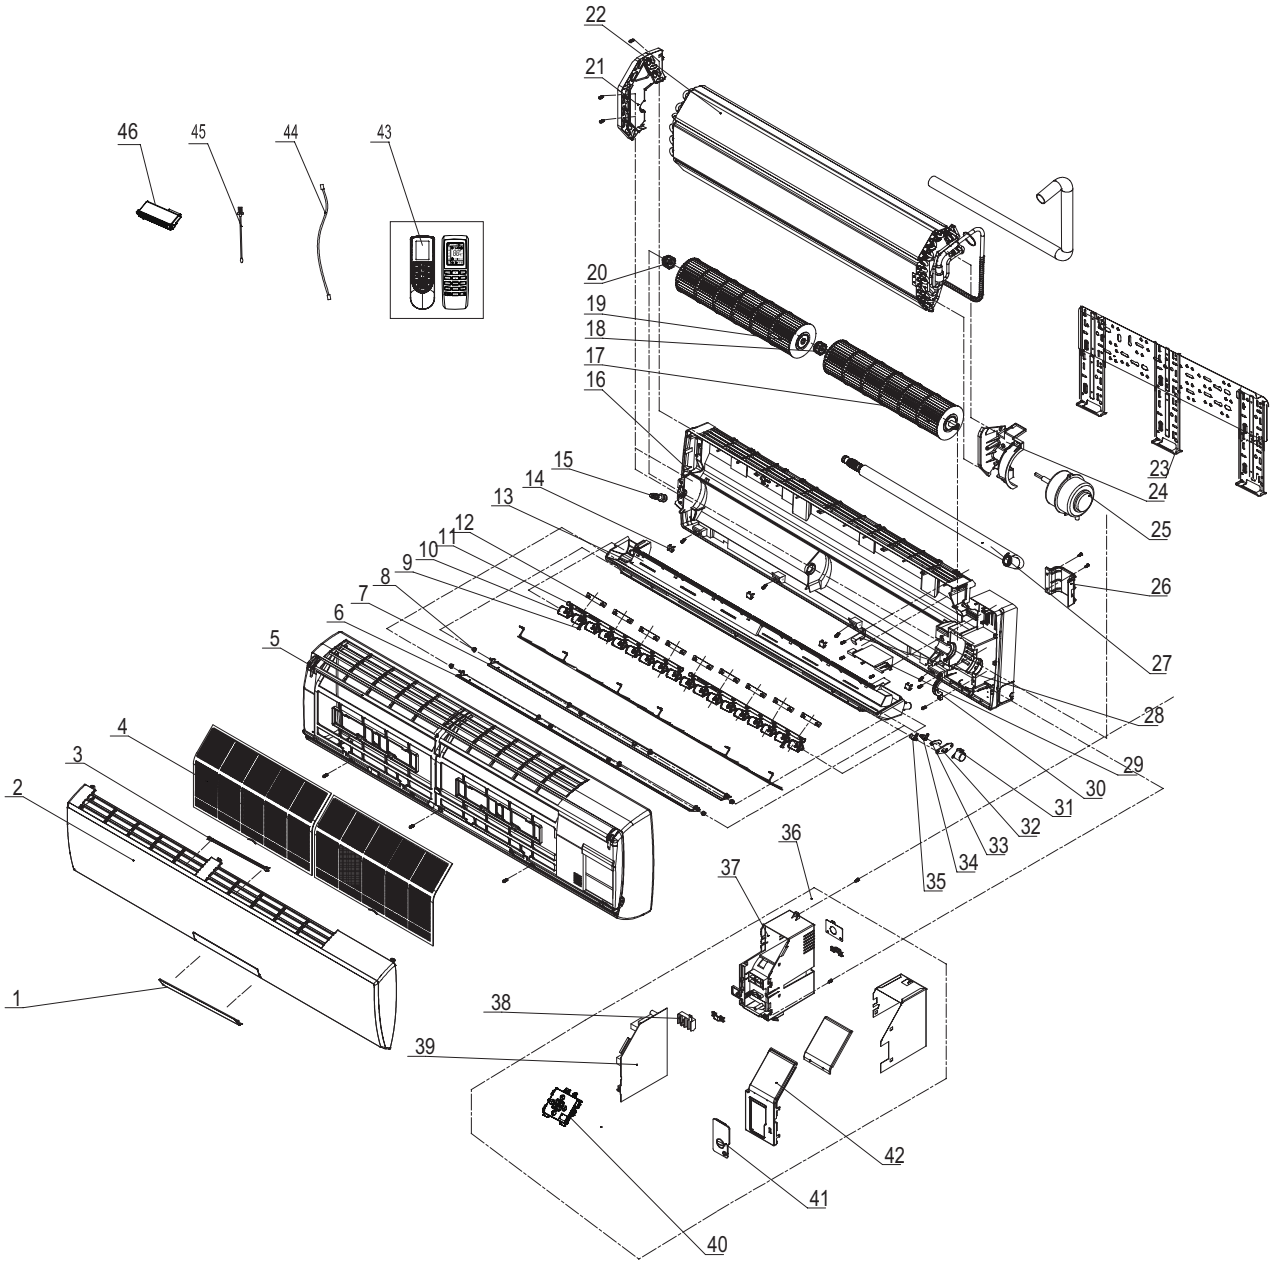

The component picture is only for reference; please refer to the actual product.


NO.	Description	Part Code		Qty
			SC-36ZGLD-HP230	
	Product Code		CB433N00402	
1	Receiver Window		/	/
2	Front Panel		20000300022S	1
3	Stand bar		2421212001	1
4	Filter Sub-Assy		11122106	2
5	Front Case Sub-Assy		20900700005	1
6	Upper Guide Louver		1051216601	1
7	Lower guide louver		1051216701	1
8	Axile Bush		10542704	6
9	Air Louver 2		1051216902	2
10	Air Louver 1		1051216802	16
11	Connecting Rod		10582086	2
12	Louver Clamp		26112158	9
13	Water Tray		2018213802	1
14	Screw Cover		2425200506	4
15	Rubber Plug (Water Tray)		76712012	1
16	Rear Case Sub-Assy		00000100113	1
17	Cross Flow Fan 1		10352039	1
18	Bearing Holder sub-assy		26152028	1
19	Cross Flow Fan 2		10352040	1
20	O-Gasket sub-assy of Bearing		76512051	1
21	Left Evaporator Support		24212041	1
22	Evaporator Assy		01002000027	1
23	Wall Mounting Frame		01252398	1
24	Right Support of Evaporator		2421204201	1
25	Fan Motor		1501213401	1
26	Pipe Clamp		26112071	1
27	Drainage hose		0523001404	1
28	Fixed Clip (Evaporator)		02112009	1
29	Cover Plate		2012212402	1
30	Motor Fixed Clip		26112324	1
31	Step Motor		1521210701	1
32	Press plate (crank)		26112070	1
33	Crank-guide		10582041	1
34	Upper Crank		10562004	1
35	Lower crank		10562005	1
36	Electric Box Assy		10000204114	1
37	Electric Box		201022502	1
38	Terminal Board		42011233	1
39	Main Board		30138001017	1
40	Display Board		30565277	1
41	Electric Box Cover		201022523	1
42	Electric Box Cover		2011204404S	1
43	Remote Controller		305001000085	1
44	Tube Sensor		390000592	1
45	Ambient Temperature Sensor		390000453	1
46	Detecting plate(WIFI)		30070077	1

Above data is subject to change without notice.

NO.	Description	Part Code		Qty
	Product Code			
1	Receiver Window			/
2	Front Panel			1
3	Stand bar			1
4	Filter Sub-Assy			2
5	Front Case Sub-Assy			1
6	Upper Guide Louver			1
7	Lower guide louver			1
8	Axile Bush			6
9	Air Louver 2			2
10	Air Louver 1			16
11	Connecting Rod			2
12	Louver Clamp			9
13	Water Tray			1
14	Screw Cover			4
15	Rubber Plug (Water Tray)			1
16	Rear Case Sub-Assy			1
17	Cross Flow Fan 1			1
18	Bearing Holder sub-assy			1
19	Cross Flow Fan 2			1
20	O-Gasket sub-assy of Bearing			1
21	Left Evaporator Support			1
22	Evaporator Assy			1
23	Wall Mounting Frame			1
24	Right Support of Evaporator			1
25	Fan Motor			1
26	Pipe Clamp			1
27	Drainage hose			1
28	Fixed Clip (Evaporator)			1
29	Cover Plate			1
30	Motor Fixed Clip			1
31	Step Motor			1
32	Press plate (crank)			1
33	Crank-guide			1
34	Upper Crank			1
35	Lower crank			1
36	Electric Box Assy			1
37	Electric Box			1
38	Terminal Board			1
39	Main Board			1
40	Display Board			1
41	Electric Box Cover			1
42	Electric Box Cover			1
43	Remote Controller			1
44	Tube Sensor			1
45	Ambient Temperature Sensor			1
46	Detecting plate(WIFI)			1

Above data is subject to change without notice.

SC-36ZPL-HP230/SC-36WPL-HP230 SC-36ZGLD-HP230/SC-36WGLD-HP230

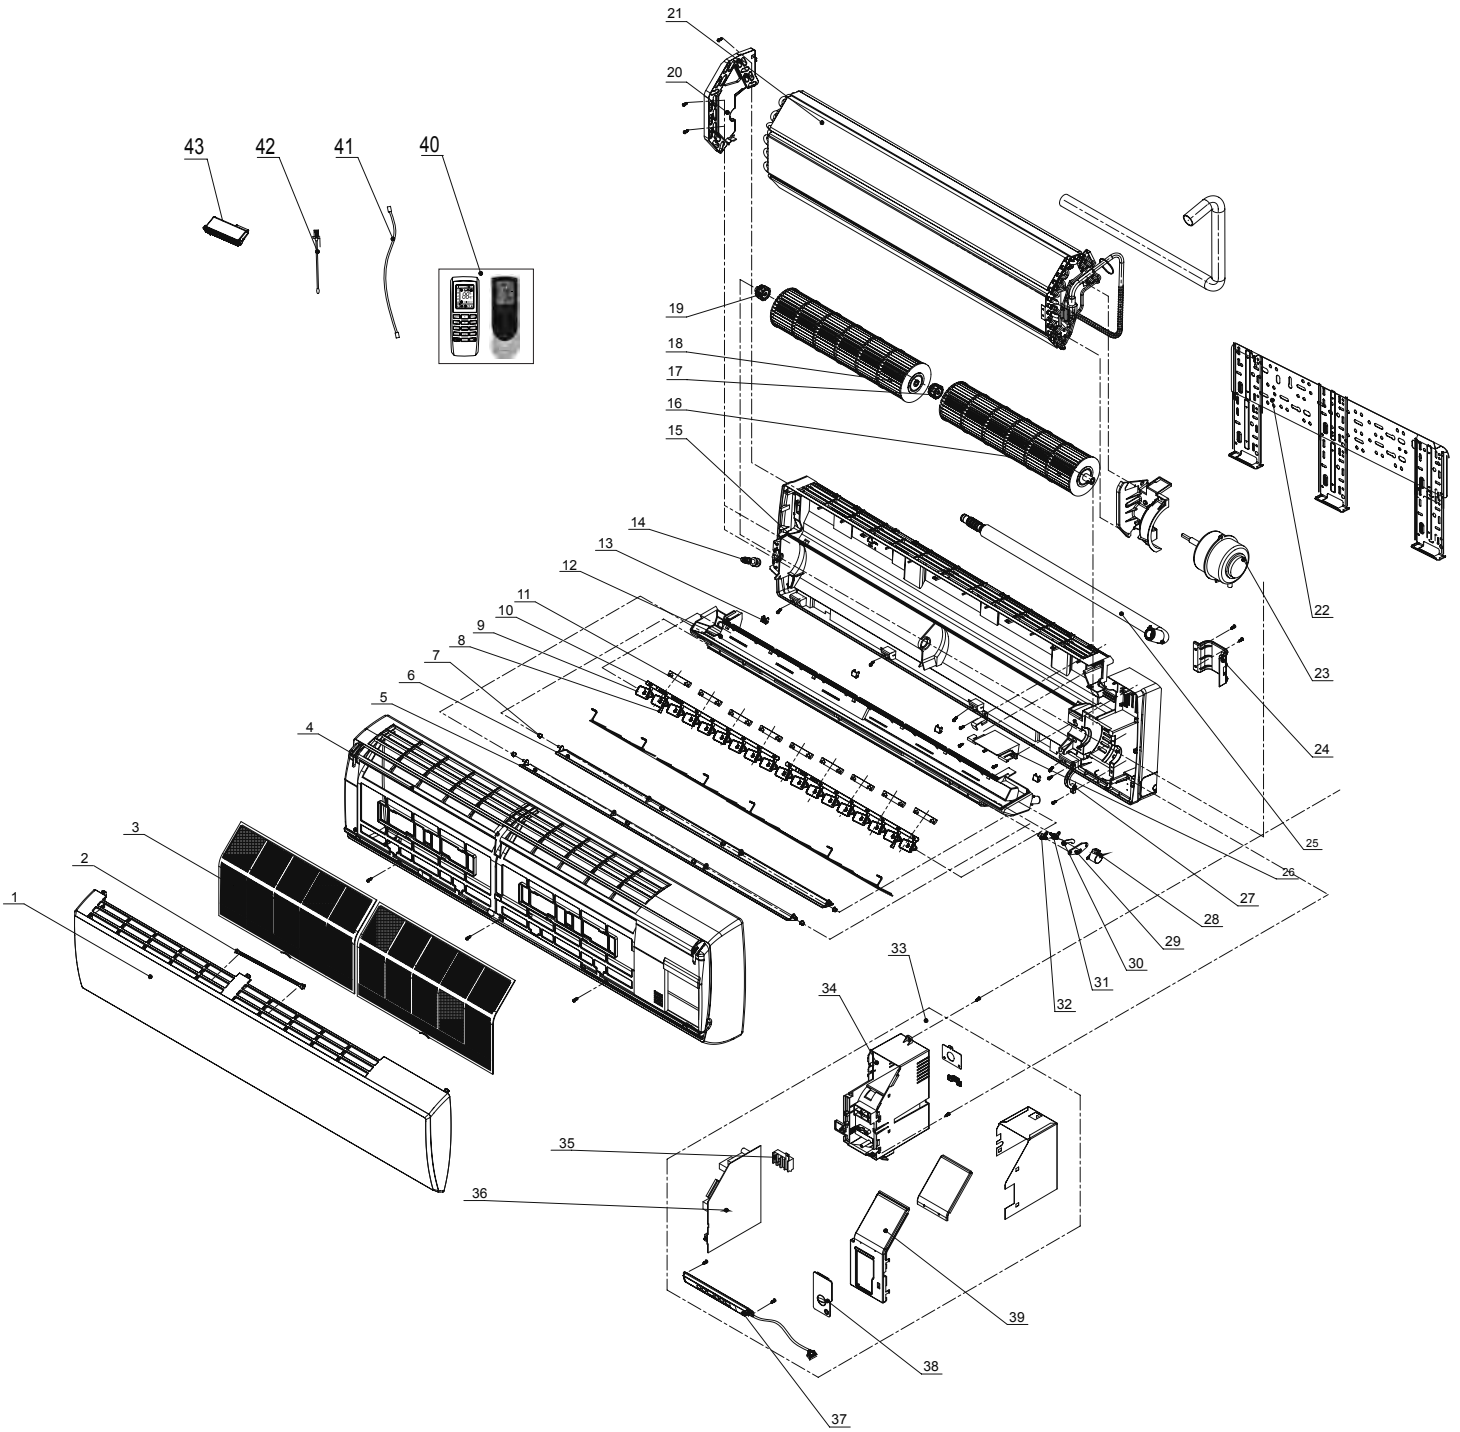


The component picture is only for reference; please refer to the actual product.

NO.	Description	Part Code	Qty
		S-36WPL-HP230	
	Product Code	CB432N10100	
1	Front Panel	20000300022S	1
2	Stand Bar	2421212001	1
3	Filter Sub-Assy	1112210601	2
4	Front Case Sub-assy	20900700005	1
5	Upper Guide Louver	1051216601	1
6	Lower Guide Louver	1051216701	1
7	Axile Bush	10542704	6
8	Air Louver 2	1051216902	2
9	Air Louver 1	1051216802	16
10	Connecting Rod	10582086	2
11	Louver Clamp	26112158	9
12	Water Tray	2018213802	1
13	Screw Cover	2425200506	4
14	Rubber Plug (Water Tray)	76712012	1
15	Rear Case assy	00000100113	1
16	Cross Flow Fan 1	10352039	1
17	Bearing Holder Sub-assy	26152028	1
18	Cross Flow Fan 2	10352040	1
19	O-Gasket sub-assy of Bearing	76512051	1
20	Left Evaporator Support	24212041	1
21	Evaporator Assy	01100100014001	1
22	Wall Mounting Frame	01252398	1
23	Fan Motor	1501213401	1
24	Pipe Clamp	26112071	1
25	Drainage Hose	0523001404	1
26	Cover Plate	2012212402	1
27	Motor Fixed Clip 1	26112324	1
28	SteppingMotor	1521210701	1
29	Press Plate(Crank)	26112070	1
30	Crank-guide	10582041	1
31	Upper Crank	10562004	1
32	Lower crank	10562005	1
33	Electric Box Assy	100002003292	1
34	Electric Box	201022502	1
35	Terminal Board	42011233	1
36	Main Board	30138001017	1
37	Display Board	30565277	1
38	Electric Box Cover	201022523	1
39	Electric Box Cover	2011204404S	1
40	Remote Controller	305001000085	1
41	Temperature Sensor	390000592	1
42	Temperature Sensor	390000453	1
43	Detecting plate(WIFI)	30070077	1

Above data is subject to change without notice.

NO.	Description	Part Code	Qty
		SC-36ZPL-HP230	
	Product Code	CB432N08101	
1	Front Panel	20000300022S	1
2	Stand Bar	2421212001	1
3	Filter Sub-Assy	11122106	2
4	Front Case Sub-assy	20900700005	1
5	Upper Guide Louver	1051216601	1
6	Lower Guide Louver	1051216701	1
7	Axile Bush	10542704	6
8	Air Louver 2	1051216902	2
9	Air Louver 1	1051216802	16
10	Connecting Rod	10582086	2
11	Louver Clamp	26112158	9
12	Water Tray	2018213802	1
13	Screw Cover	2425200506	4
14	Rubber Plug (Water Tray)	76712012	1
15	Rear Case assy	00000100113	1
16	Cross Flow Fan 1	10352039	1
17	Bearing Holder Sub-assy	26152028	1
18	Cross Flow Fan 2	10352040	1
19	O-Gasket sub-assy of Bearing	76512051	1
20	Left Evaporator Support	24212041	1
21	Evaporator Assy	1002000027	1
22	Wall Mounting Frame	1252398	1
23	Fan Motor	1501213401	1
24	Pipe Clamp	26112071	1
25	Drainage Hose	523001404	1
26	Cover Plate	2012212402	1
27	Motor Fixed Clip 1	26112324	1
28	Stepping Motor	1521210701	1
29	Press Plate(Crank)	26112070	1
30	Crank-guide	10582041	1
31	Upper Crank	10562004	1
32	Lower crank	10562005	1
33	Electric Box Assy	100002001022	1
34	Electric Box	201022502	1
35	Terminal Board	42011233	1
36	Main Board	30138001017	1
37	Display Board	30565277	1
38	Electric Box Cover	2011204404S	1
39	Electric Box Cover	2011204404	1
40	Remote Controller	305001000085	1
41	Temperature Sensor	390000592	1
42	Temperature Sensor	390000453	1
43	Detecting plate(WIFI)	30070077	1

Above data is subject to change without notice.

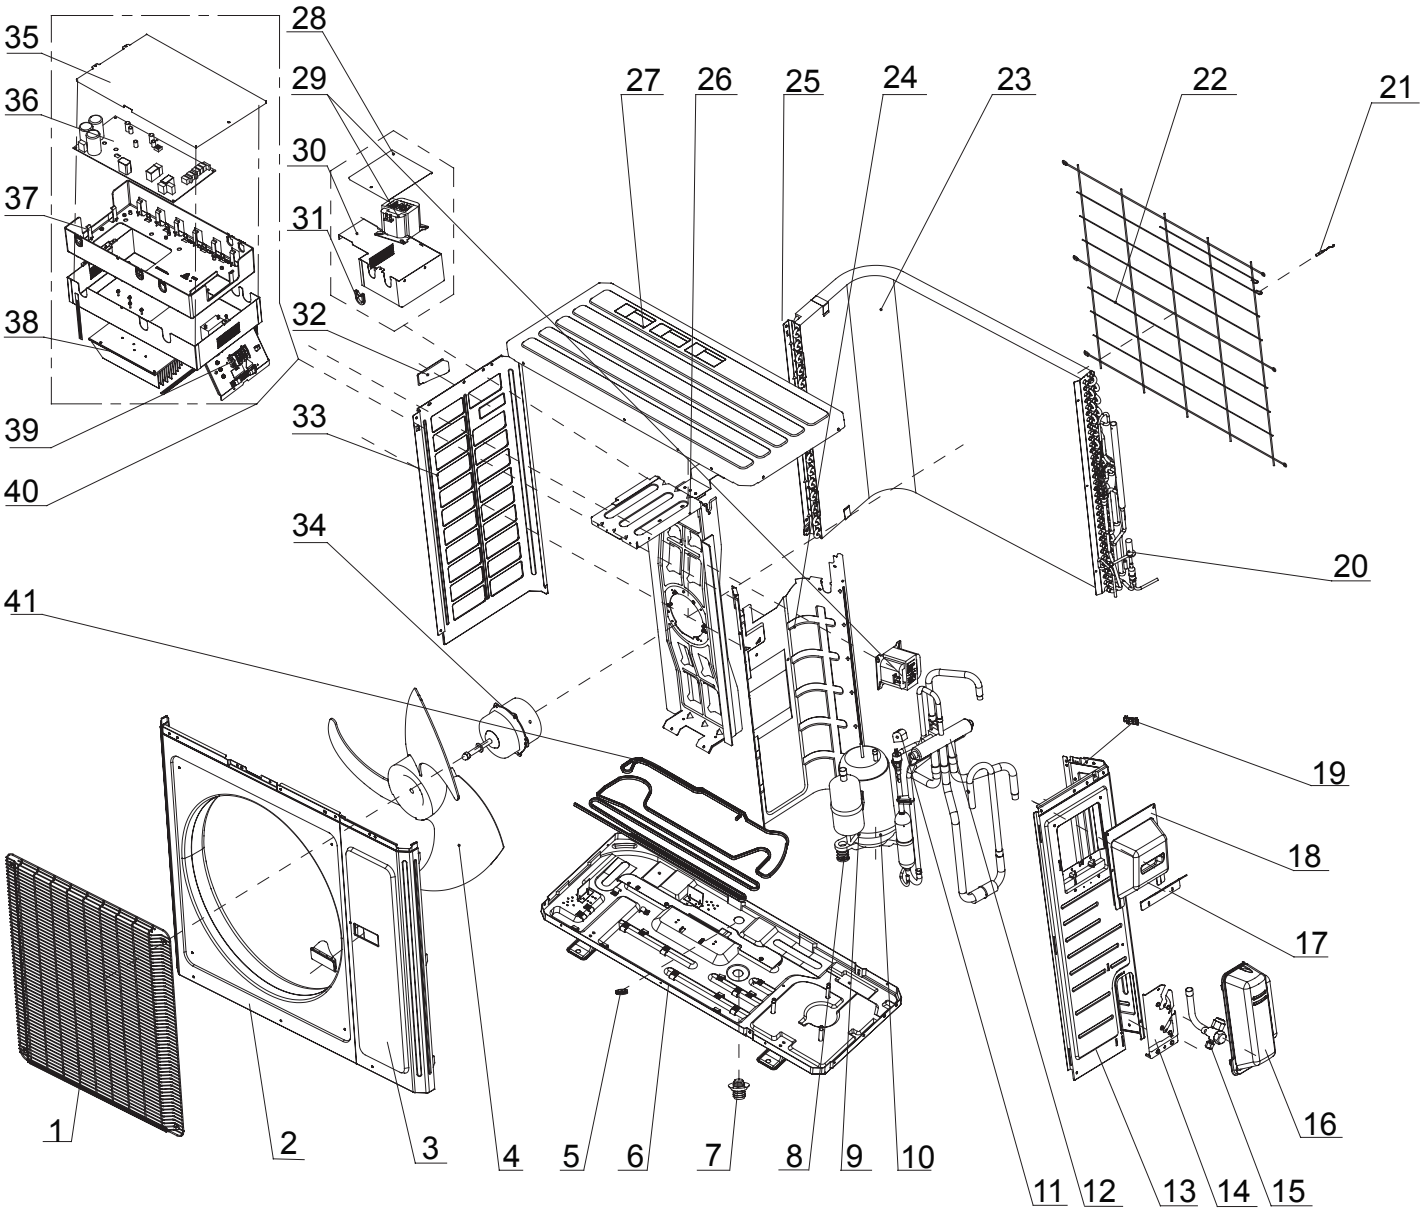


The component picture is only for reference; please refer to the actual product.

NO.	Description	Part Code	Qty
		SC-36ZPL-HP230	
	Product Code	CB432W08100	
1	Front Grill	1473050	1
2	Cabinet	0143500401P	1
3	Front Side Plate	01303249P	1
4	Axial Flow Fan	10335014	1
5	Drainage Plug	7671301802	1
6	Chassis Sub-assy	0280319605	1
7	Drainage Connecter	06123401	1
8	Compressor Gasket	76713066	3
9	Compressor and fitting	205200003	1
10	Electrical heater	7651000413	1
11	Magnet Coil	4300040029	1
12	4-way Valve Assy	30152000213	1
13	Right Side Plate	0130504402P	1
14	Valve Support Sub-Assy	0171501201P	1
15	Cut-off Valve	07130239	1
16	Valve cover	22245003	1
17	Retaining plate	02115006P	1
18	Handle assy	2113109	1
19	Wiring clamp	26115004	1
20	Electronic expansion valve Sub-Assy	07133684	1
21	Temperature Sensor	3900031001	1
22	Rear Grill	01475013	1
23	Condenser Assy	01163491	1
24	Clapboard	01233134	1
25	Condenser support plate	01175037	1
26	Motor Support Sub-Assy	01802876	1
27	Top Cover Sub-Assy	1255007	1
28	Electric Box Cover	01425281	1
29	Reactor	43130192	2
30	Electric Box Sub-Assy	02603620	1
31	Pass wire ring sub-assy	76614102	2
32	left handle	2113031	1
33	Left Side Plate	01305043P	1
34	Fan Motor	1570280000405	1
35	Electric Box Cover	01425281	1
36	Main Board	300027000216	1
37	Electric Box	02603614	1
38	Radiator	49010252	1
39	Terminal Board	42200006001401	1
40	Electric Box Assy	100002001028	1
41	Electrical Heater (Chassis)	7651000413	1

Above data is subject to change without notice.

NO.	Description	Part Code		Qty
		VIR36HP230V1BO	LIVV36HP230V1AO	
	Product Code	CB171W10800	CB432W23000	
1	Front Grill	01473050	016004060005	1
2	Cabinet	0143500401P	0143500401P	1
3	Front Side Plate	01303249P	01303249P	1
4	Axial Flow Fan	10335014	10335014	1
5	Drainage Plug	7671301802	/	1
6	Chassis Sub-assy	02803026P	017000060476	1
7	Drainage Connecter	06123401	/	1
8	Compressor Gasket	76710207	009012000004	3
9	Compressor and fitting	00205275	00900100019501	1
10	Electrical heater	7651873209	/	1
11	Magnet Coil	4300040029	4300040045	1
12	4-way Valve Assy	03123890	030152000329	1
13	Right Side Plate	0130504402P	0130504402P	1
14	Valve Support Sub-Assy	0171501201P	0171501201P	1
15	Cut-off Valve	07133157	07133157	1
16	Valve cover	22245003	22245003	1
17	Retaining plate	02115006P	02115006P	1
18	Handle assy	02113109	02113109	1
19	Wiring clamp	26115004	26115004	1
20	Electronic expansion valve Sub-Assy	07133684	030174060043	1
21	Temperature Sensor	3900031001	3900030901	1
22	Rear Grill	01475013	01475013	1
23	Condenser Assy	01163491	011002061052	1
24	Clapboard	01233134	01175092	1
25	Condenser support plate	01175037	01175092	1
26	Motor Support Sub-Assy	01802876	017012000017	1
27	Top Cover Sub-Assy	01255007	000051060049	1
28	Electric Box Cover	01425281	20125002	1
29	Reactor	43130192	/	2
30	Electric Box Sub-Assy	02603620	100002068354	1
31	Pass wire ring sub-assy	76614102	/	2
32	left handle	02113031	02113031	1
33	Left Side Plate	01305043P	01305043	1
34	Fan Motor	1570280000405	15010400000102	1
35	Electric Box Cover	01425281	20125002	1
36	Main Board	30138000711	300027060993	1
37	Electric Box	02603614	20115003	1
38	Radiator	49010252	4901521502	1
39	Terminal Board	42200006001401	42200006001401	1
40	Electric Box Assy	10000100328	100002068354	1
41	Electrical Heater (Chassis)	7651000413	/	1

Above data is subject to change without notice.

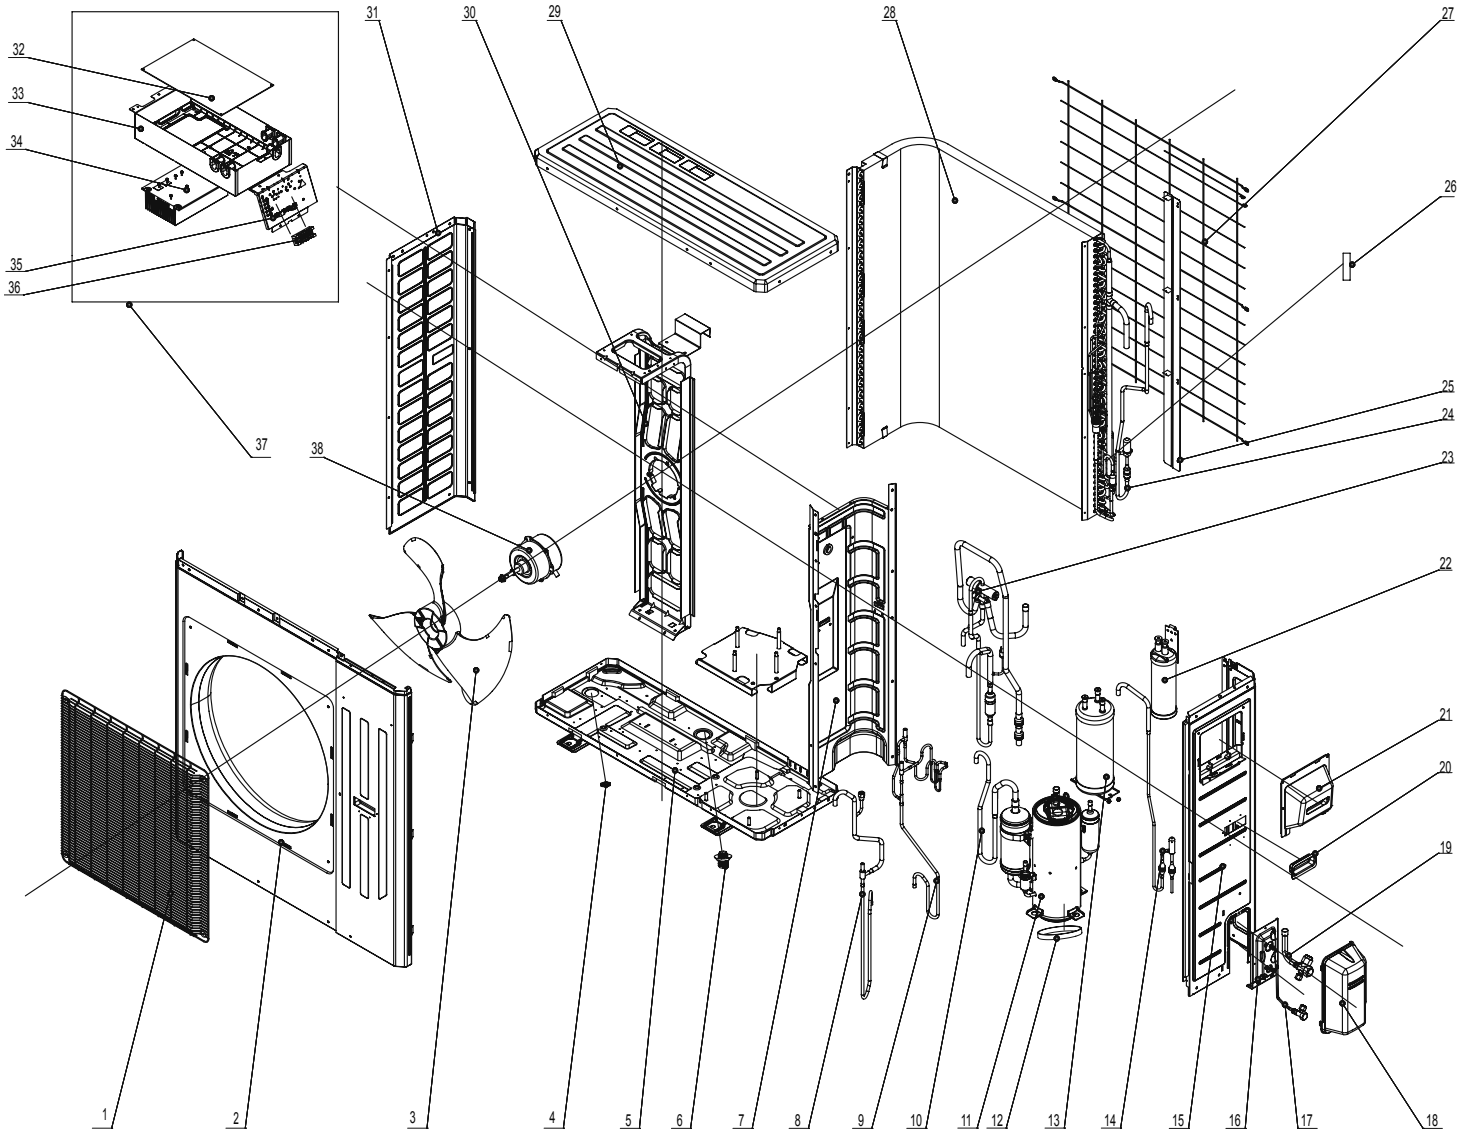

The component picture is only for reference; please refer to the actual product.





NO.	Description	Part Code	Qty
		SC-36ZPL-HP230	
	Product Code	CB432W10100	
1	Front Grill	01574106	1
2	Cabinet	01435007P	1
3	Axial Flow Fan	10335014	1
4	Drainage hole Cap	76715005	1
5	Electrical Heater (Chassis)	7651000413	1
6	Drainage Joint	26113009	1
7	Clapboard Sub-Assy	0124525304	1
8	Magnet Valve Sub-assy	030025000055	1
9	Magnet Valve Sub-assy	030025000056	1
10	Inhalation Tube Sub-assy	030010000570	1
11	Compressor and Fittings	00204100030	1
12	Electrical Heater(Compressor)	7651873209	1
13	Accumulator	07424100031	1
14	Electronic Expansion Valve assy B	030174000139	1
15	Right side plate	017038000055	1
16	Valve Support Sub-Assy	01805200222P	1
17	Cut off Valve Sub-Assy	030057000153	1
18	Valve Cover	22245005	1
19	Cut off Valve	07133157	1
20	Handle	2623305301	1
21	Handle Assy	02113109	1
22	Gas-liquid Separator	07223048	1
23	4-Way Valve Assy	030152000370	1
24	Baffle Plate Sub-ass	01355200016P	1
25	Electronic Expansion Valve assy A	030174000138	1
26	Temperature Sensor	3900007201	1
27	Rear Grill	01475012	1
28	Condenser Assy	011002000628	1
29	Top Cover	0125500901P	1
30	Motor Support Sub-Assy	017012000155	1
31	Left Side Plate	01305064P	1
32	Main Board	300027000042	1
33	Electric Box Sub-Assy	017007000632	1
34	Radiator	43003400001601	1
35	Terminal Board Support sub-assy	01715016	1
36	Terminal Board	42000100000402	1
37	Electric Box Assy	100002003294	1
38	Brushless DC Motor	15010400000106	1





Above data is subject to change without notice.






11. Removal Procedure





Warning: Be sure to wait for a minimum of 20 minutes after turning off all power supplies and discharge the refrigerant completely before removal.





11.1 Removal Procedure of Indoor Unit

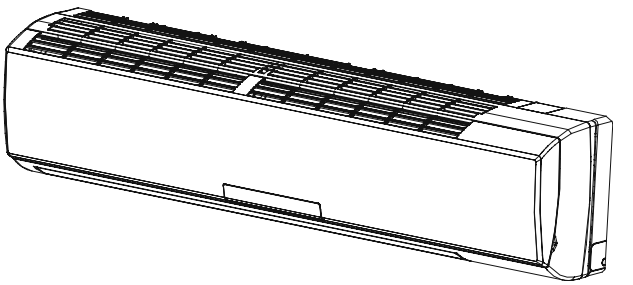
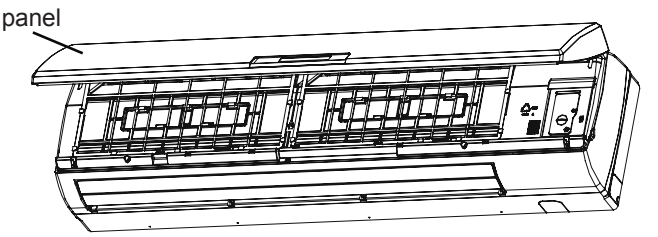
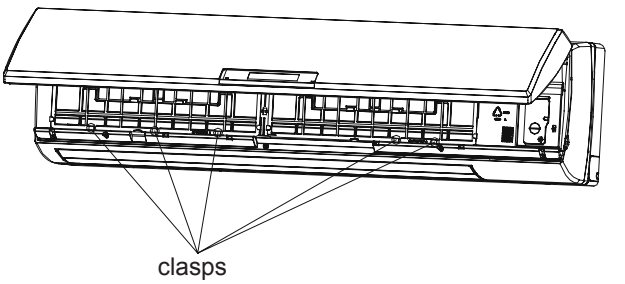
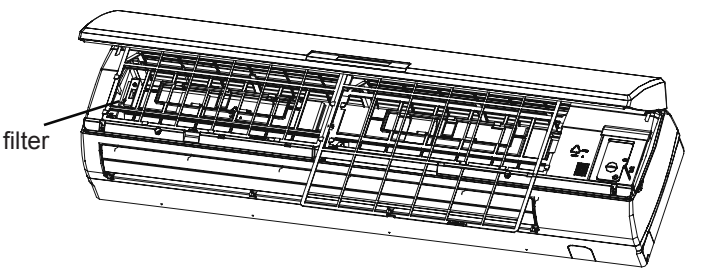
Steps	Procedure	
1.Before disassembly of the unit		
	Axonometric drawing for the complete unit.	
2.Remove filter		
a	Open the panel.	
b	Loosen the clasps on the filter.	
c	Draw out two pieces of filter.	

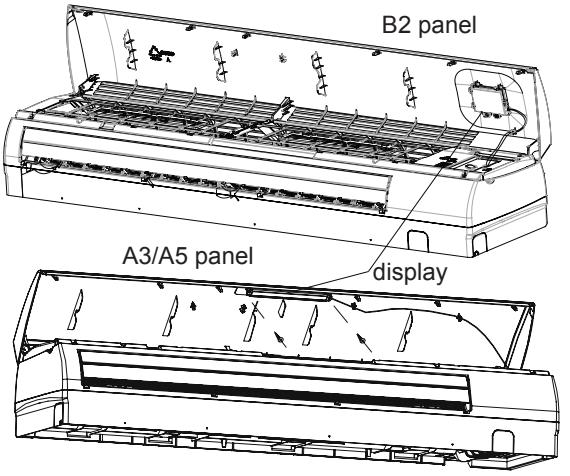
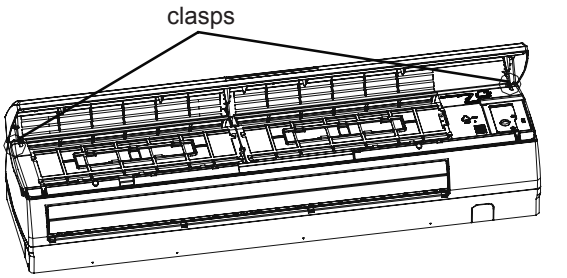
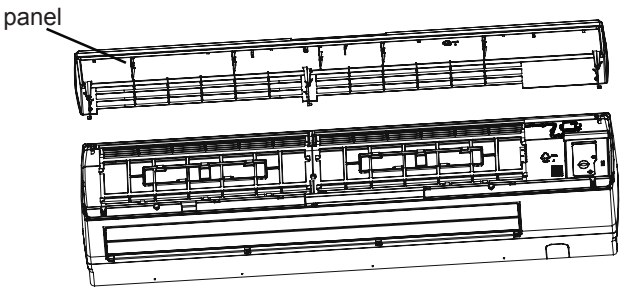
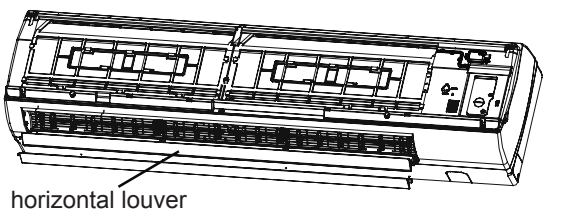
Steps	Procedure	
	3.Remove display	
	Remove screws fixing display, and then remove the display.	
	4.Remove panel	
	Pull the clasps at both sides slightly, and then remove the panel.	
	5.Remove horizontal louver	
	Remove the axial bush on the horizontal louver, and then remove the horizontal louver.	

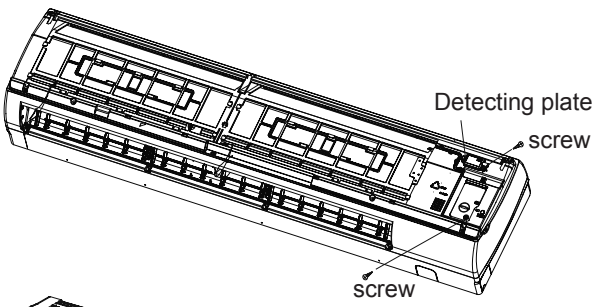
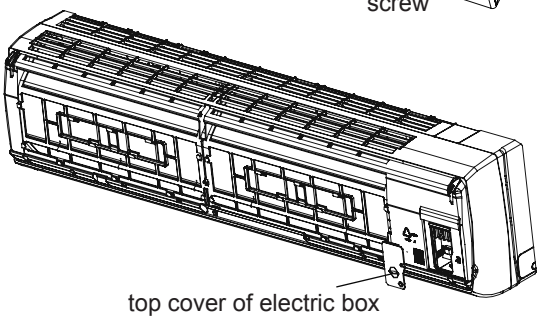
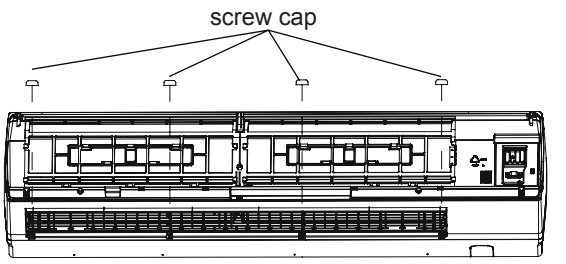
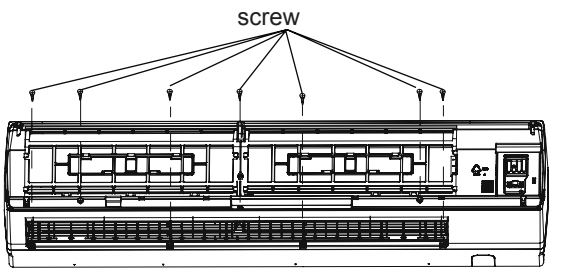
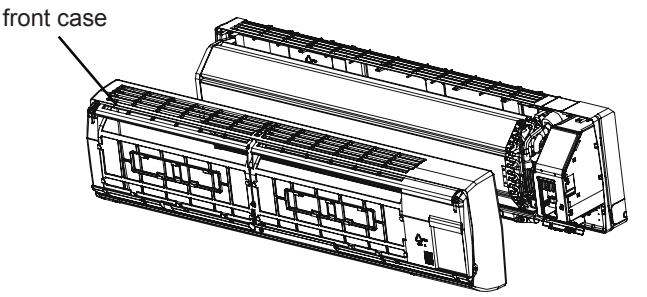
Steps	Procedure	
6.Remove detecting plate and top cover of electric box		
a	Remove the screw fixing detecting plate and then remove the detecting plate. Note:The position of detection board(WIFI) may be different for -different models.	
b	Remove screws fixing the top cover of electric box. Remove the top cover of electric box.	
7.Remove front case		
a	Remove the screw caps on front case.	
b	Remove screws connecting the front case.	
c	Remove the front case.	

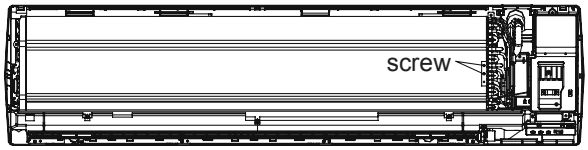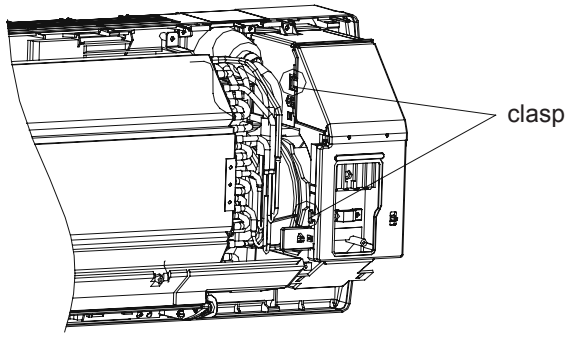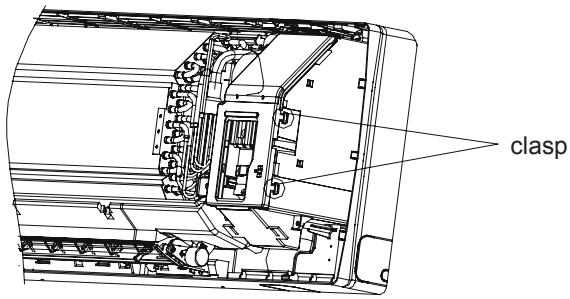
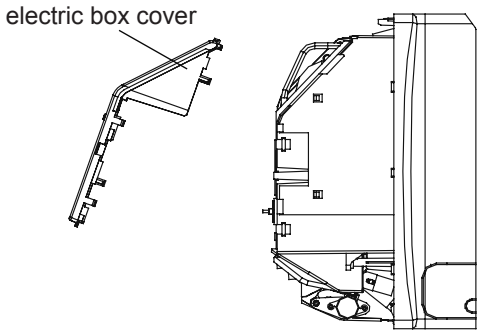
Steps	Procedure	
8.Remove earthing wire		
	Remove earthing screws, and then remove the earthing wire.	
9.Remove electric box cover		
a	Loosen clasps at the left side of electric box.	
b	Loosen clasps on the right side of electric box.	
b	Remove electric box cover.	

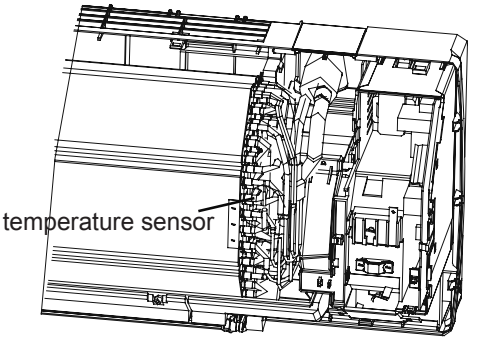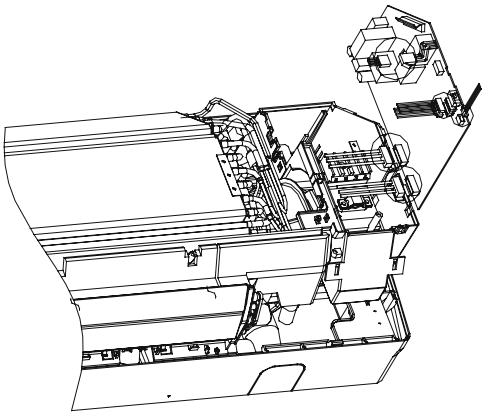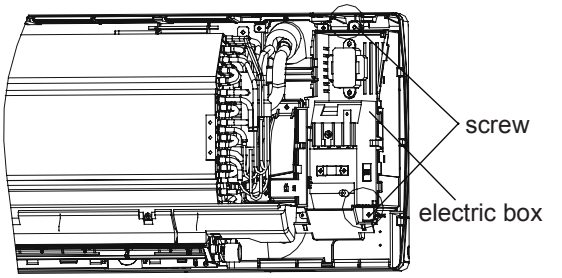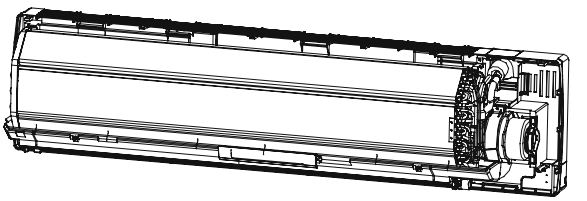Steps	Procedure	
10.Remove temperature sensor		
	Pull out the indoor temperature sensor.	
11.Remove electric box		
a	Pull out 6 sockets on PCB board.	
b	Pull out two screws on electric box.	
c	Remove the electric box.	

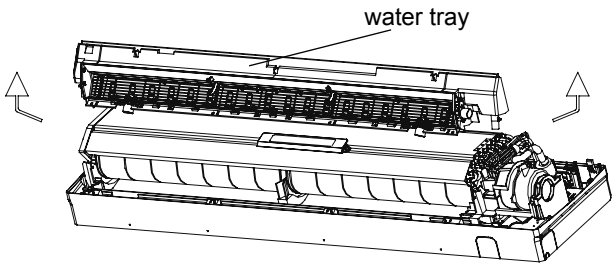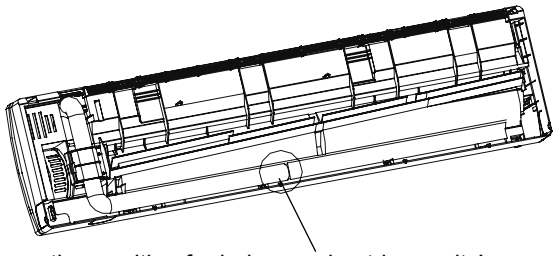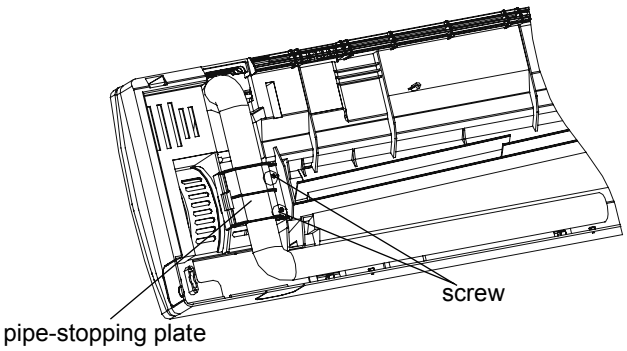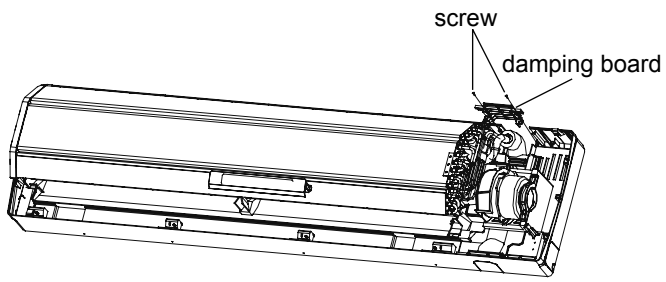Steps	Procedure
12.Remove water tray	
	Pull the water tray upwards, and then remove the water tray.
	
13.Remove connection pipe between indoor and outdoor units	
	Separate the connection pipe between indoor and outdoor units.
	
14.Remove pipe-stopping plate	
	Remove two screws on pipe-stopping plate for indoor unit, and then remove the pipe-stopping plate.
	
15.Remove damping board	
	Remove 2 screws on damping board, and then remove the damping board.
	

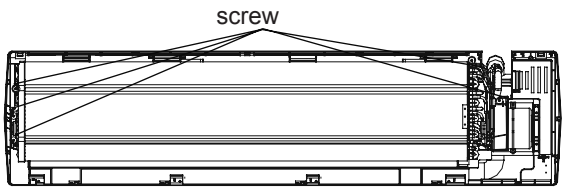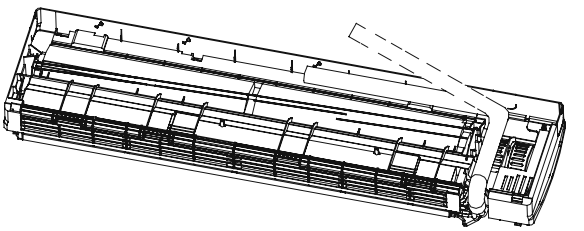
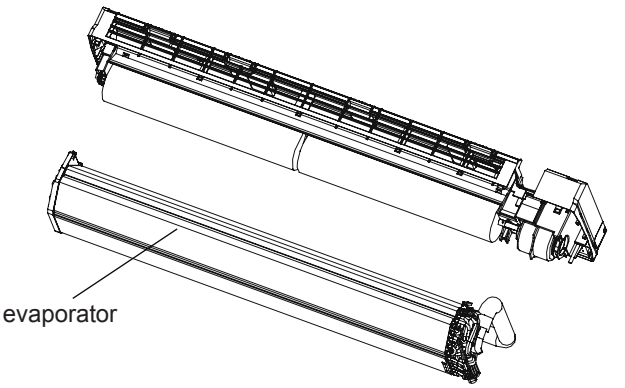
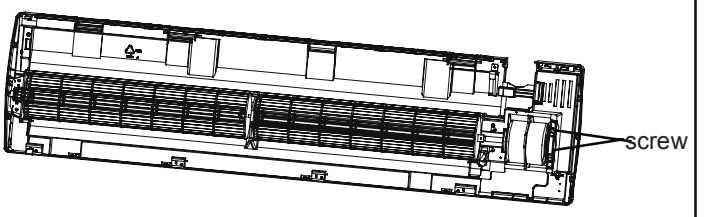
Steps	Procedure	
16.Remove evaporator		
a	Remove screws between evaporator and bottom case.	
b	Turn over the indoor unit and adjust the pipe line to the position as shown by the broken line.	
c	Lift up the evaporator, and then remove the evaporator.	
17.Remove the fixing plate of motor		
	Remove 2 screws on fixing plate of motor, and then remove the fixing pate of motor.	

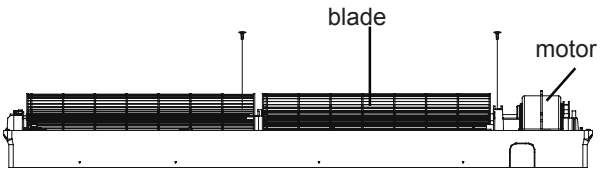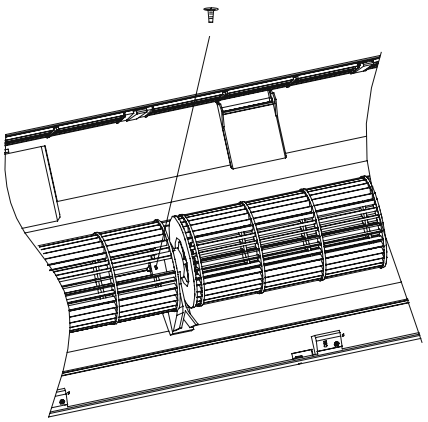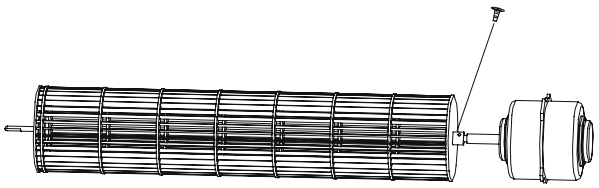
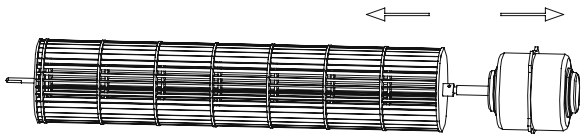
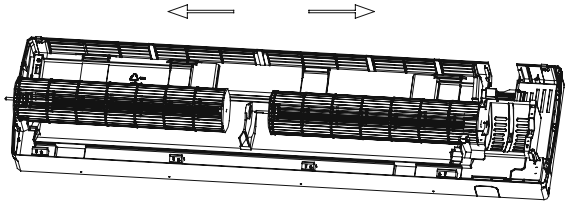
Steps	Procedure	
18.Remove cross flow blade and motor		
a	Remove screws fixing cross flow blade and motor.	
		
		
b	Remove the motor sub-assy.	
c	Separate two cross flow blade.	

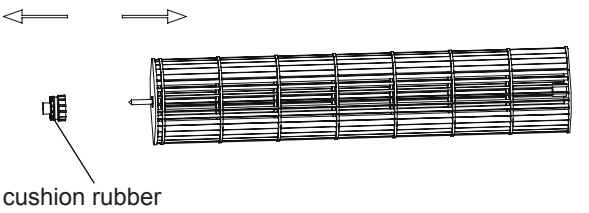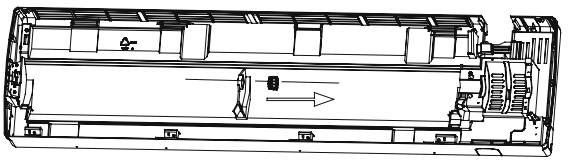Steps	Procedure	
19.Remove cushion rubber		
a	Remove the cushion rubber on cross flow blade.	
b	Remove the cushion rubber from the base.	


11.2 Removal Procedure of Outdoor Unit


Note: Take heat pump unit for example.

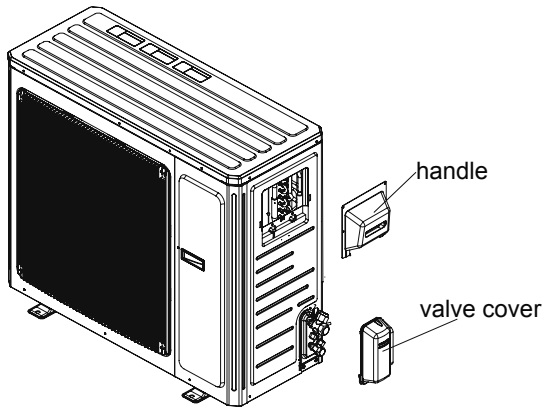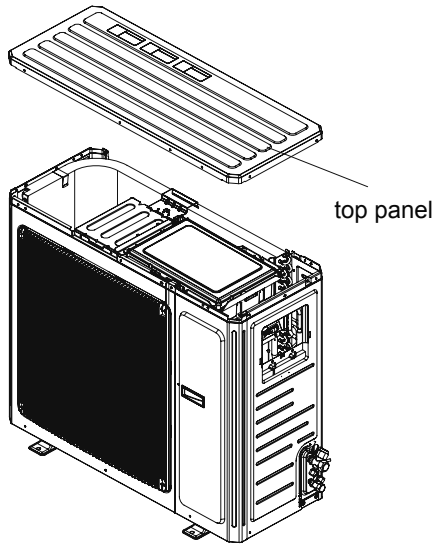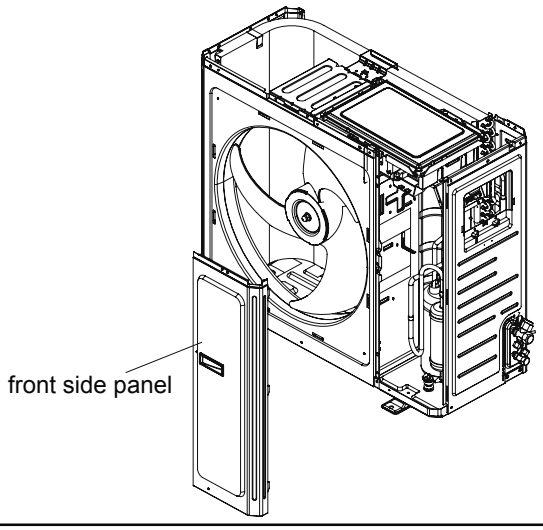
Steps	Procedure
1. Remove big handle,valve cover and top cover	
	Remove the screw connecting the big handle and right side plate, and then remove the big handle. Remove the screw connecting the valve cover and right side plate, and then remove the valve cover.
	
2.Remove top panel	
	Remove the screws connecting the top panel with the front panel and left&right side plate, and then remove the top panel.
	
3.Remove front side panel	
	Loosen the screws connecting the front side panel and chassis. Remove the front side panel.
	

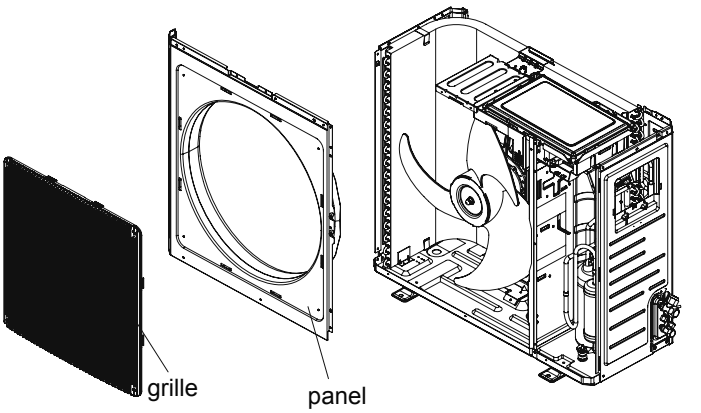
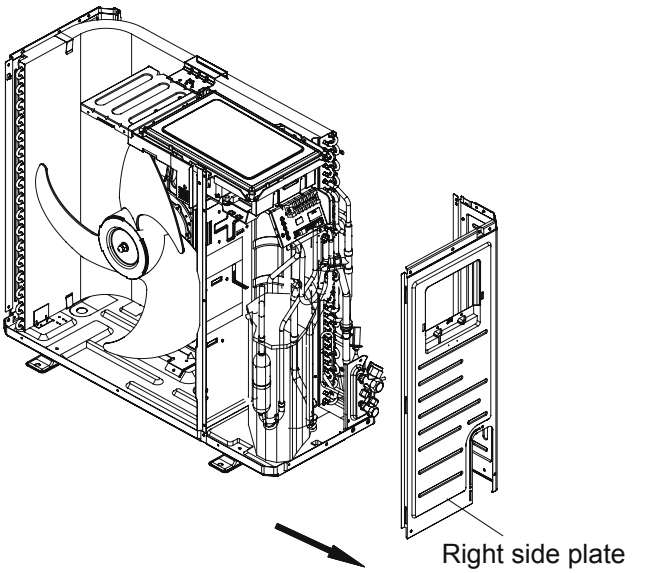
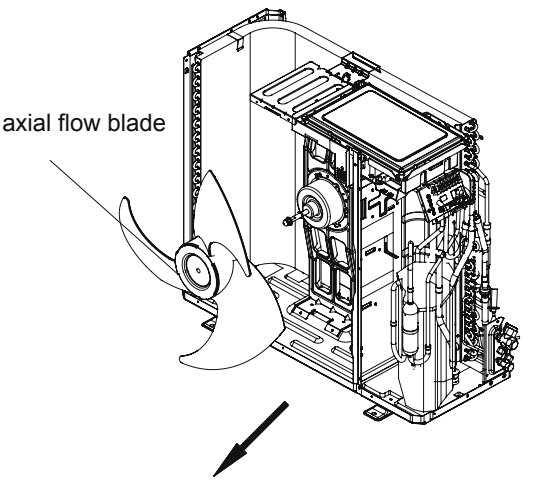
Steps	Procedure
4.Remove grille and panel	
Twist off the screws connecting the grille and panel, and then remove the grille. Twist off the screws connecting the panel, chassis and motor support with screwd-river, and then remove the panel.	
5.Remove right side plate	
Twist off the screws connecting the right side plate and chassis, valve support and condenser, and then remove the right side plate.	
6.Remove axial flow blade	
Twist off the nuts on blade with wrench and then remove the axial flow blade.	




Steps	Procedure
7.Remove electric box	
	Twist off the screws on electric box, cut off the tieline with scissors or pliers, pull out the wiring terminal, pull it upwards to remove the electric box.
	Twist off the screws on electric box (fireproofing) with screwdriver, and then remove the electric box (fireproofing).
8.Remove motor	
	Twist off the tapping screws fixing the motor, pull out the pin of leading wire for motor and then remove the motor.


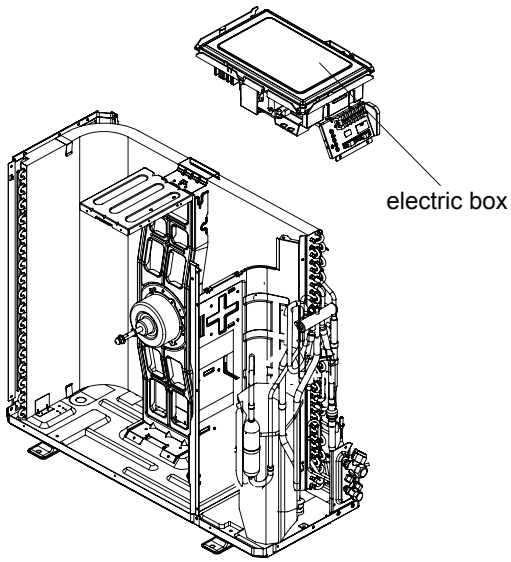


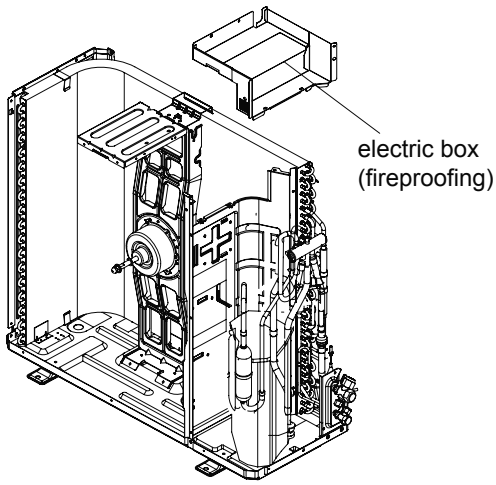

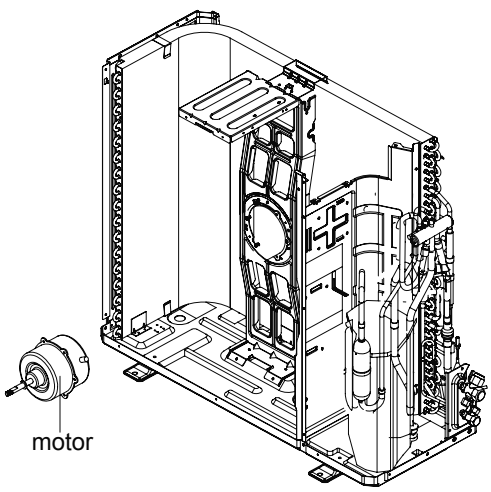


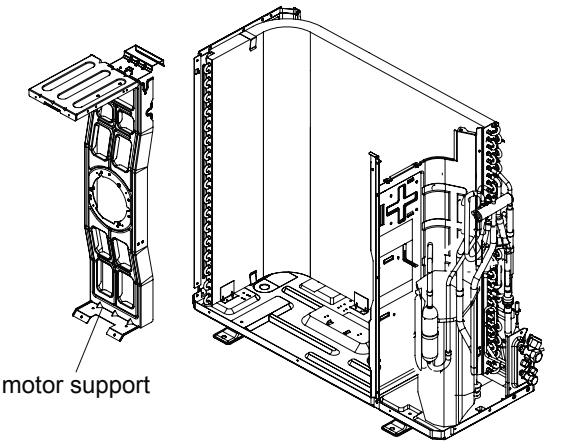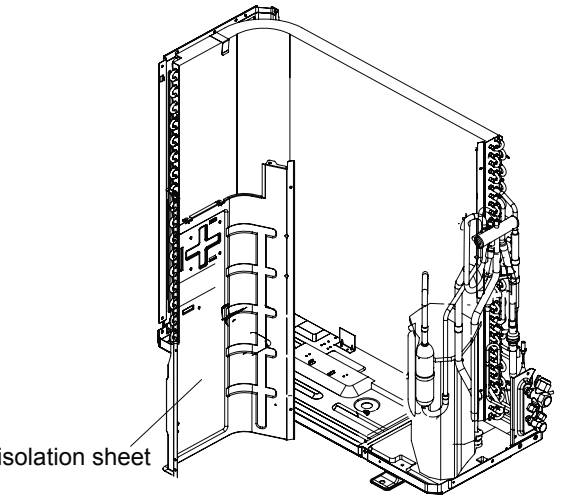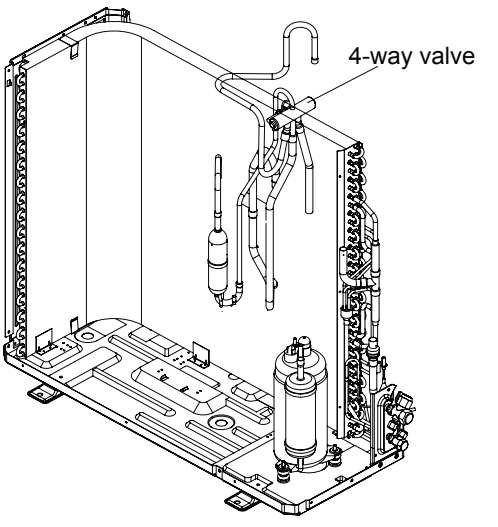
Steps	Procedure
9.Remove motor support	
	Twist off the tapping screws fixingthe motor support, pull it upwardsand then remove the motor support.
	
10.Remove isolation sheet	
	Twist off the screws connecting isolation sheet and end plate of condenser and chassis, and then remove the isolation sheet.
	
11.Remove 4-way valve	
	Unsolder the pipeline between compressor, condenser, gas and liquid valve, and then remove the 4-way valve. (note: release all refrigerant before unsoldering).
	

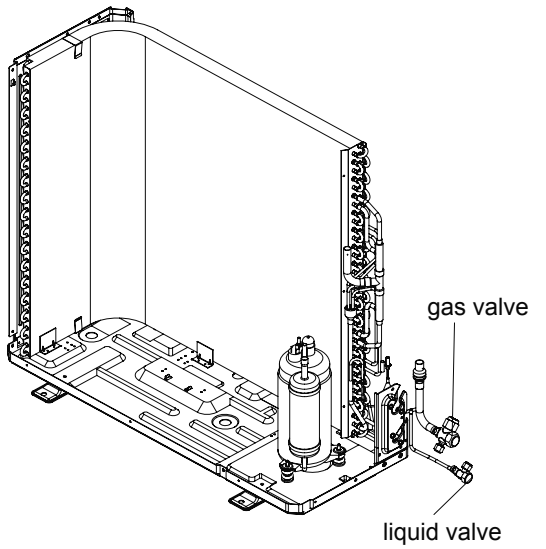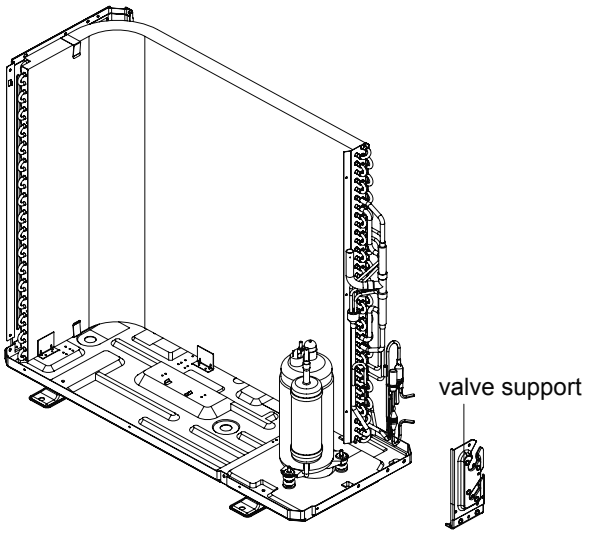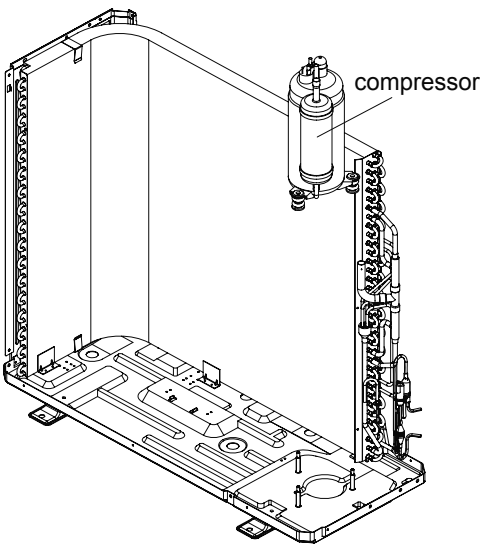
Steps	Procedure
12.Remove gas valve and liquid valve	
Twist off the 2 bolts fixing the valve sub-assy. Unsolder the soldering joint between gas valve and air-return pipe and then remove the gas valve.(note: when unsoldering the soldering joint, wrap the gas valve with wet cloth completely to avoid the damage to valve, and release all refrigerant completely at first). Unsolder the soldering joint between liquid valve and connection pipe of liquid valve, and then remove the liquid valve.	
13.Remove valve support	
Twist off the screws connecting valve support and chassis, and then remove the valve support.	
14.Remove compressor	
Twist off the 3 foot nuts on compressor and then remove the compressor.	

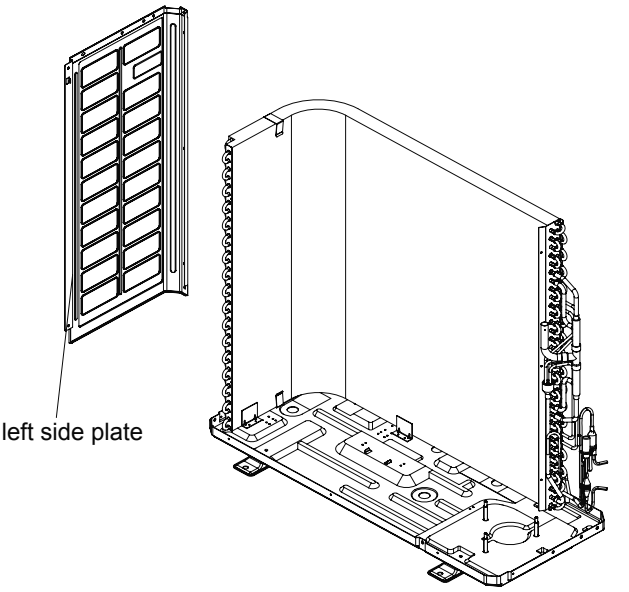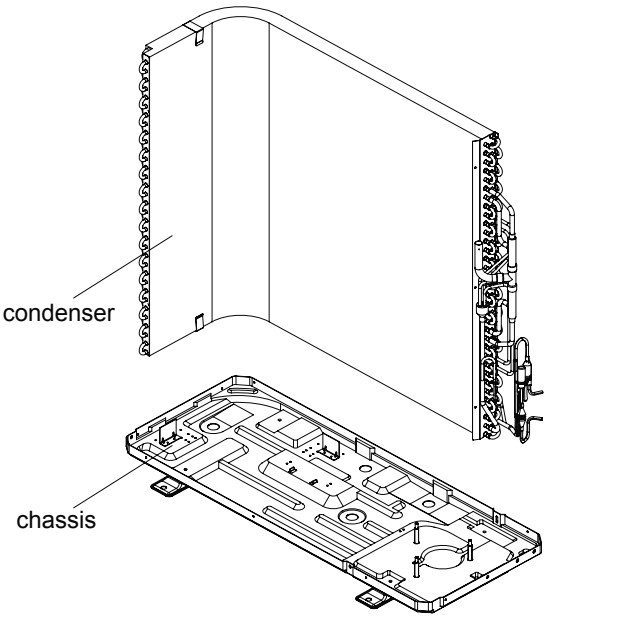Steps	Procedure
15.Remove left side plate	
Twist off the screws connecting the left side plate and chassis with screwdriver, and then remove the left side plate.	
16.Remove chassis and condenser	
Pull it upwards to separate the chassis and condenser.	


Steps	Procedure
1. Remove big handle,valve cover and top cover	
	Remove the screw connecting the big handle and right side plate, and then remove the big handle. Remove the screw connecting the valve cover and right side plate, and then remove the valve cover.
2.Remove top panel	
	Remove the screws connecting the top panel with the front panel and left&right side plate, and then remove the top panel.
3.Remove front side panel	
	Loosen the screws connecting the front side panel and chassis. Remove the front side panel.

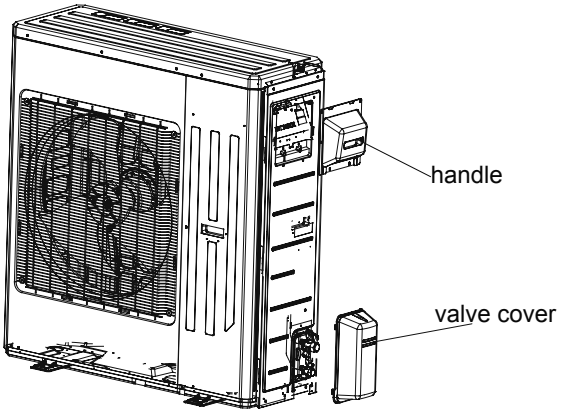


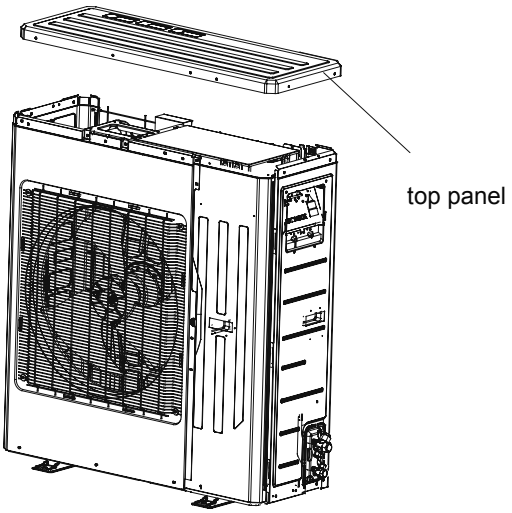




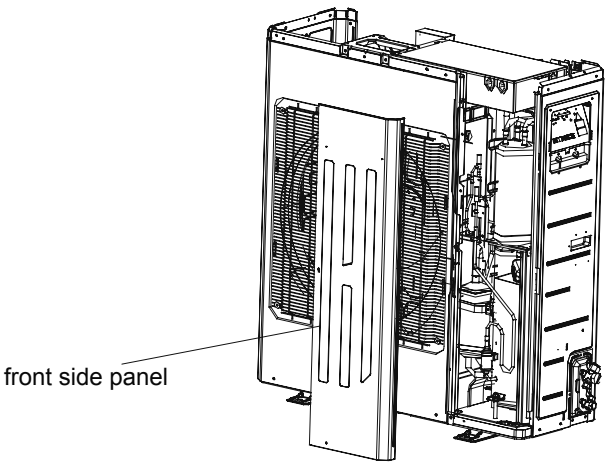





Steps	Procedure
4.Remove grille and panel	
	Twist off the screws connecting the grille and panel, and then remove the grille. Twist off the screws connecting the panel, chassis and motor support with screwd-river, and then remove the panel.
5.Remove right side plate and axial flow blade	
	Twist off the screws connecting the right side plate and chassis, valve support and condenser, and then remove the right side plate. Twist off the nuts on blade with wrench and then remove the axial flow blade.
6.Remove electric box	
	Twist off the screws on electric box, cut off the tieline with scissors or pliers, pull out the wiring terminal, pull it upwards to remove the electric box.



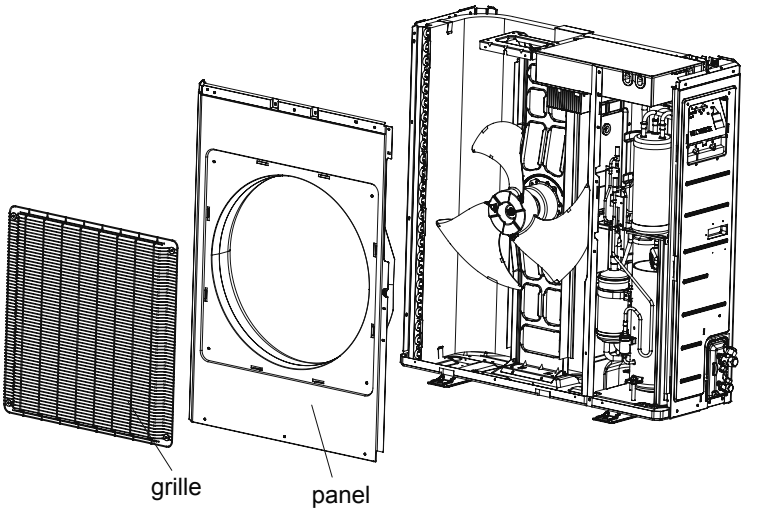


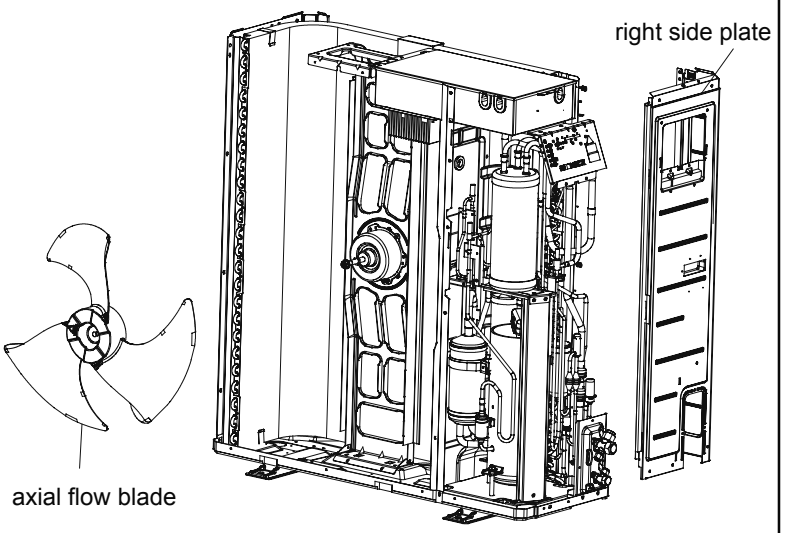

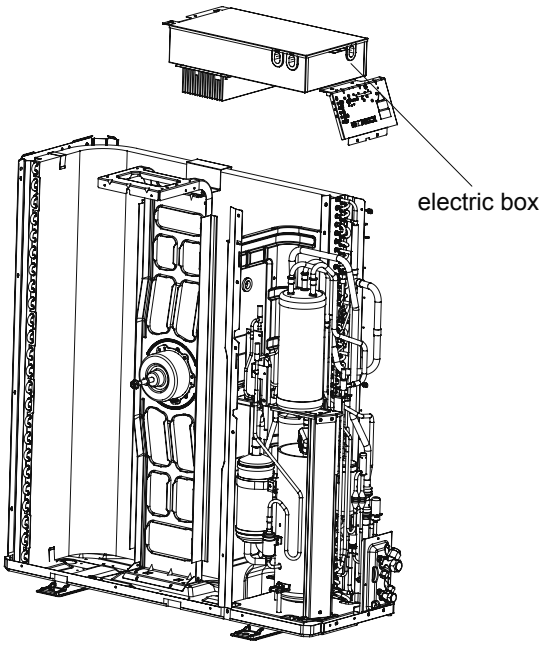

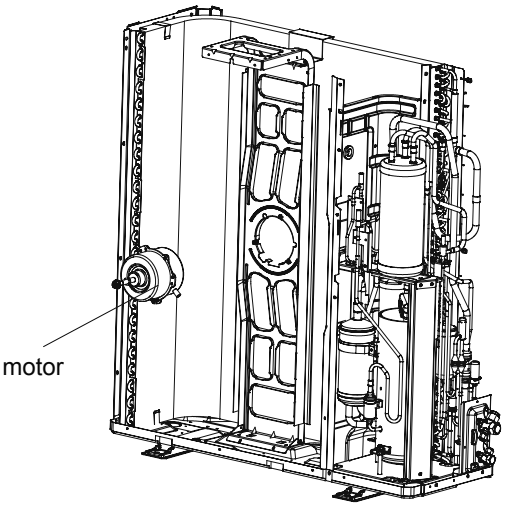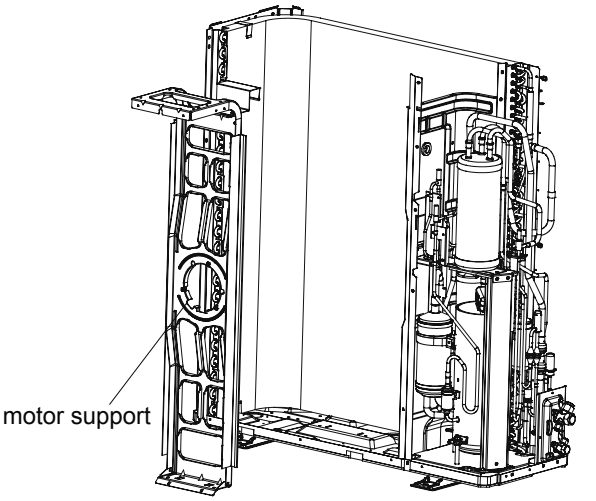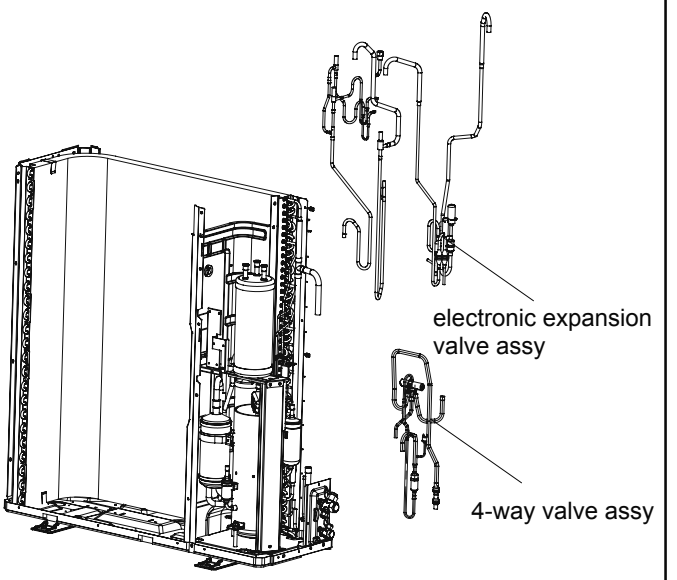Steps	Procedure
8.Remove motor	
Twist off the tapping screws fixing the motor, pull out the pin of leading wire for motor and then remove the motor.	
9.Remove motor support	
Twist off the tapping screws fixingthe motor support, pull it upwardsand then remove the motor support.	
10.Remove 4-way valve assy and electronic expansion valve assy	
Unsolder the spot weld of 4-way valve assy, electronic expansion, compressor and condenser, and then remove the 4-way valve assy and electronic expansion sub-assy. Note: When unsoldering the spot weld, wrap the 4-way valve with wet cloth completely to avoid damaging the valve due to high temperature.	

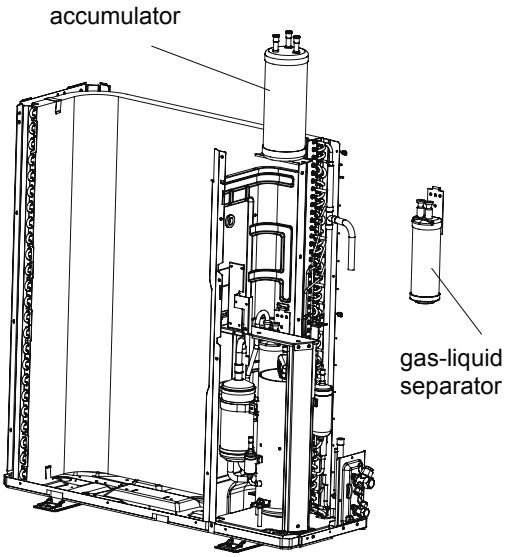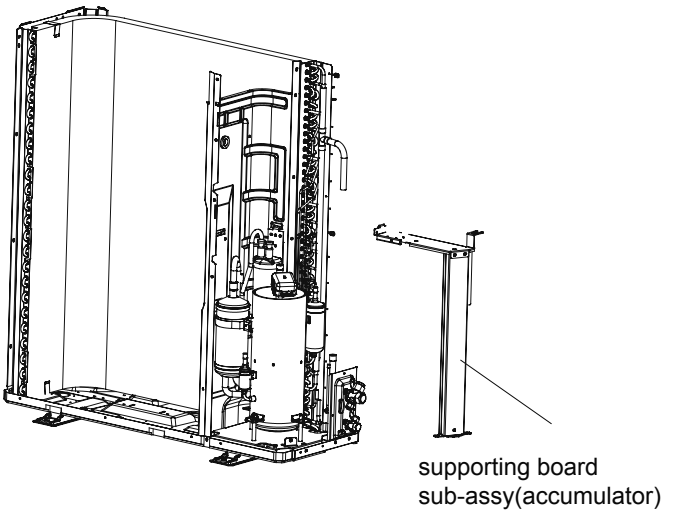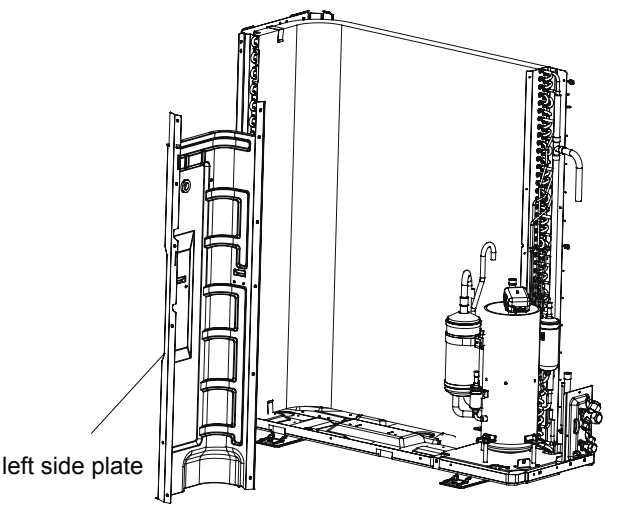Steps	Procedure
11.Remove accumulator and gas-liquid separator	
Twist off the screws connecting accumulator and gas-liquid separator, and then remove the accumulator and gas-liquid separator.	
12.Remove supporting board sub-assy(accumulator)	
Twist off the screws connecting supporting board sub-assy(accumulator) and then remove the supporting board sub-assy(accumulator).	
13.Remove left side plate	
Twist off the screws connecting the left side plate and chassis with screwdriver, and then remove the left side plate.	

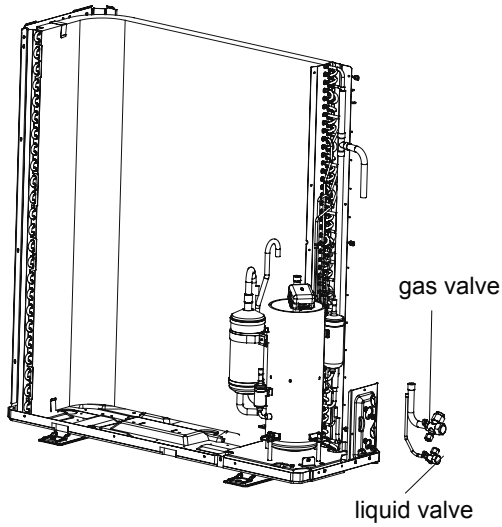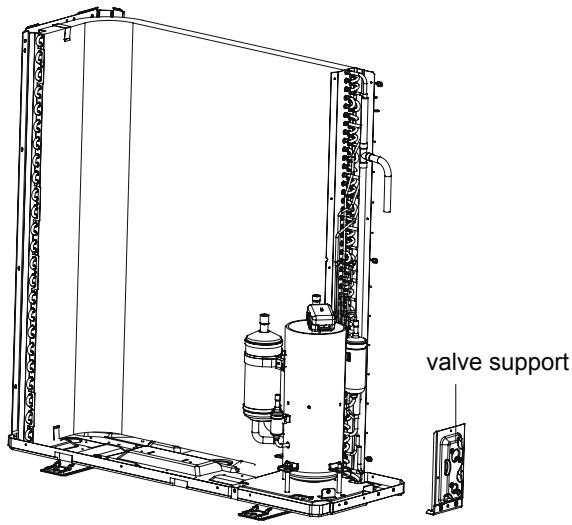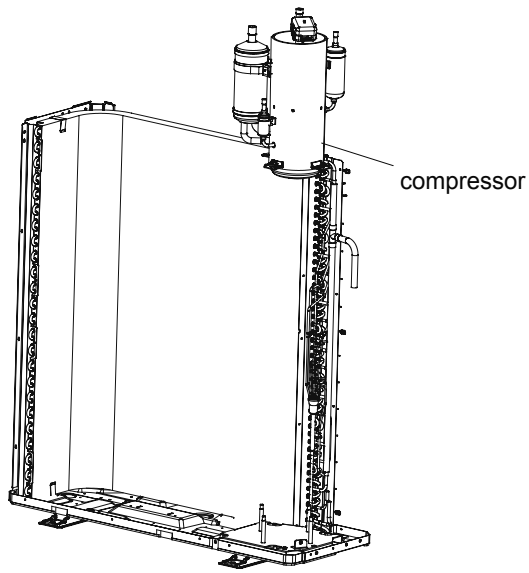Steps	Procedure	
14.Remove gas valve and liquid valve		
	Twist off the 2 bolts fixing the valve sub-assy. Unsolder the soldering joint between gas valve and air-return pipe and then remove the gas valve.(note: when unsoldering the soldering joint, wrap the gas valve with wet cloth completely to avoid the damage to valve, and release all refrigerant completely at first). Unsolder the soldering joint between liquid valve and connection pipe of liquid valve, and then remove the liquid valve.	
15.Remove valve support		
	Twist off the screws connecting valve support and chassis, and then remove the valve support.	
16.Remove compressor		
	Twist off the 3 foot nuts on compressor and then remove the compressor.	

Appendix:

Appendix 1: Reference Sheet of Celsius and Fahrenheit

Conversion formula for Fahrenheit degree and Celsius degree: Tf=Tcx1.8+32

Set temperature

Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)		Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)		Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)
61	60.8	16		69/70	69.8	21		78/79	78.8	26
62/63	62.6	17		71/72	71.6	22		80/81	80.6	27
64/65	64.4	18		73/74	73.4	23		82/83	82.4	28
66/67	66.2	19		75/76	75.2	24		84/85	84.2	29
68	68	20		77	77	25		86	86	30

Ambient temperature

Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)		Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)		Fahrenheit display temperature (℉)	Fahrenheit (℉)	Celsius (℃)
32/33	32	0		55/56	55.4	13		79/80	78.8	26
34/35	33.8	1		57/58	57.2	14		81	80.6	27
36	35.6	2		59/60	59	15		82/83	82.4	28
37/38	37.4	3		61/62	60.8	16		84/85	84.2	29
39/40	39.2	4		63	62.6	17		86/87	86	30
41/42	41	5		64/65	64.4	18		88/89	87.8	31
43/44	42.8	6		66/67	66.2	19		90	89.6	32
45	44.6	7		68/69	68	20		91/92	91.4	33
46/47	46.4	8		70/71	69.8	21		93/94	93.2	34
48/49	48.2	9		72	71.6	22		95/96	95	35
50/51	50	10		73/74	73.4	23		97/98	96.8	36
52/53	51.8	11		75/76	75.2	24		99	98.6	37
54	53.6	12		77/78	77	25				

Appendix 2: Configuration of Connection Pip

1.Standard length of connection pipe (More details please refer to the specifications.
2.Min. length of connection pipe is 9.84ft.
3.Max. length of connection pipe and max. high difference.(More details please refer to the specifications.
4.The additional refrigerant oil and refrigerant charging required after prolonging connection pipe

● After the length of connection pipe is prolonged for 32.81ft at the basis of standard length, you should add 5ml of refrigerant oil for each additional 16.40ft of connection pipe.

● The calculation method of additional refrigerant charging amount (on the basis of liquid pipe):

● When the length of connection pipe is above 16.40ft, add refrigerant according to the prolonged length of liquid pipe. The additional refrigerant charging amount per meter is different according to the diameter of liquid pipe. See the following sheet.


● Additional refrigerant charging amount = prolonged length of liquid pipe X additional refrigerant charging amount per meter

Additional refrigerant charging amount for R22, R407C, R410A and R134a			
Diameter of connection pipe		Outdoor unit throttle	
Liquid pipe(inch)	Gas pipe(inch)	Cooling only(oz/ft.)	Cooling and heating(oz/ft.)
Φ1/4	Φ3/8or Φ1/2	0.2	0.2
Φ1/4 or Φ3/8	Φ5/8 or Φ3/4	0.2	0.2
Φ1/2	Φ3/4 or Φ7/8	0.3	1.3
Φ5/8	Φ1 or Φ1 1/4	0.7	1.3
Φ3/4	/	2.7	2.7
Φ7/8	/	3.8	3.8

Appendix 3: Pipe Expanding Method


⚠ **Note:**

Improper pipe expanding is the main cause of refrigerant leakage.Please expand the pipe according to the following steps:

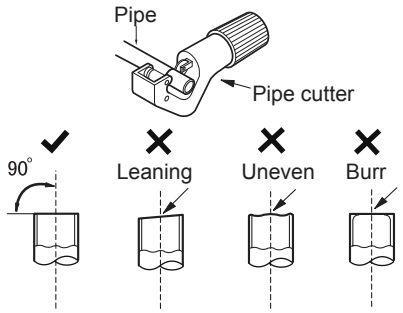


A:Cut the pip
- Confirm the pipe length according to the distance of indoor unit and outdoor unit
- Cut the required pipe with pipe cutter.

B:Remove the burrs
- Remove the burrs with shaper and prevent the burrs from getting into the pipe.



C:Put on suitable insulating pipe


D:Put on the union nut
- Remove the union nut on the indoor connection pipe and outdoor valve; install the union nut on the pipe.




E:Expand the port
- Expand the port with expander.

⚠ **Note:**
- "A" is different according to the diameter, please refer to the sheet below:

Outer diameter(inch)	A(inch)	
	Max	Min
Φ1/4	2/39	1/36
Φ3/8	1/16	1/51
Φ1/2	1/14	1/51
Φ5/8	5/53	2/23

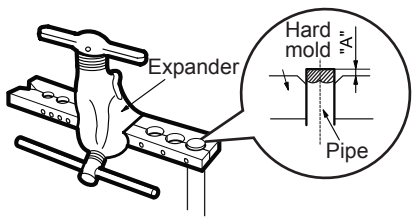

F:Inspection
- Check the quality of expanding port. If there is any blemish, expand the port again according to the steps above.

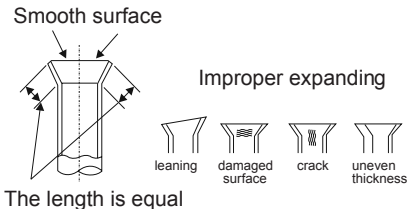

Appendix 4: List of Resistance for Temperature Sensor

Resistance Table of Ambient Temperature Sensor for Indoor and Outdoor Units(15K)

Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)
-2.2	138.1		68	18.75		138.2	3.848		208.4	1.071
-0.4	128.6		69.8	17.93		140	3.711		210.2	1.039
1.4	121.6		71.6	17.14		141.8	3.579		212	1.009
3.2	115		73.4	16.39		143.6	3.454		213.8	0.98
5	108.7		75.2	15.68		145.4	3.333		215.6	0.952
6.8	102.9		77	15		147.2	3.217		217.4	0.925
8.6	97.4		78.8	14.36		149	3.105		219.2	0.898
10.4	92.22		80.6	13.74		150.8	2.998		221	0.873
12.2	87.35		82.4	13.16		152.6	2.896		222.8	0.848
14	82.75		84.2	12.6		154.4	2.797		224.6	0.825
15.8	78.43		86	12.07		156.2	2.702		226.4	0.802
17.6	74.35		87.8	11.57		158	2.611		228.2	0.779
19.4	70.5		89.6	11.09		159.8	2.523		230	0.758
21.2	66.88		91.4	10.63		161.6	2.439		231.8	0.737
23	63.46		93.2	10.2		163.4	2.358		233.6	0.717
24.8	60.23		95	9.779		165.2	2.28		235.4	0.697
26.6	57.18		96.8	9.382		167	2.206		237.2	0.678
28.4	54.31		98.6	9.003		168.8	2.133		239	0.66
30.2	51.59		100.4	8.642		170.6	2.064		240.8	0.642
32	49.02		102.2	8.297		172.4	1.997		242.6	0.625
33.8	46.6		104	7.967		174.2	1.933		244.4	0.608
35.6	44.31		105.8	7.653		176	1.871		246.2	0.592
37.4	42.14		107.6	7.352		177.8	1.811		248	0.577
39.2	40.09		109.4	7.065		179.6	1.754		249.8	0.561
41	38.15		111.2	6.791		181.4	1.699		251.6	0.547
42.8	36.32		113	6.529		183.2	1.645		253.4	0.532
44.6	34.58		114.8	6.278		185	1.594		255.2	0.519
46.4	32.94		116.6	6.038		186.8	1.544		257	0.505
48.2	31.38		118.4	5.809		188.6	1.497		258.8	0.492
50	29.9		120.2	5.589		190.4	1.451		260.6	0.48
51.8	28.51		122	5.379		192.2	1.408		262.4	0.467
53.6	27.18		123.8	5.197		194	1.363		264.2	0.456
55.4	25.92		125.6	4.986		195.8	1.322		266	0.444
57.2	24.73		127.4	4.802		197.6	1.282		267.8	0.433
59	23.6		129.2	4.625		199.4	1.244		269.6	0.422
60.8	22.53		131	4.456		201.2	1.207		271.4	0.412
62.6	21.51		132.8	4.294		203	1.171		273.2	0.401
64.4	20.54		134.6	4.139		204.8	1.136		275	0.391
66.2	19.63		136.4	3.99		206.6	1.103		276.8	0.382

Resistance Table of Tube Temperature Sensors for Indoor and Outdoor (20K)

Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)
-2.2	181.4		68	25.01		138.2	5.13		208.4	1.427
-0.4	171.4		69.8	23.9		140	4.948		210.2	1.386
1.4	162.1		71.6	22.85		141.8	4.773		212	1.346
3.2	153.3		73.4	21.85		143.6	4.605		213.8	1.307
5	145		75.2	20.9		145.4	4.443		215.6	1.269
6.8	137.2		77	20		147.2	4.289		217.4	1.233
8.6	129.9		78.8	19.14		149	4.14		219.2	1.198
10.4	123		80.6	18.13		150.8	3.998		221	1.164
12.2	116.5		82.4	17.55		152.6	3.861		222.8	1.131
14	110.3		84.2	16.8		154.4	3.729		224.6	1.099
15.8	104.6		86	16.1		156.2	3.603		226.4	1.069
17.6	99.13		87.8	15.43		158	3.481		228.2	1.039
19.4	94		89.6	14.79		159.8	3.364		230	1.01
21.2	89.17		91.4	14.18		161.6	3.252		231.8	0.983
23	84.61		93.2	13.59		163.4	3.144		233.6	0.956
24.8	80.31		95	13.04		165.2	3.04		235.4	0.93
26.6	76.24		96.8	12.51		167	2.94		237.2	0.904
28.4	72.41		98.6	12		168.8	2.844		239	0.88
30.2	68.79		100.4	11.52		170.6	2.752		240.8	0.856
32	65.37		102.2	11.06		172.4	2.663		242.6	0.833
33.8	62.13		104	10.62		174.2	2.577		244.4	0.811
35.6	59.08		105.8	10.2		176	2.495		246.2	0.77
37.4	56.19		107.6	9.803		177.8	2.415		248	0.769
39.2	53.46		109.4	9.42		179.6	2.339		249.8	0.746
41	50.87		111.2	9.054		181.4	2.265		251.6	0.729
42.8	48.42		113	8.705		183.2	2.194		253.4	0.71
44.6	46.11		114.8	8.37		185	2.125		255.2	0.692
46.4	43.92		116.6	8.051		186.8	2.059		257	0.674
48.2	41.84		118.4	7.745		188.6	1.996		258.8	0.658
50	39.87		120.2	7.453		190.4	1.934		260.6	0.64
51.8	38.01		122	7.173		192.2	1.875		262.4	0.623
53.6	36.24		123.8	6.905		194	1.818		264.2	0.607
55.4	34.57		125.6	6.648		195.8	1.736		266	0.592
57.2	32.98		127.4	6.403		197.6	1.71		267.8	0.577
59	31.47		129.2	6.167		199.4	1.658		269.6	0.563
60.8	30.04		131	5.942		201.2	1.609		271.4	0.549
62.6	28.68		132.8	5.726		203	1.561		273.2	0.535
64.4	27.39		134.6	5.519		204.8	1.515		275	0.521
66.2	26.17		136.4	5.32		206.6	1.47		276.8	0.509

Resistance Table of Discharge Temperature Sensor for Outdoor(50K)

Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)		Temp.(°F)	Resistance(kΩ)
-20.2	853.5		50	98		120.2	18.34		190.4	4.754
-18.4	799.8		51.8	93.42		122	17.65		192.2	4.609
-16.6	750		53.6	89.07		123.8	16.99		194	4.469
-14.8	703.8		55.4	84.95		125.6	16.36		195.8	4.334
-13	660.8		57.2	81.05		127.4	15.75		197.6	4.204
-11.2	620.8		59	77.35		129.2	15.17		199.4	4.079
-9.4	580.6		60.8	73.83		131	14.62		201.2	3.958
-7.6	548.9		62.6	70.5		132.8	14.09		203	3.841
-5.8	516.6		64.4	67.34		134.6	13.58		204.8	3.728
-4	486.5		66.2	64.33		136.4	13.09		206.6	3.619
-2.2	458.3		68	61.48		138.2	12.62		208.4	3.514
-0.4	432		69.8	58.77		140	12.17		210.2	3.413
1.4	407.4		71.6	56.19		141.8	11.74		212	3.315
3.2	384.5		73.4	53.74		143.6	11.32		213.8	3.22
5	362.9		75.2	51.41		145.4	10.93		215.6	3.129
6.8	342.8		77	49.19		147.2	10.54		217.4	3.04
8.6	323.9		78.8	47.08		149	10.18		219.2	2.955
10.4	306.2		80.6	45.07		150.8	9.827		221	2.872
12.2	289.6		82.4	43.16		152.6	9.489		222.8	2.792
14	274		84.2	41.34		154.4	9.165		224.6	2.715
15.8	259.3		86	39.61		156.2	8.854		226.4	2.64
17.6	245.6		87.8	37.96		158	8.555		228.2	2.568
19.4	232.6		89.6	36.38		159.8	8.268		230	2.498
21.2	220.5		91.4	34.88		161.6	7.991		231.8	2.431
23	209		93.2	33.45		163.4	7.726		233.6	2.365
24.8	198.3		95	32.09		165.2	7.47		235.4	2.302
26.6	199.1		96.8	30.79		167	7.224		237.2	2.241
28.4	178.5		98.6	29.54		168.8	6.998		239	2.182
30.2	169.5		100.4	28.36		170.6	6.761		240.8	2.124
32	161		102.2	27.23		172.4	6.542		242.6	2.069
33.8	153		104	26.15		174.2	6.331		244.4	2.015
35.6	145.4		105.8	25.11		176	6.129		246.2	1.963
37.4	138.3		107.6	24.13		177.8	5.933		248	1.912
39.2	131.5		109.4	23.19		179.6	5.746		249.8	1.863
41	125.1		111.2	22.29		181.4	5.565		251.6	1.816
42.8	119.1		113	21.43		183.2	5.39		253.4	1.77
44.6	113.4		114.8	20.6		185	5.222		255.2	1.725
46.4	108		116.6	19.81		186.8	5.06		257	1.682
48.2	102.8		118.4	19.06		188.6	4.904		258.8	1.64